
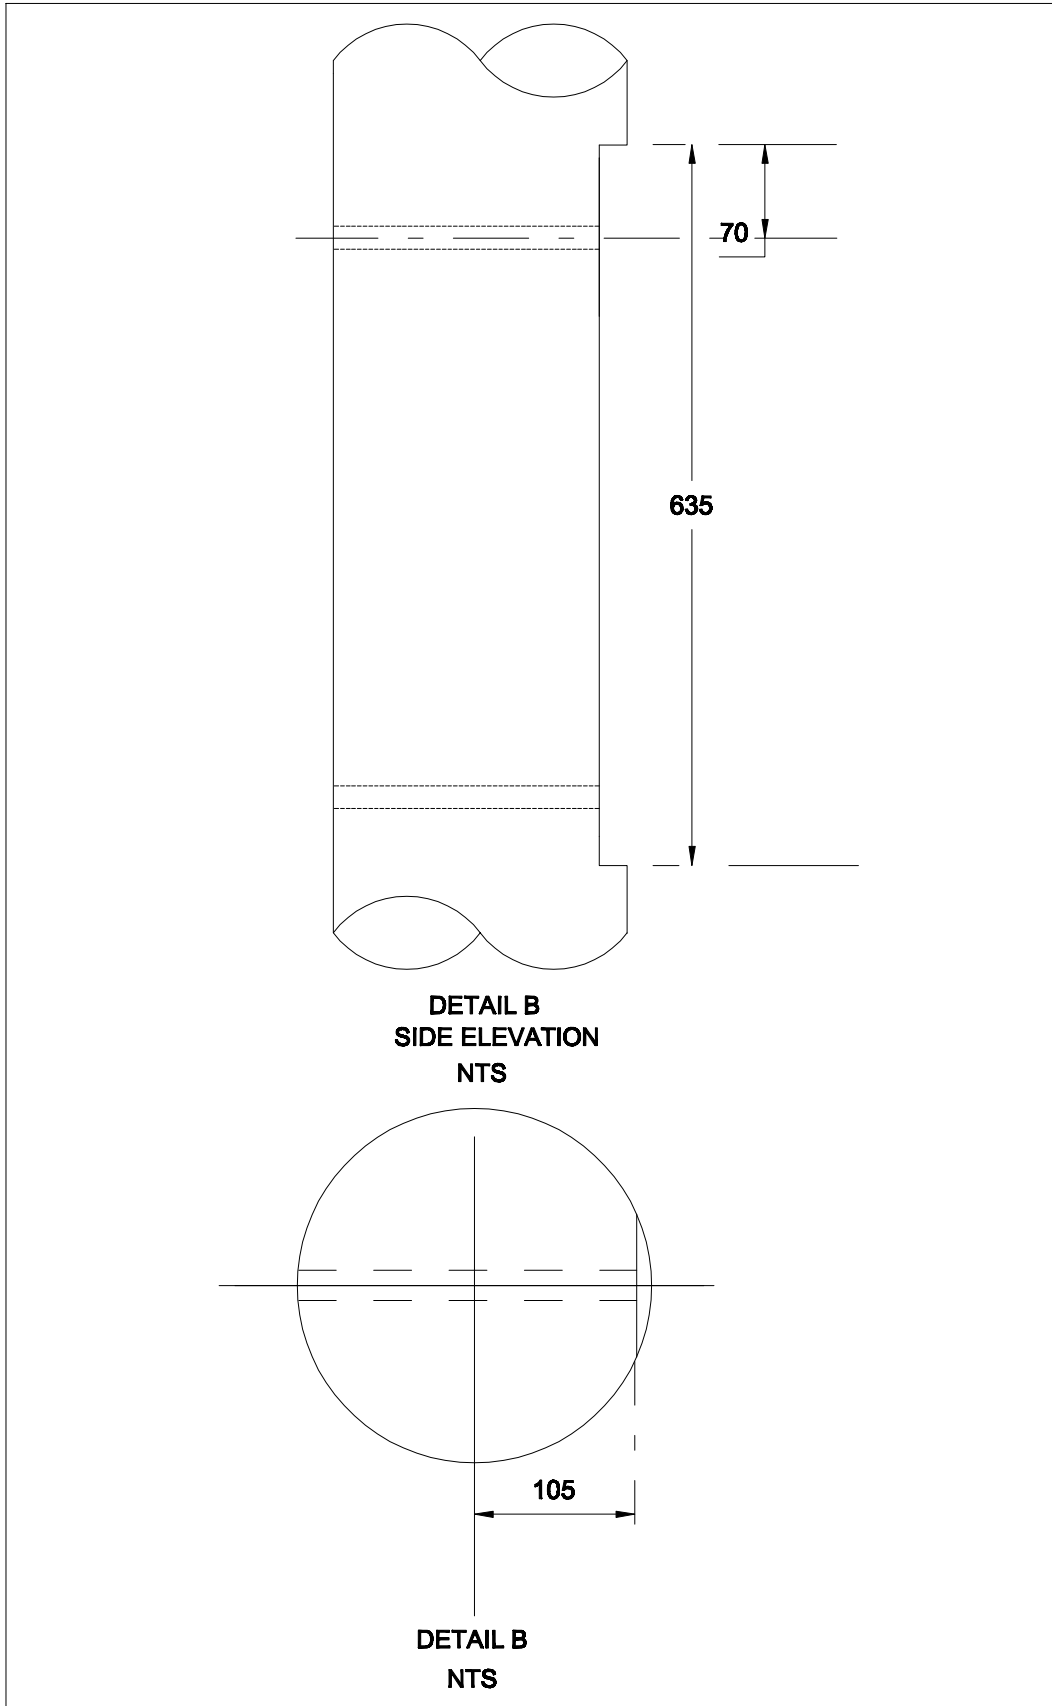
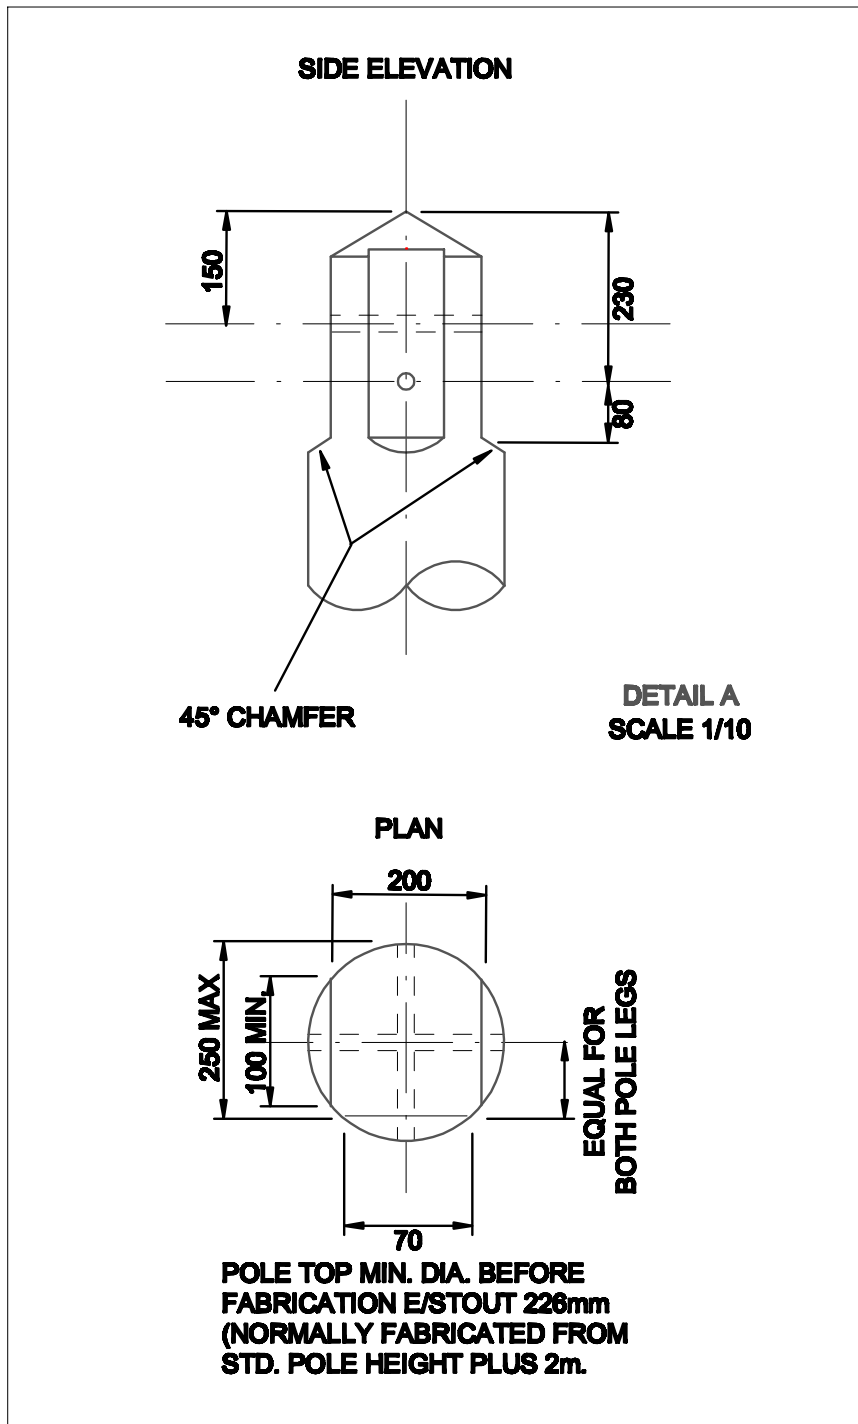


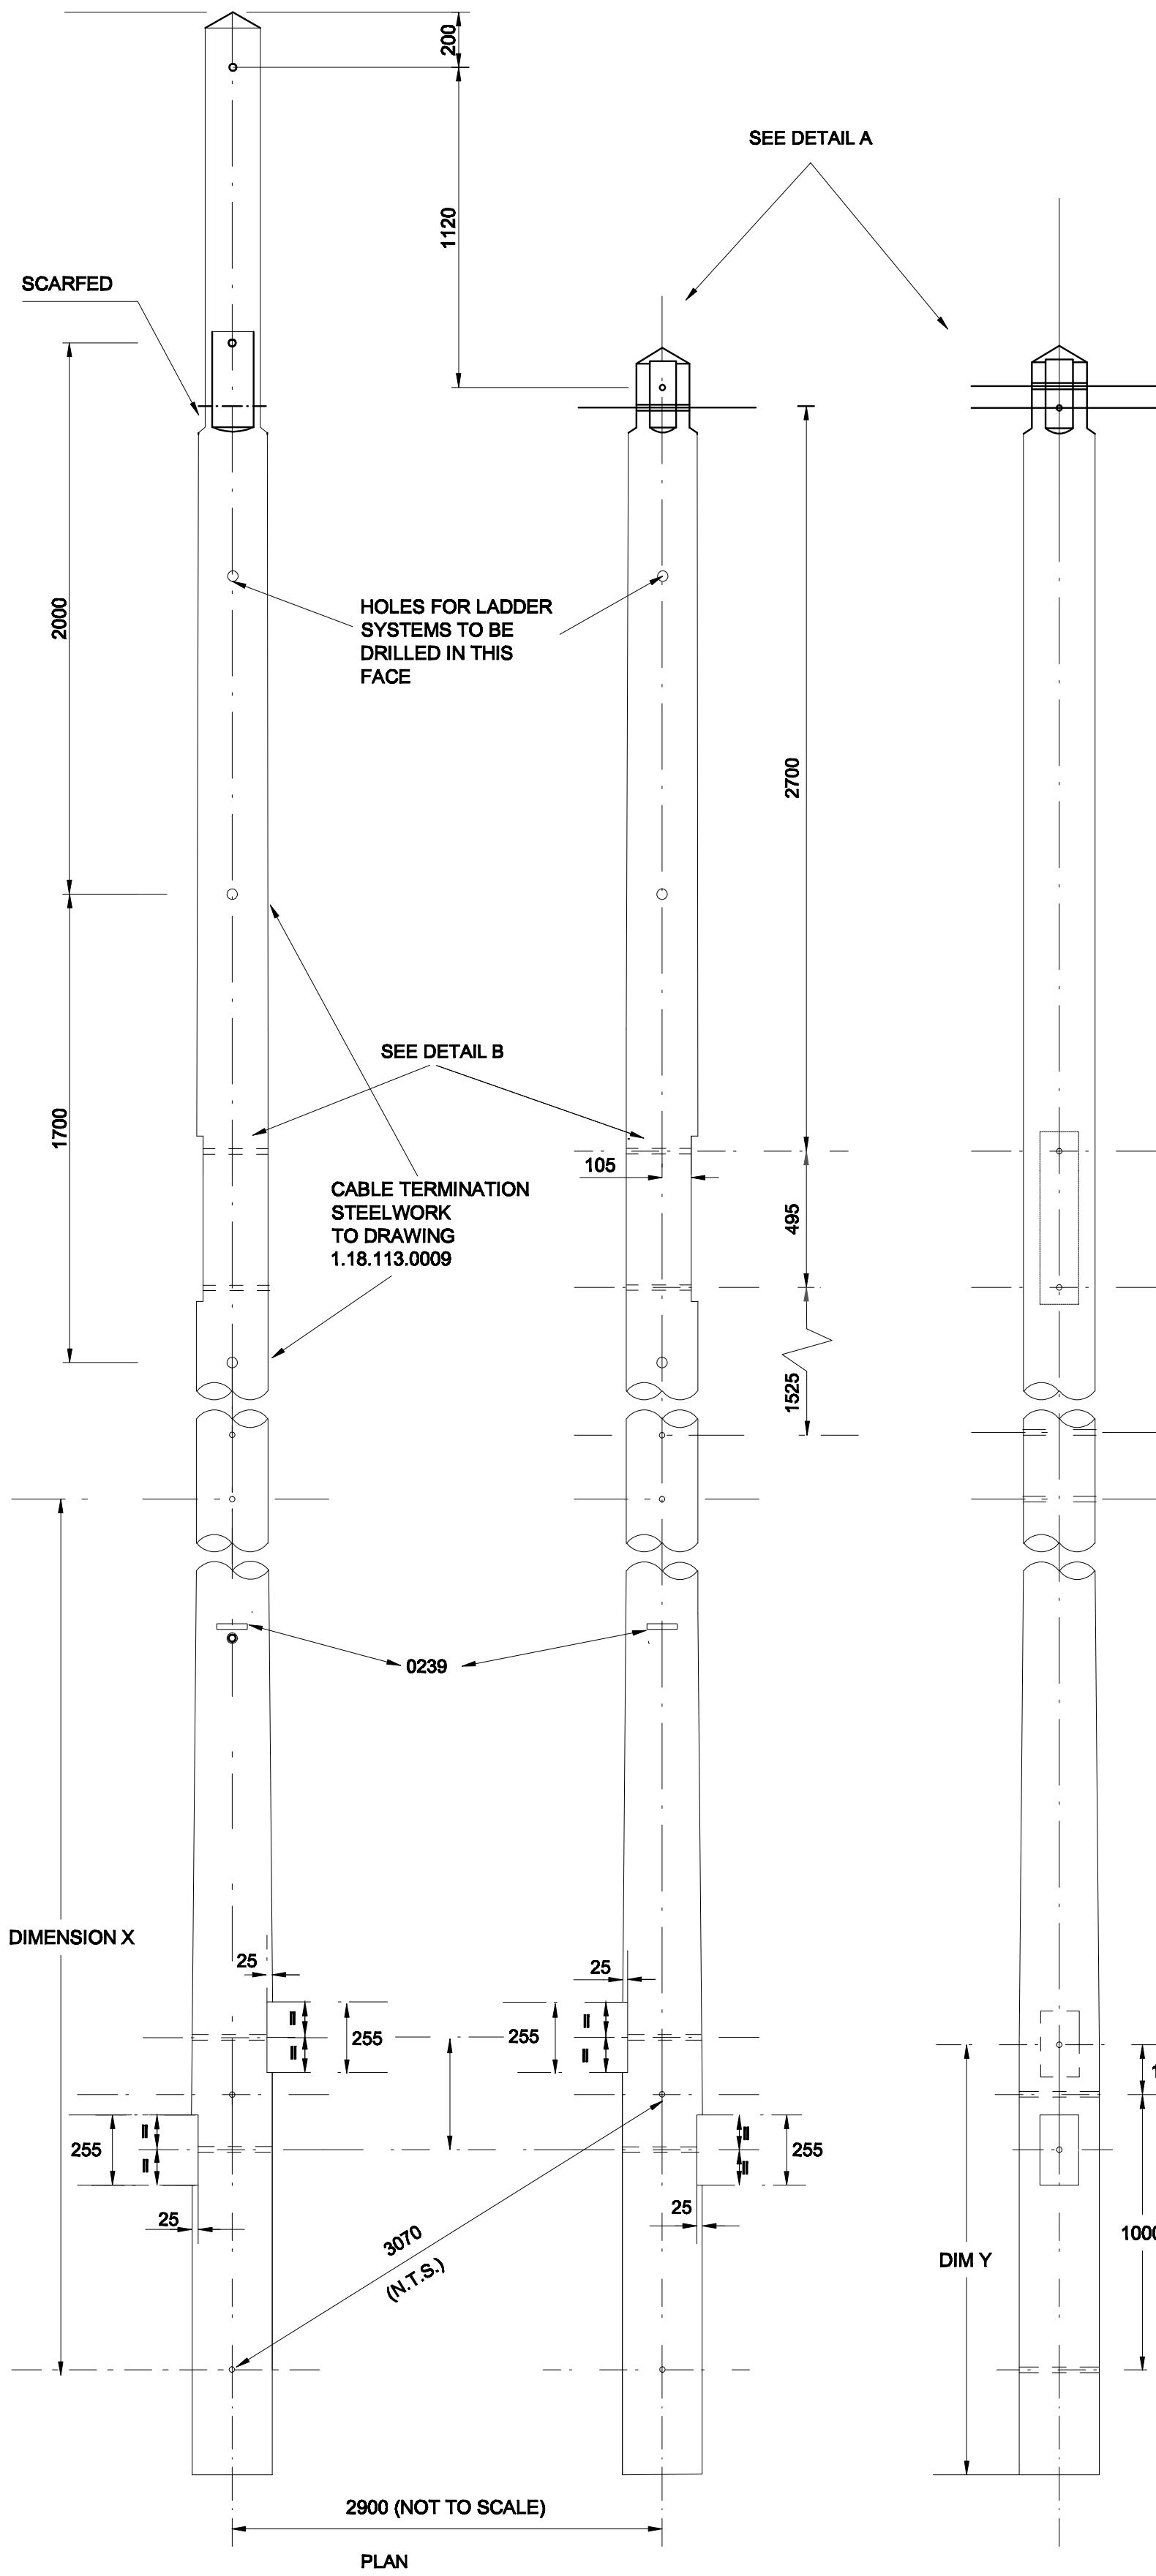

- NOTES:**
- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT - 230mm 226mm (NORMALLY FABRICATED FROM STD. POLE HEIGHT PLUS 2.0m).
 - ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
 - POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
 - POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
 - POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
 - HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE
 - 1 LEG ONLY EXTENDED TO ACCOMMODATE EARTH WIRE ATTACHMENT ON WOODHOUSE MAST DESIGNS

POLE LENGTH	DIM X	DIM Y
12.0m	5655	1700
13.0m	6655	1700
14.0m	7655	1700
15.0m	8655	1700
16.0m	9655	1900

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

 NORTHERN POWERGRID Manufacturer Details	Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
	33KV SINGLE CIRCUIT LINES DRILLING AND SCARFING FOR TERMINAL SUPPORT WITH SURGE ARRESTERS - 1173 SHEET 18 & 20	
Sheet No. 19	Scale 1:20	Type OVERHEAD
Prepared By Joan.Oakley	Grid Reference	POLES
Revised 13/11/14	Date Issued 08/10/14	Ref No. C1040897
Checked By M WILSON	Notes	Historic Drg.No. 1091231173