

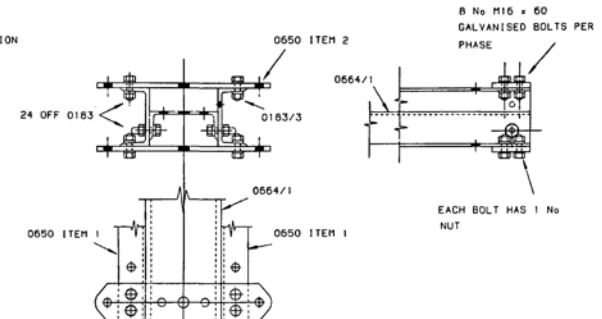
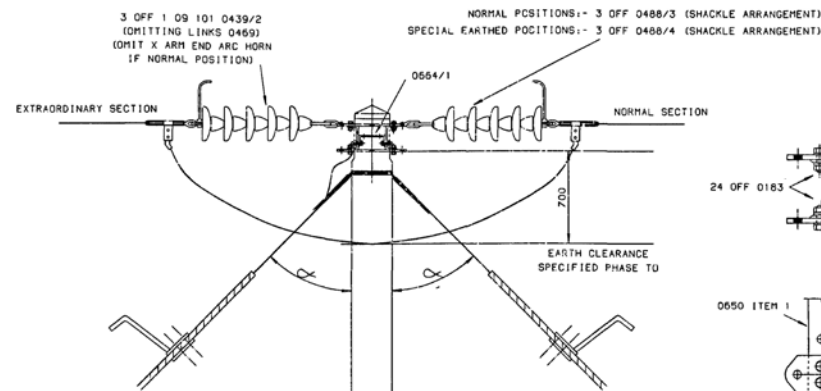


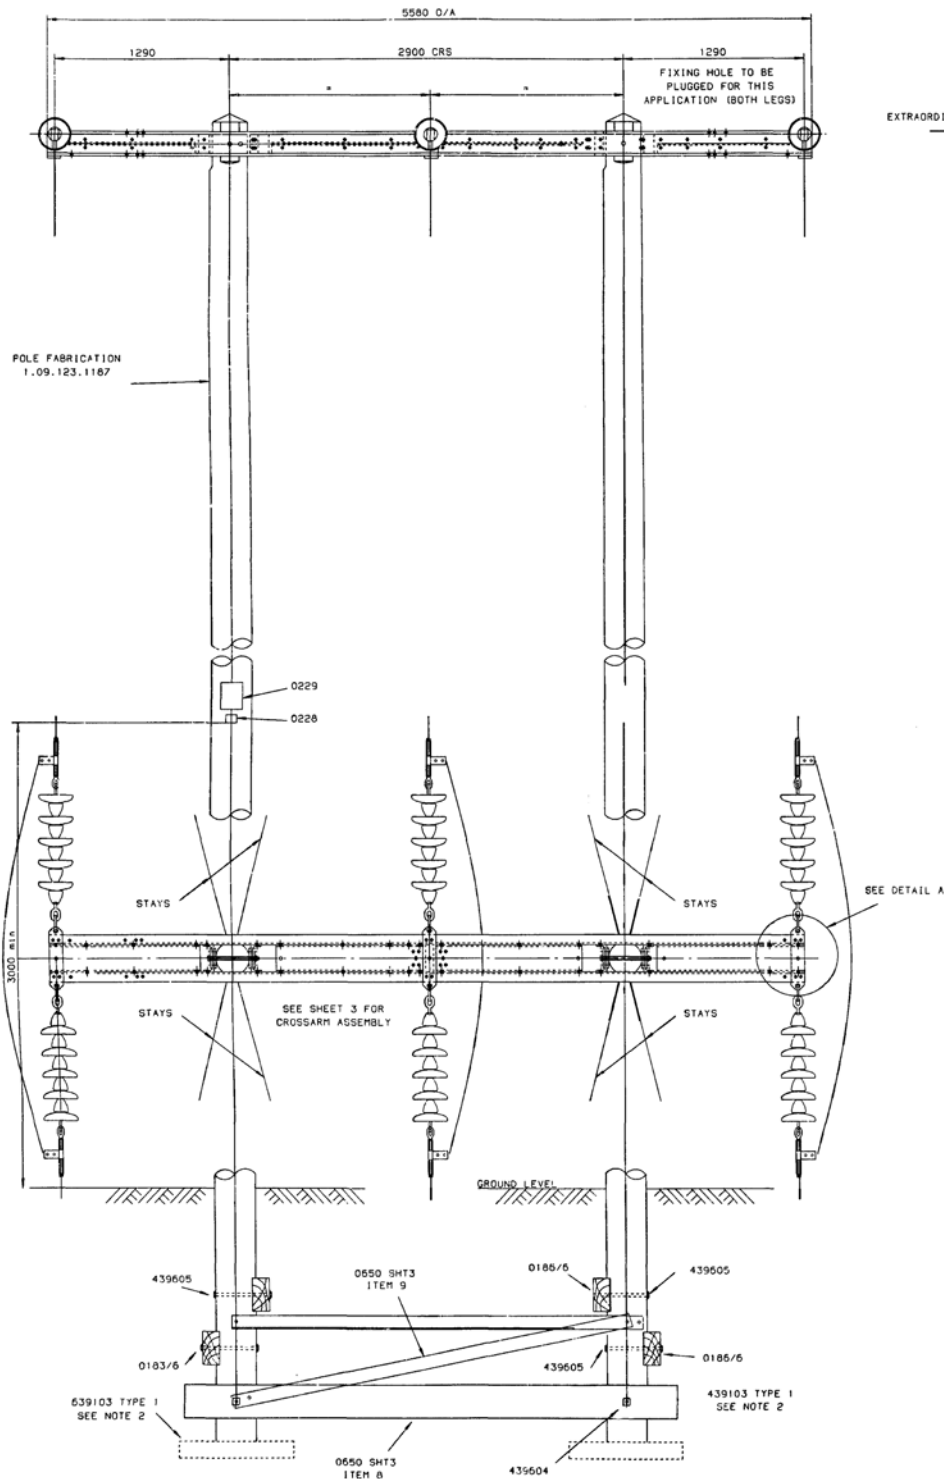

ENLARGED DETAIL A  
SCALE 1:7.5


STAYS AS SPECIFIED  
IN OHL 4  
C NORMALLY 45°

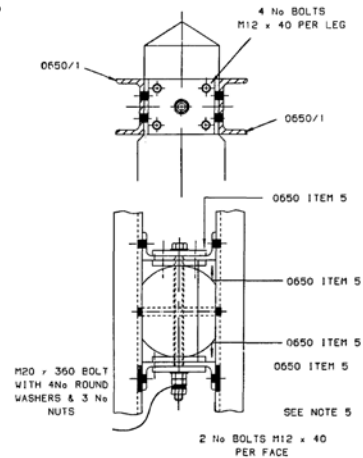

ENLARGED DETAIL OF CROSSARM  
FIXING SCALE 1:7.5

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
  2. FOOTING USED WHEN REQUIRED TO CONSIST OF 2 No WOOD BAULKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
  3. DETAILED DRGS PREFIXED 43... REFER TO ES1 BASED DRAWINGS AND OTHER DETAILED DRGS REFER TO 1.09.101 SERIES.
  4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 700 MIN. CLEARANCE BETWEEN DISSIMILAR PHASES TO BE 1500 MIN.
  5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS SPECIFIED OTHERWISE.
  6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS.
  7. ARRANGEMENTS NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0M LENGTH.

| POLE LENGTH               | DIM X |
|---------------------------|-------|
| UP TO AND INCLUDING 12.0M | 2.0M  |
| 13.0M TO 15.0M INCLUSIVE  | 2.2M  |
| 16.0M TO 18.0M INCLUSIVE  | 2.4M  |

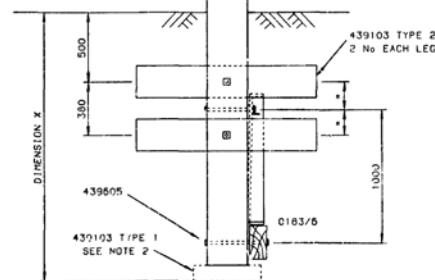

NORTHERN ELECTRIC  
Northern Electric, Central House, Newcastle upon Tyne NE1 0NE

60kV SINGLE CIRCUIT OVERHEAD LINES.  
OUT OF BALANCE SECTION ARRANGEMENT TO  
EXTRAORDINARY SECTION - NEW CONSTRUCTION

|                        |              |               |                       |           |             |                   |               |
|------------------------|--------------|---------------|-----------------------|-----------|-------------|-------------------|---------------|
| Drawn<br>CT            | Traced<br>CT | Checked<br>CH | Date Issued<br>FEB 87 | Code<br>N | Sheet No. 2 | Revised<br>JAN 86 | Scale<br>1:20 |
| Dwg. No. 1 09 123 1173 |              |               |                       |           |             |                   |               |

WORK SPEC No 04/22