

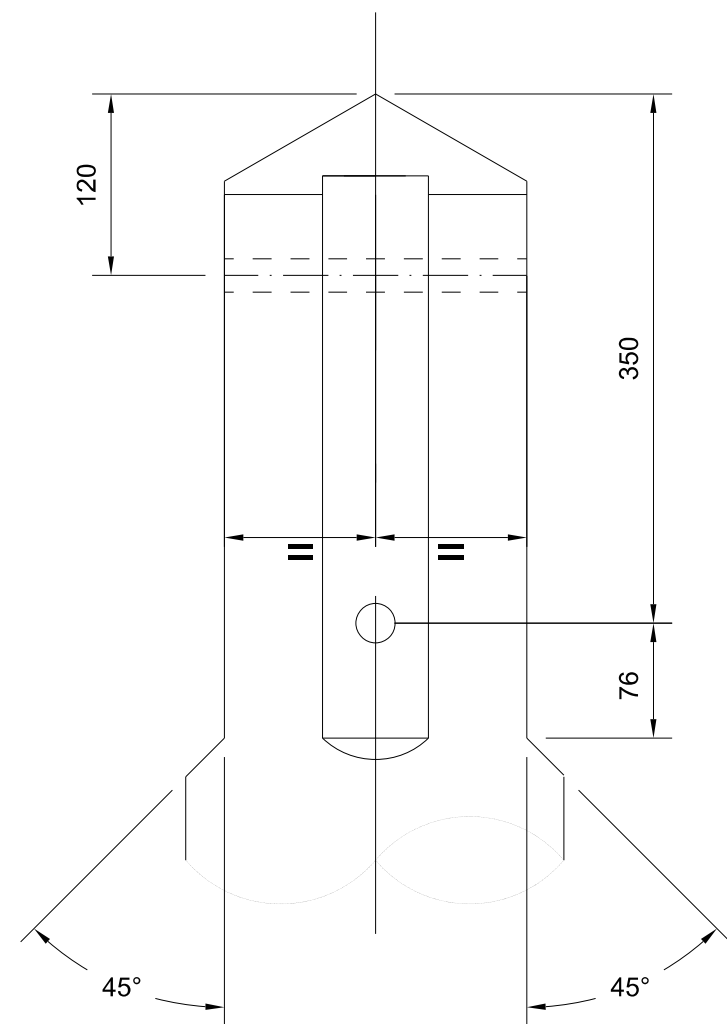
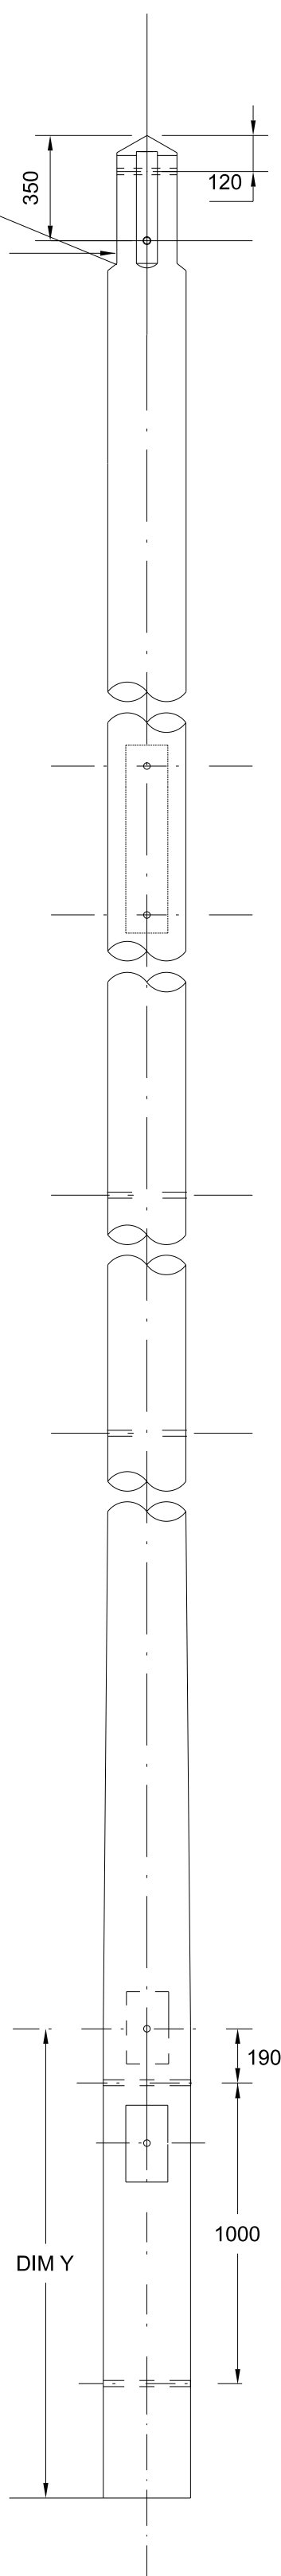


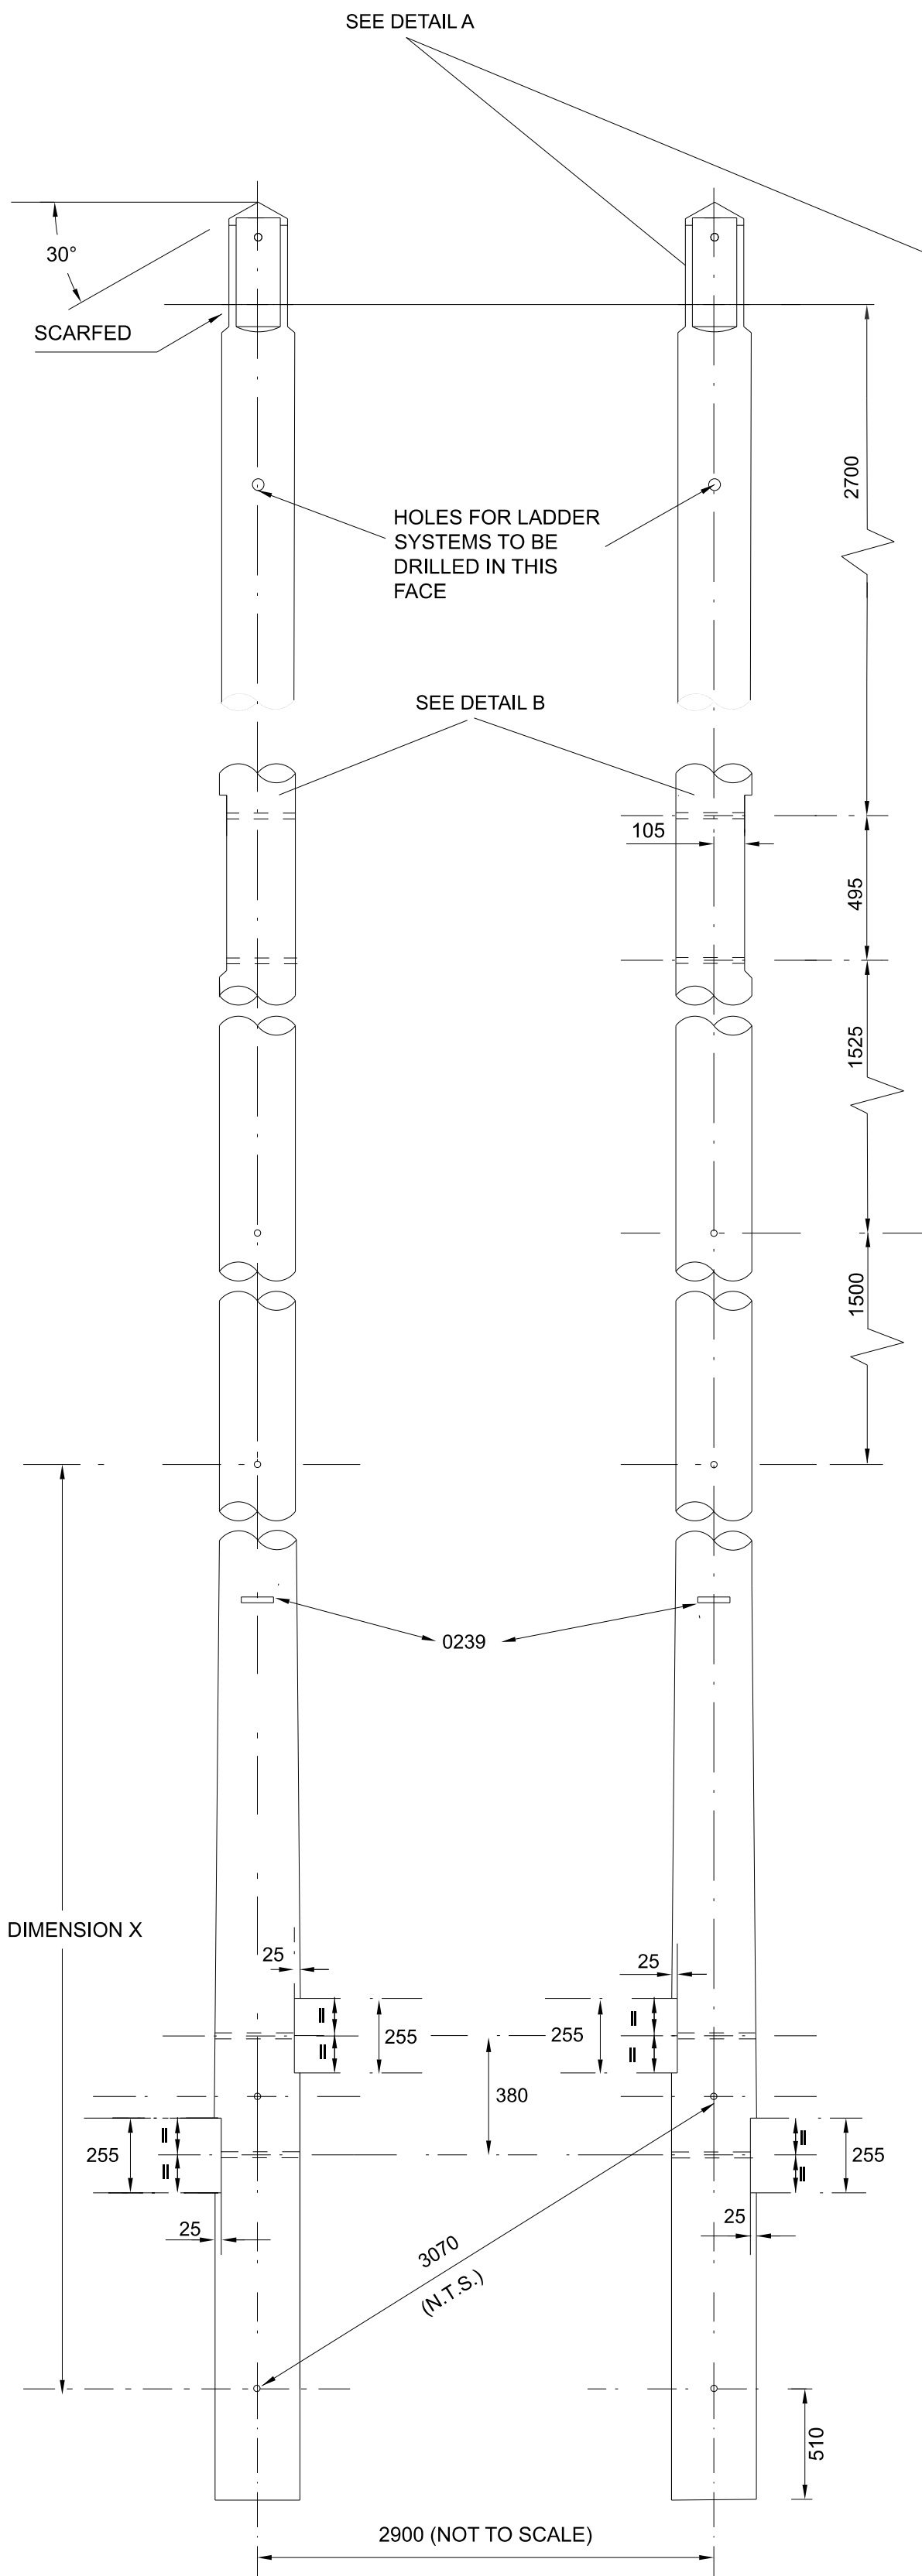


SIDE ELEVATION ON VIEW 'A' & 'B'
SCALE 1:5


SIDE ELEVATION

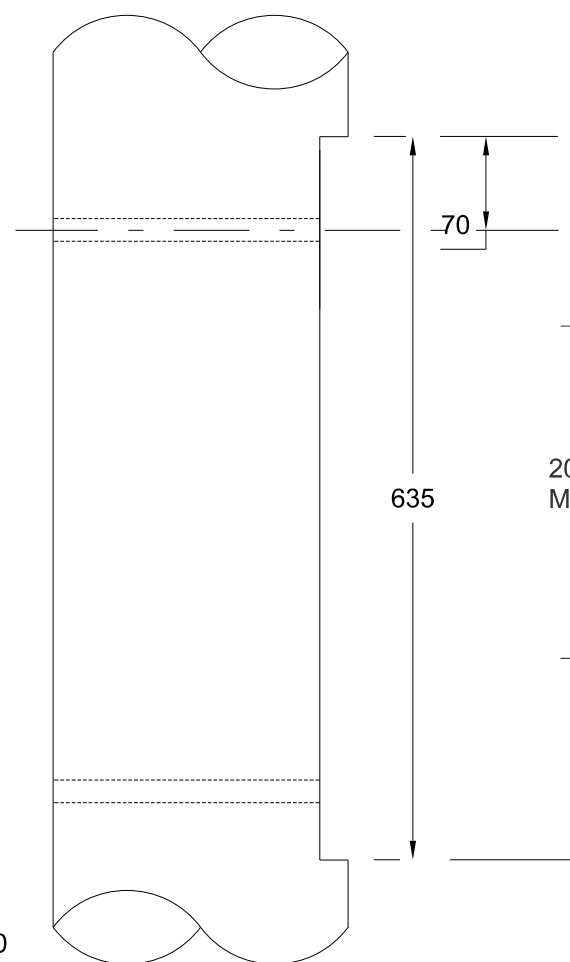

DETAIL B
SIDE ELEVATION
NTS

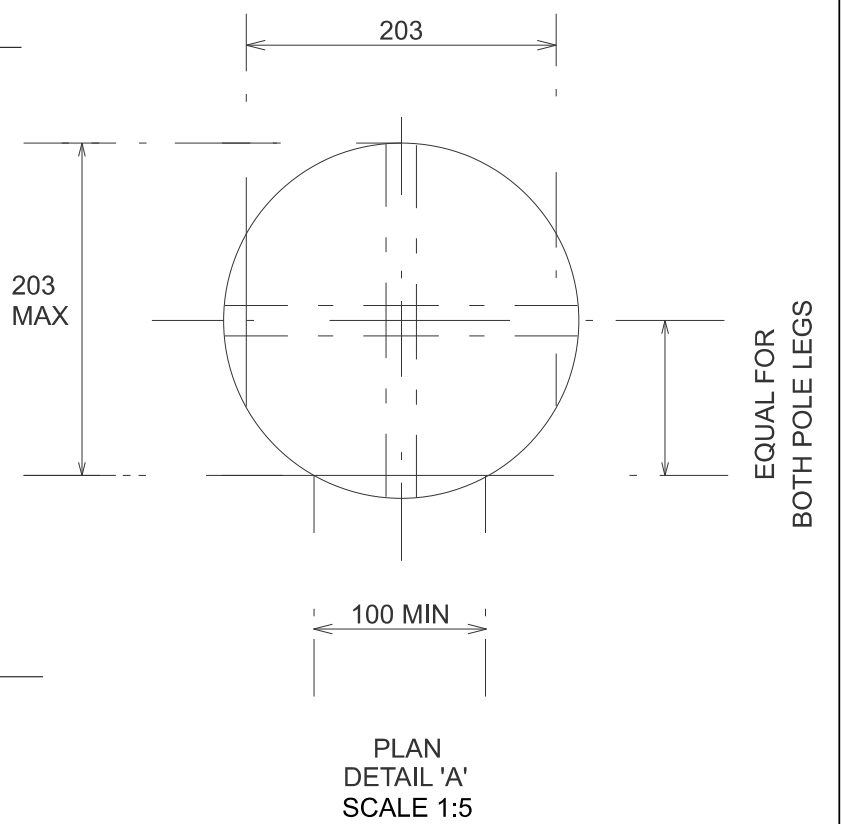

PLAN
DETAIL 'A'
SCALE 1:5

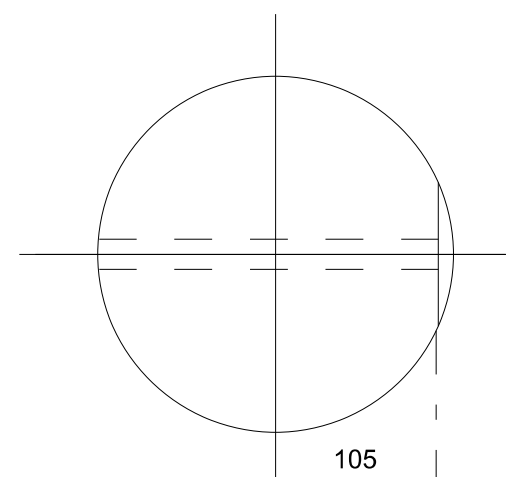

DETAIL B
PLAN

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION
STOUT - 230mm
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE
OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO
CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO
DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS
EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS
1 00 043 9604 AND 9605 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL
BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	4920	1700
13.0m	5920	1700
14.0m	6920	1700
15.0m	7920	1700
16.0m	8920	1900

 NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		
Manufacturer Details		66KV SINGLE CIRCUIT LINES DRILLING AND SCARFING FOR TERMINAL SUPPORT WITH SURGE ARRESTERS - 1173 SHEET 4		
Sheet No. 5	Scale 1:20	Type OVERHEAD POLES		
Prepared By W7Brian.James		Ref No. C995434		
Revised 01/05/26	Grid Reference	Historic Drg.No.		
Date Issued 16/02/11	Checked By S SALKELD	1091231173		
Revision H		Notes SOME DIMENSIONS CHANGE TO MUP		