


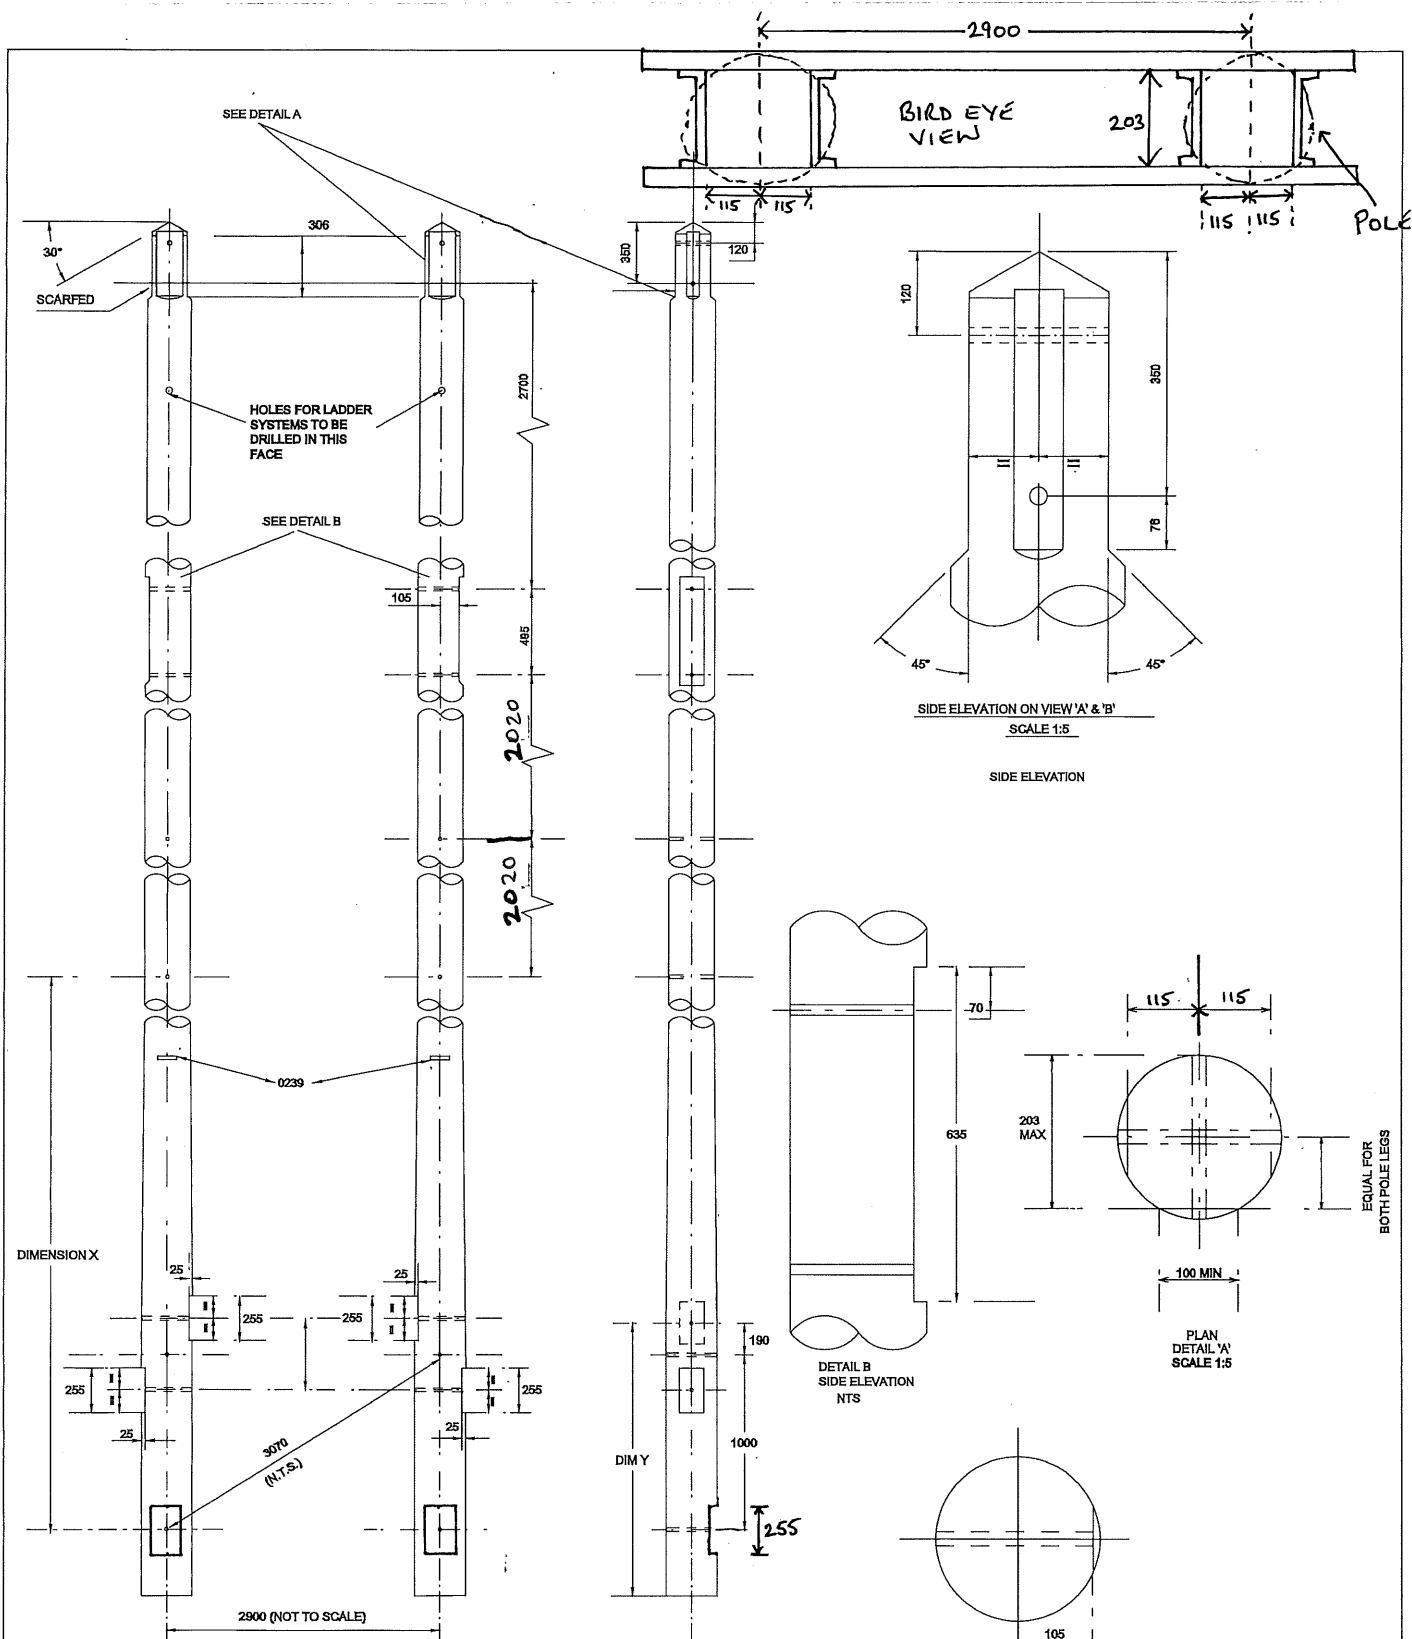

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 250mm
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BALKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BALKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9804 AND 9805 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	4920	1700
13.0m	5920	1700
14.0m	6920	1700
15.0m	7920	1700
16.0m	8920	1900

NORTHERN POWERGRID Manufacturer Details		Lloyds Court, 78 Gray Street, Newcastle Upon Tyne, NE1 6AF 66kV SINGLE CIRCUIT LINES DRILLING AND SCARFING FOR TERMINAL SUPPORT WITH SURGE ARRESTERS - 1173 SHEET 4	
Street No. 5	Scale 1:20	Type OVERHEAD	POLES
Prepared By Barbara Gordon	Grid Reference	Ref No. C995434	Historic Drg. No. 1091231173
Revised 18/06/16	Checked By S. SAUKELD	Revision	Notes
Date Issued 16/02/11			

1.09.123.1173 SHEET 5
 MODIFIED BY PETER BEARDSHAW
 20.08.18