


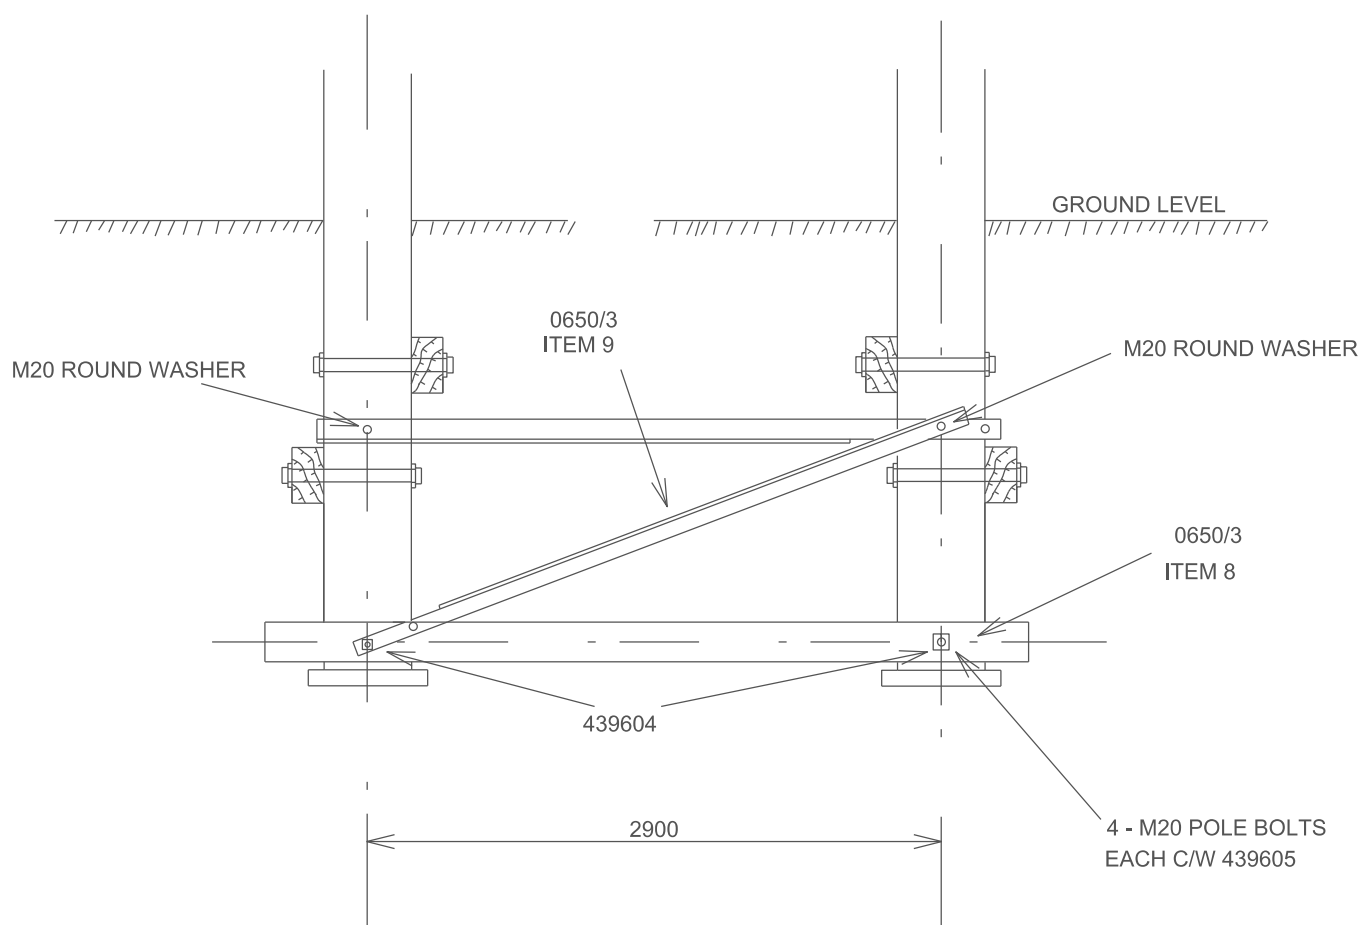

NOTE:

ONLY THOSE MATERIALS IDENTIFIED SEPERATELY
INCLUDED IN THE SUB ASSEMBLY

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

NEDL

NEDL, Manor House, Station Road, Houghton le Spring, DH4 7LA.

66kV SINGLE CIRCUIT OVERHEAD LINES
CROSS BRACED FOUNDATION AUGMENTATION FOR PORTAL
TYPE POLE TO SPECIFICATION O.H.L.4/84

Prepared By

C.M.

Checked

R.M.D.

Date Issued

AUG '85

Drg.No.

1

09

123

1187

Mods.

A

B

C

D

E

Sheet No.

2

Revised.

JUNE '03

Scale

N.T.S.