


0239

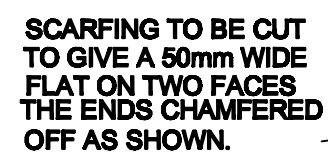

NOTES

- 1. CLASS OF POLE TO BE 'STOUT' OR EXTRA STOUT IN ACCORDANCE WITH 1.09.101.0238**
- 2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE**
- 3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING**
- 4. POLE TO BE NOTCHED AND DRILLED FOR
1 x 250 x 125 x 2500 AND
1 x 250 x 125 x 1300 LONG BAULKS**
- 5. EXTRA STOUT POLES TO BE NORMALLY FITTED WITH DOUBLE BAULKS. EXTRA STOUT POLES DESIGNED TO INCREASE WIND SPANS MAY BE UNSUITABLE FOR POOR GROUND CONDITIONS. SEE SPECIFICATION.**

POLE LENGTH	DIM. 'S'
13.0m - 15.0m INCLUSIVE	2.1
16.0m - 18.0m INCLUSIVE	2.1
20.0m - 24m INCLUSIVE	2.5

**NORTHERN
POWERGRID**

Manufacturer Details

Sheet No. 2	Scale 1:20
----------------	---------------

Prepared By	
-------------	--

Revised

01/10/14
Date Issued
01/10/14

Grid Reference

Checked By	M MOODY
------------	---------

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR SINGLE INTERMEDIATE POLE ARRANGEMENT

Type	OVERHEAD
------	----------

Ref No.	C1040650
---------	----------

Revision	Notes
----------	-------

**Historic
Drg.No.**

1091380006