
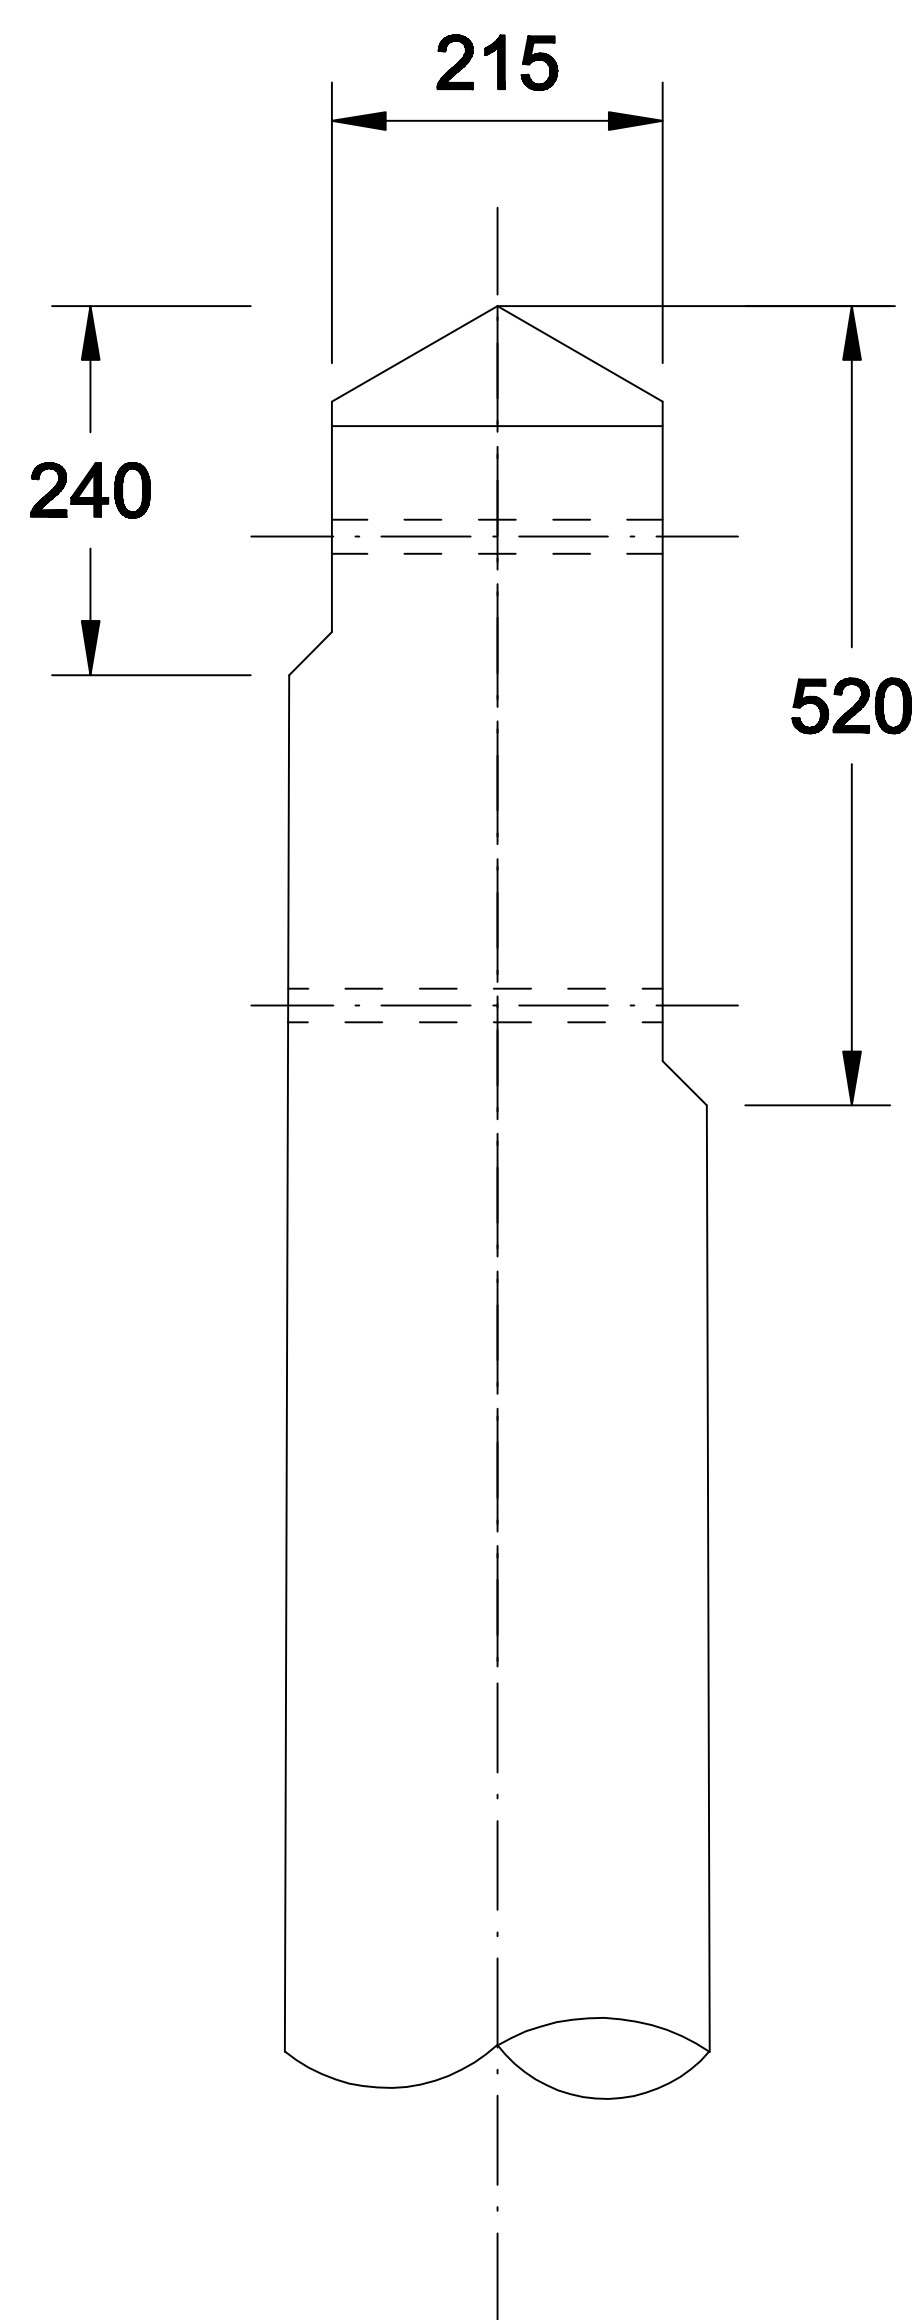


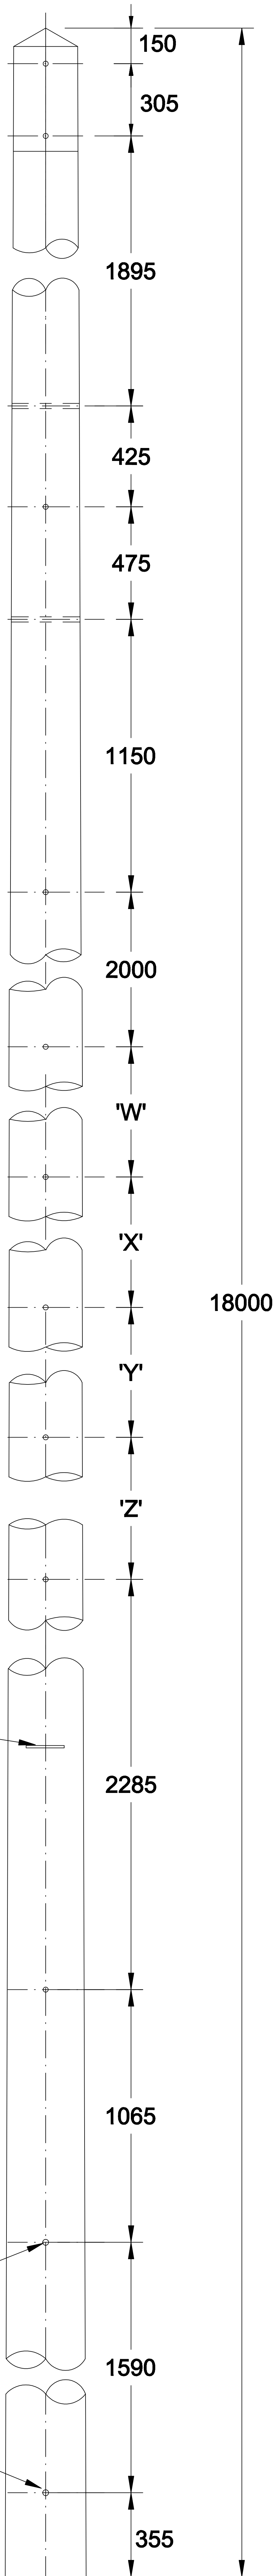

SCALE 1:10

NOTES

- 1. POLES TO BE "STOUT " CLASS
- 2. POLES TO BE MATCHED FOR "H" STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS
- 3. ALL HOLES TO BE 22mm DIAMETER (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT

POLE LENGTH	DIM 'W'	DIM 'X'	DIM 'Y'	DIM 'Z'
18.0m	2000	2000	2000	305
17.0m	2000	2000	1455	0
16.0m	2000	2000	455	0
15.0m	2000	1605	0	0
14.0m	2000	605	0	0
13.0m	1705	0	0	0
12.0m	705	0	0	0
11.5m	405	0	0	0

GOUGE MARK
TO ESI 43 - 88

HOLES 26mm
DIAMETER

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

FORMERLY YE DRAWING No Y204L0606 sheet 8

Prepared by
J.L.W.

Checked
G.H.

Date Issued
MAR 05

Lloyds Court, 78, Grey Street, Newcastle Upon Tyne, NE1 6AF

POLE FABRICATION
FOR 66kV POLYMERIC CABLE TERMINATION WITH
PORCELAIN TYPE MB75 SURGE DIVERTERS CE/C/37 (M1)

Drg.No.
1 09 138 0009

Mod.

Sheet No.
1

Revised

Scale
1:20@A2