
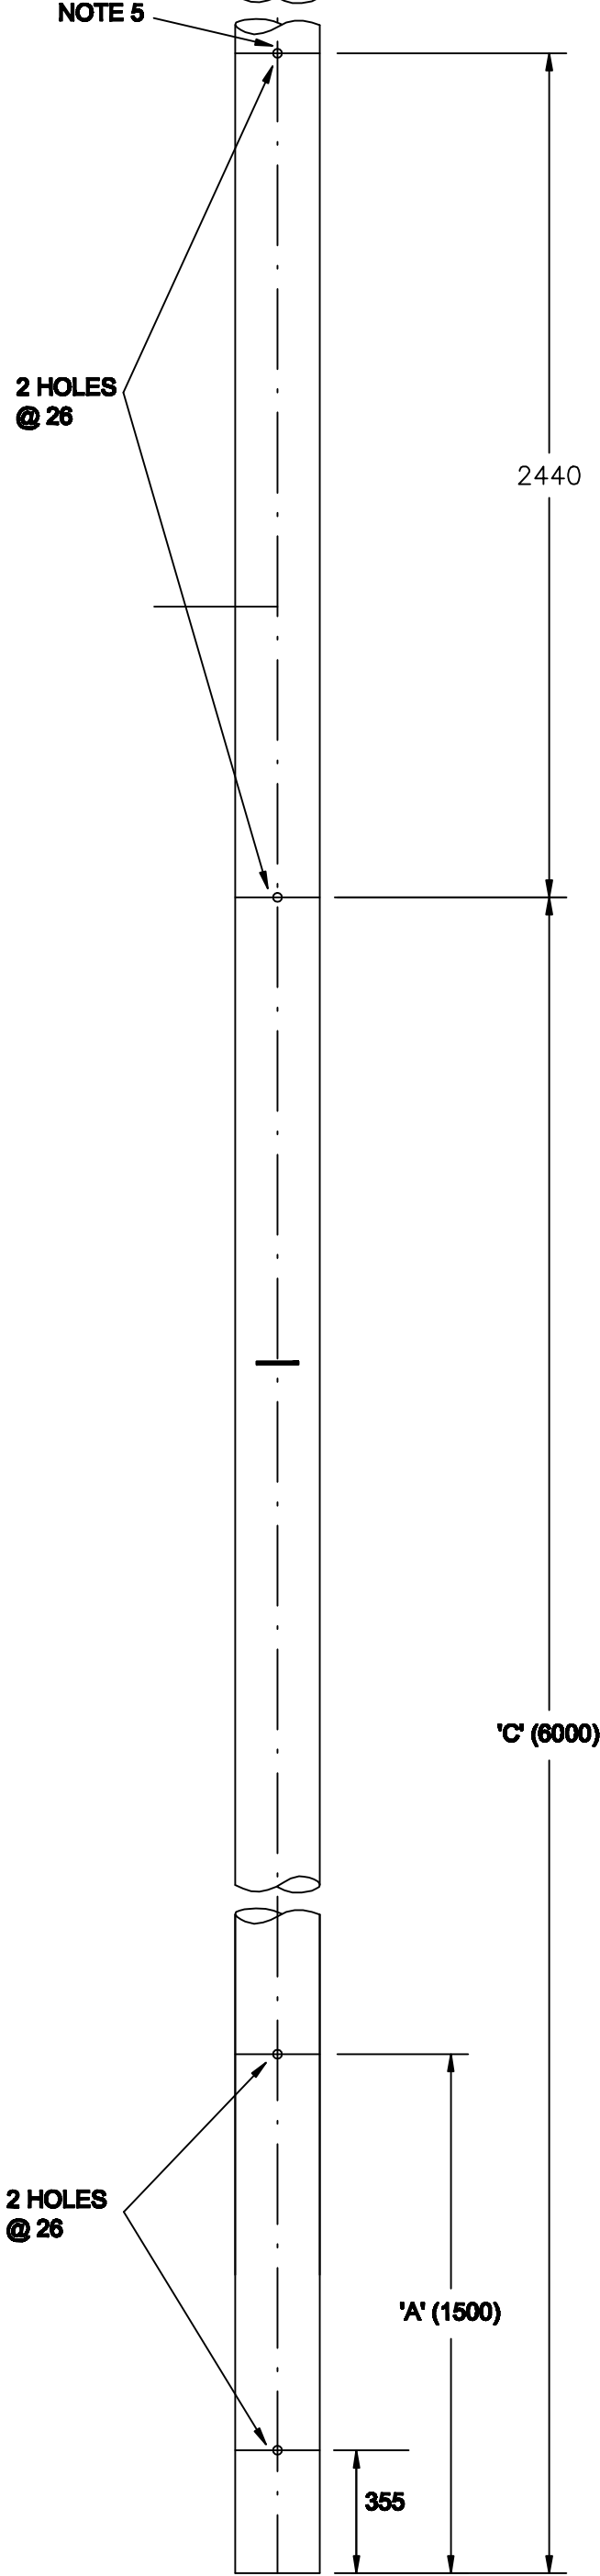
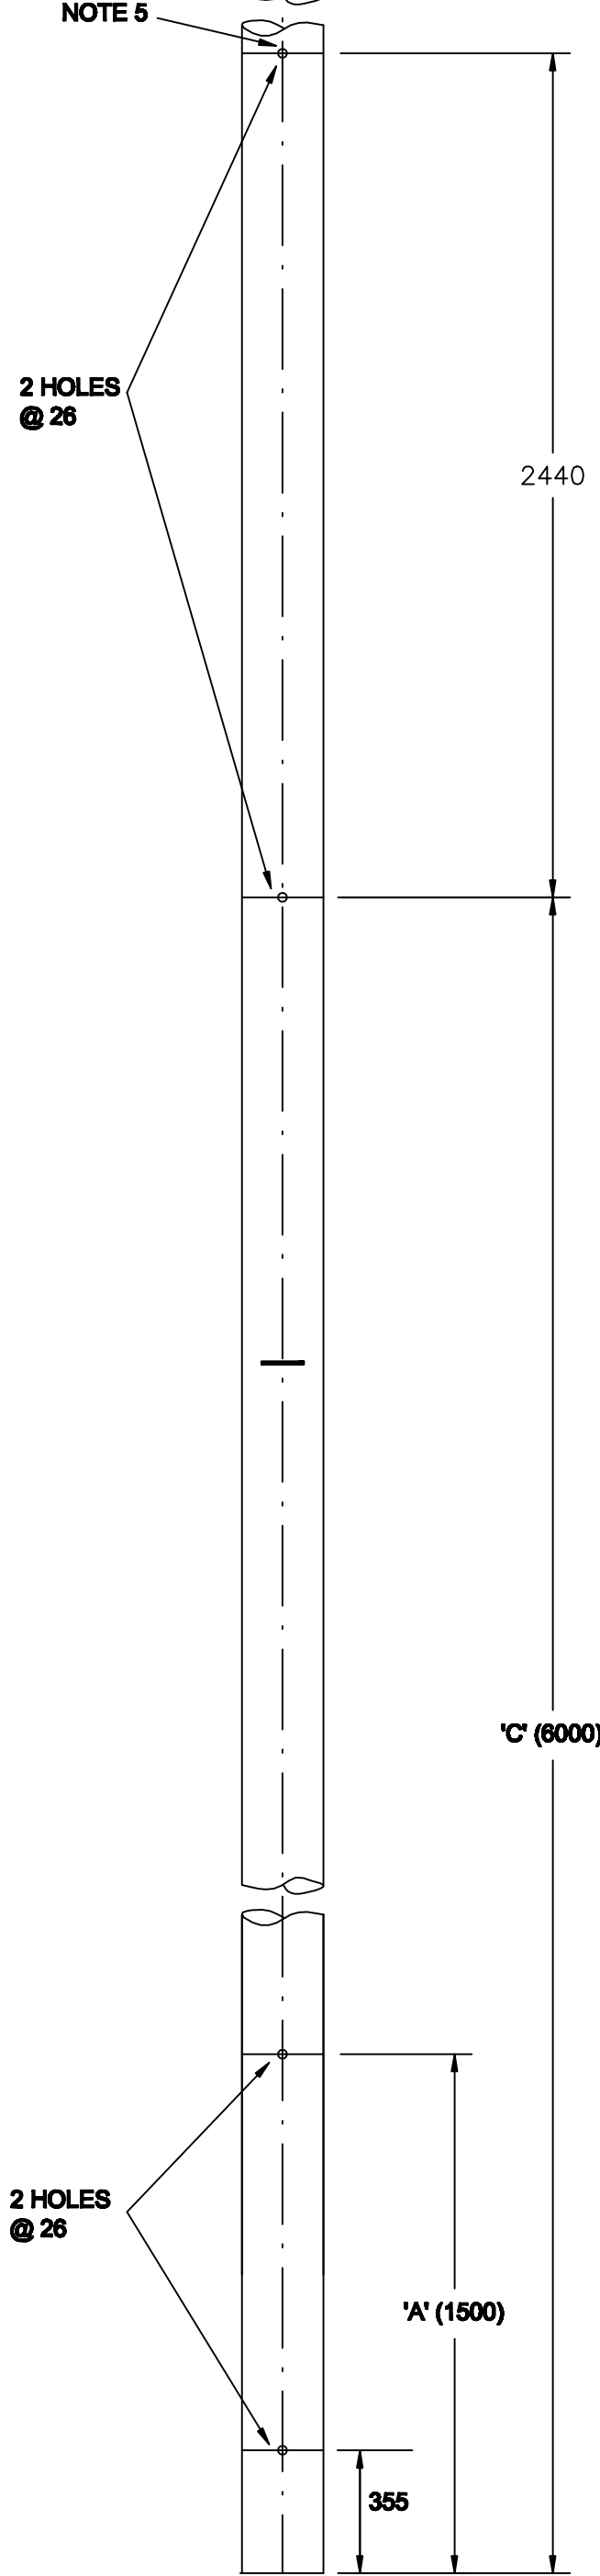
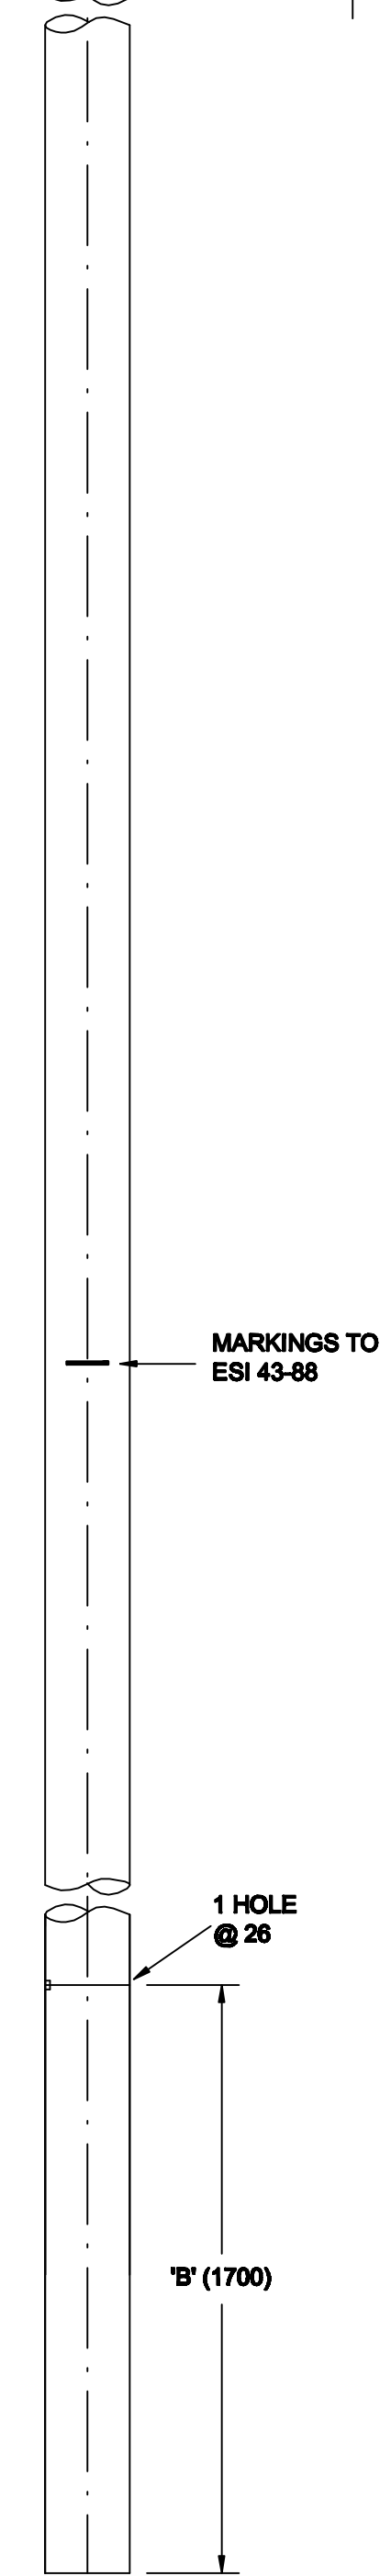
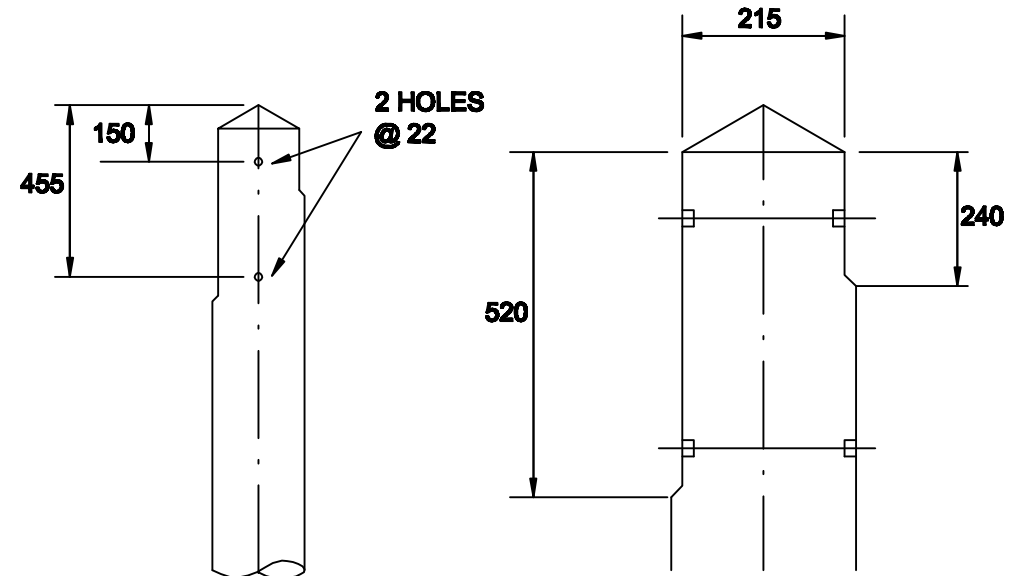
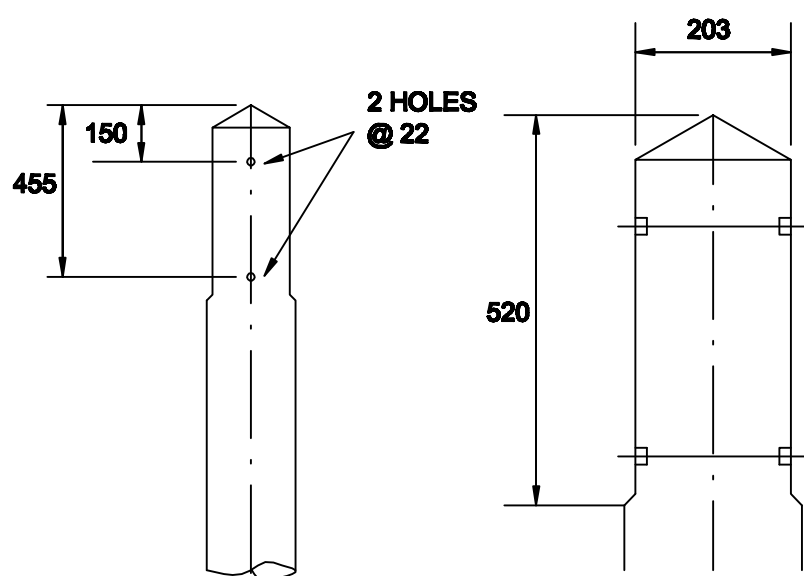


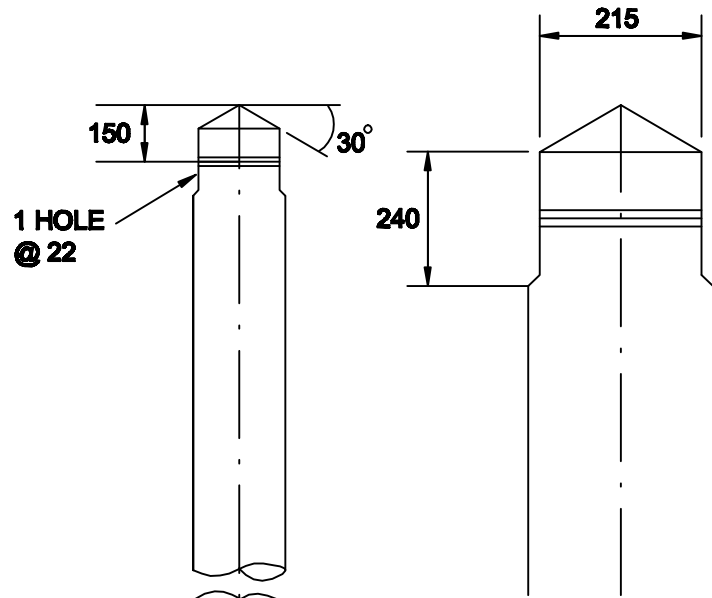

'H' IN LINE
SUPPORT
(TYPE 1)

'H' ANGLE
SUPPORT
(TYPE 2)

SLACK SPAN 'H'
TERMINAL SUPPORT
(TYPE 3)

NOTES:

1. POLES TO BE 'STOUT CLASS' TO BS 1990. CREOSOTED TO BS913 BY RUEPING PROCESS, AFTER FABRICATION.
2. POLES TO BE MATCHED FOR H STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. MINIMUM POLE TOP DIAMETER 205mm FOR INTERMEDIATES, 215mm FOR SECTION POLES. SCARFING ONLY REQUIRED WHERE POLE TOP DIAMETER EXCEEDS THESE DIMENSIONS.
4. ALL HOLES DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE.
5. 1 ADDITIONAL HOLE AT 2440 INTERVAL FOR POLES OVER 14m.
6. ANGLE AND TERMINAL POLES TO HAVE A POLE TOP DIAMETER NOT LESS THAN 20mm ABOVE THE MINIMUM SPECIFIED IN BS 1990 TABLE 3.

DIMENSIONS IN MILLIMETRES

POLE LENGTH (m)	DIM 'A' (m)	DIM 'B' (m)	DIM 'C' (m)
UP TO 11.5	1.2	1.4	6.0
12.0 TO 13.0	1.4	1.5	6.0
14.0	1.5	1.7	6.0
15.0	1.5	1.7	6.0
16.0 & 17.0	1.7	1.8	7.0
16.0	1.8	2.0	8.0
20.0	1.8	2.0	10.0
22.0	1.8	2.0	12.0

FORMERLY YE DRAWING No. Y204L0601

NEDL YEDL		Lloyds Court, 78, Grey Street, Newcastle Upon Tyne, NE1 6AF	
Prepared by BFR		POLE FABRICATION INTERMEDIATE, ANGLE AND SLACK SPAN TERMINAL CE/C/37M	
Checked GH	Date Issued JAN'05	Drg.No. 1 09 138 0011	Sheet No. 1
Mod.		Revised	
		Scale 1:20&1:10@A2	