


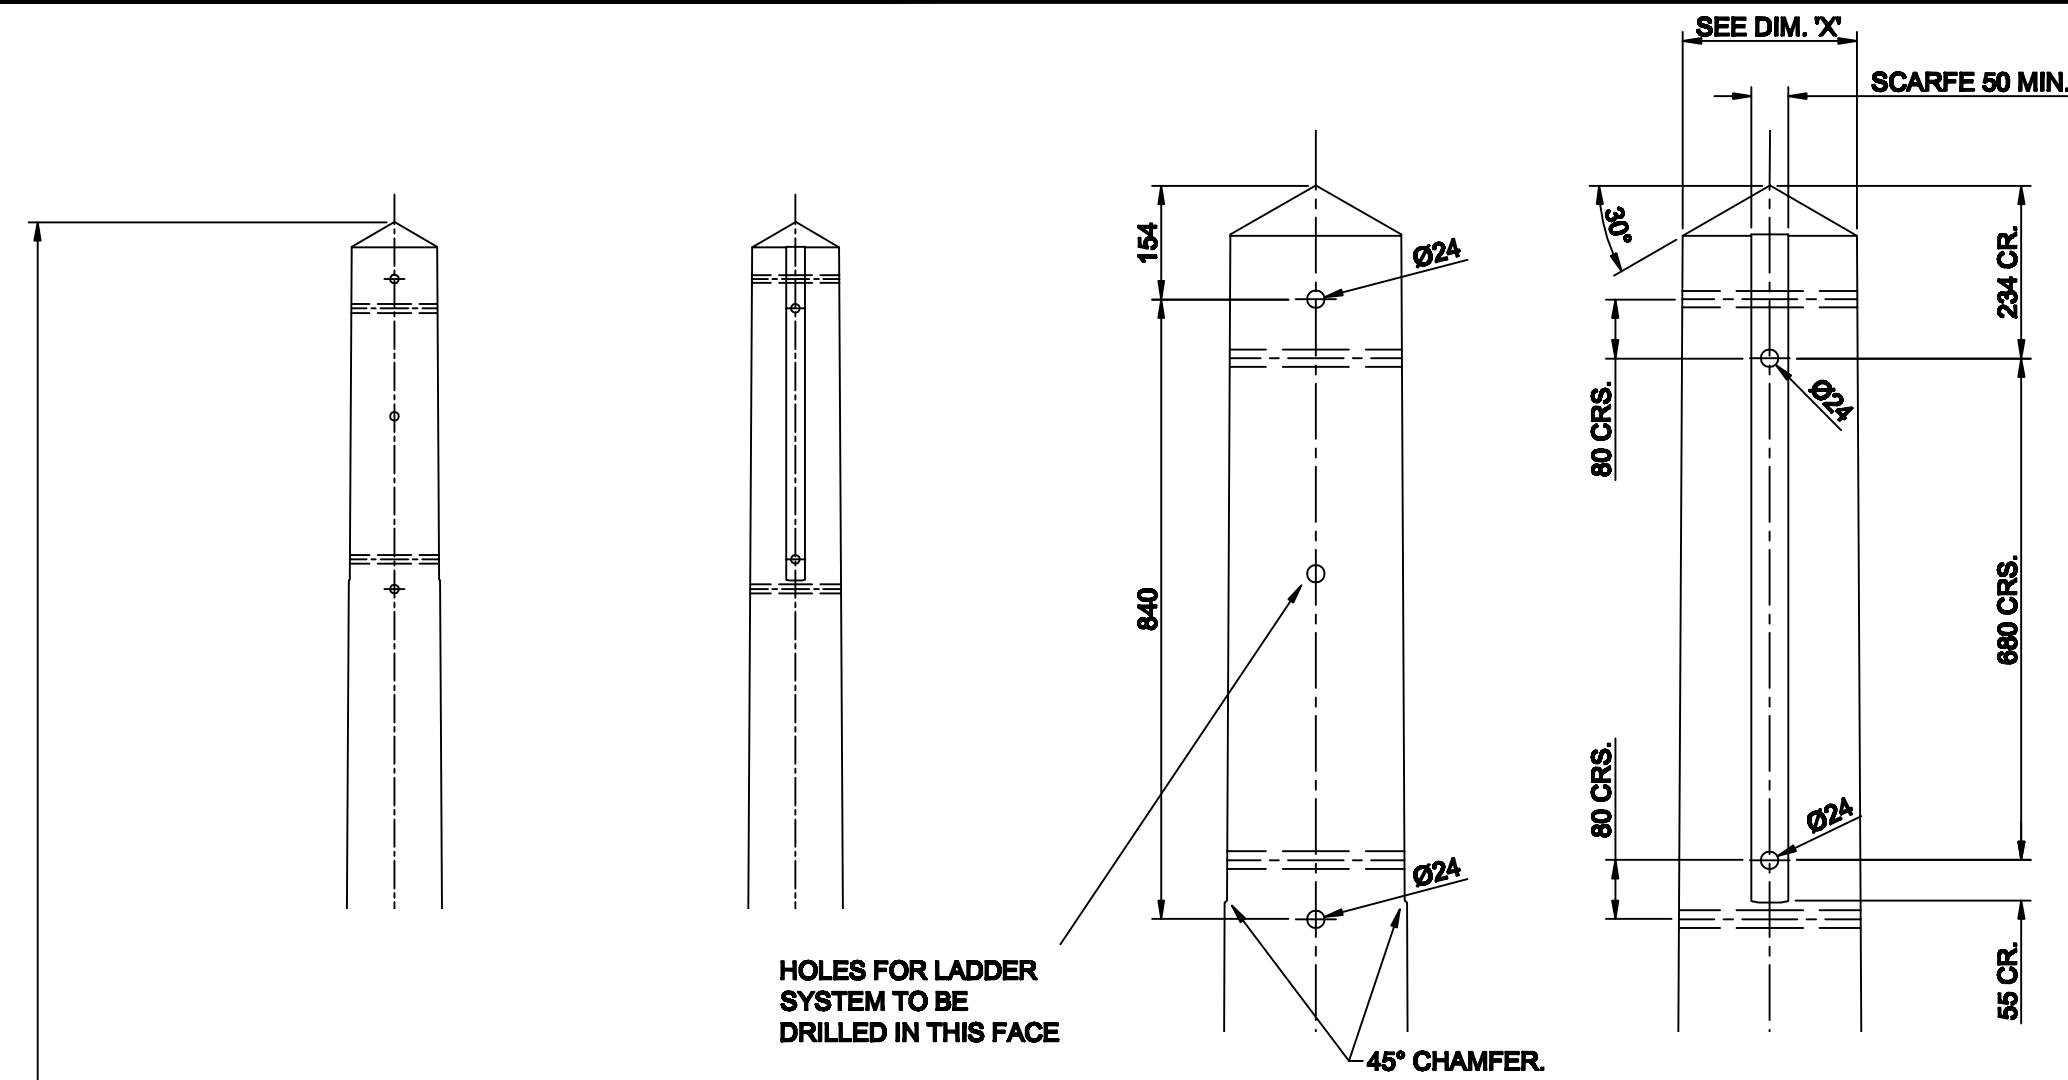

HOLES FOR LADDER
SYSTEM TO BE
DRILLED IN THIS FACE

45° CHAMFER.

ENLARGED VIEWS OF POLE APEX SCALE 1:10

IMPORTANT NOTE


THE SCARFE IS PARALLEL TO THE POLE EDGE
& NOT THE POLE CENTRELINE.

SCARFING TO BE CUT TO GIVE A
50mm WIDE FLAT ON TWO DIAMETRICALLY
OPPOSITE FACES WITH ENDS CHAMFERED
AS SHOWN.

NOTES

1. CLASS OF POLE TO BE EXTRA STOUT
IN ACCORDANCE WITH 1.09.101.0238
2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS
OF POLE.
3. ALL HOLES EXCEPT WHERE STATED OTHERWISE
TO BE 24mm DIA. DRILLED AT RIGHT ANGLES
TO VERTICAL CENTRELINE OF POLE. ALL DRILLING
& CUTTING TO BE DONE STRICTLY TO TEMPLATE
PRIOR TO CREOSOTING.
4. BS 1990 TABULATED MIN VALUES HAVE BEEN
AMENDED TO REFLECT CALCULATED MEAN VALUES
5. POLE DIAMETER INCREASED TO MATCH MAXIMUM
SPAN CAPABILITIES OF RUTTER POLES.

**DO NOT DRILL FOR
LADDER SYSTEM**

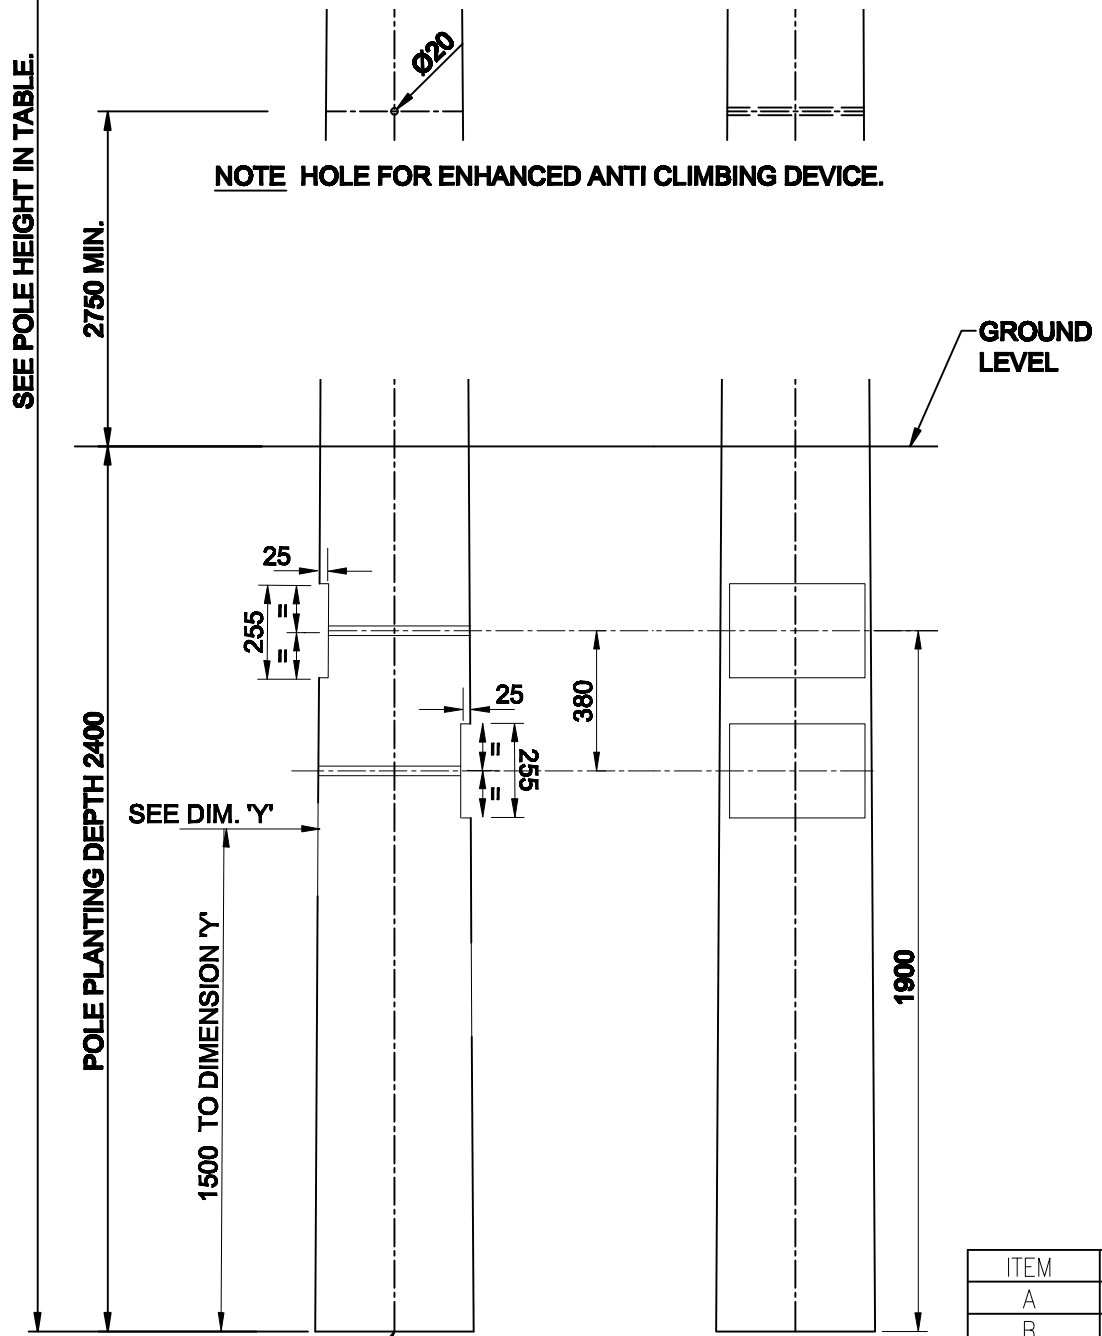

NOTE HOLE FOR ENHANCED ANTI CLIMBING DEVICE.

GROUND
LEVEL

POLE PLANTING DEPTH 2400

1500 TO DIMENSION 'Y'

SCALE:- 1:20

POLE LENGTH/ CLASS TO BE
IMPRESSED ON POLE BUTT.

THIS VIEW SHOWS
THE POLE FACE
(NATURAL LIE OF POLE).

ITEM	POLE HEIGHT	DIMENSION 'X' (MIN.)	DIMENSION 'Y'(MIN.)
A	12000mm	245	335
B	13000mm	245	350
C	14000mm	245	365
D	15000mm	245	375
E	16000mm	250	390
F	17000mm	250	415

NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		132KV OVERHEAD LINES DRILLING, SCARFING AND MARKINGS FOR SINGLE ANGLE POLE ARRANGEMENT	
Sheet No. 2	Scale AS SHOWN	Type OVERHEAD	DOCUMENT_SUB_CLASS
Prepared By Barbara.Gordon	Grid Reference	Ref No. C949737	Historic Drg.No. 1091390003
Revised 30/03/17	Checked By G HAMMEL	Revision G	Notes
Date Issued 02/07/07			