


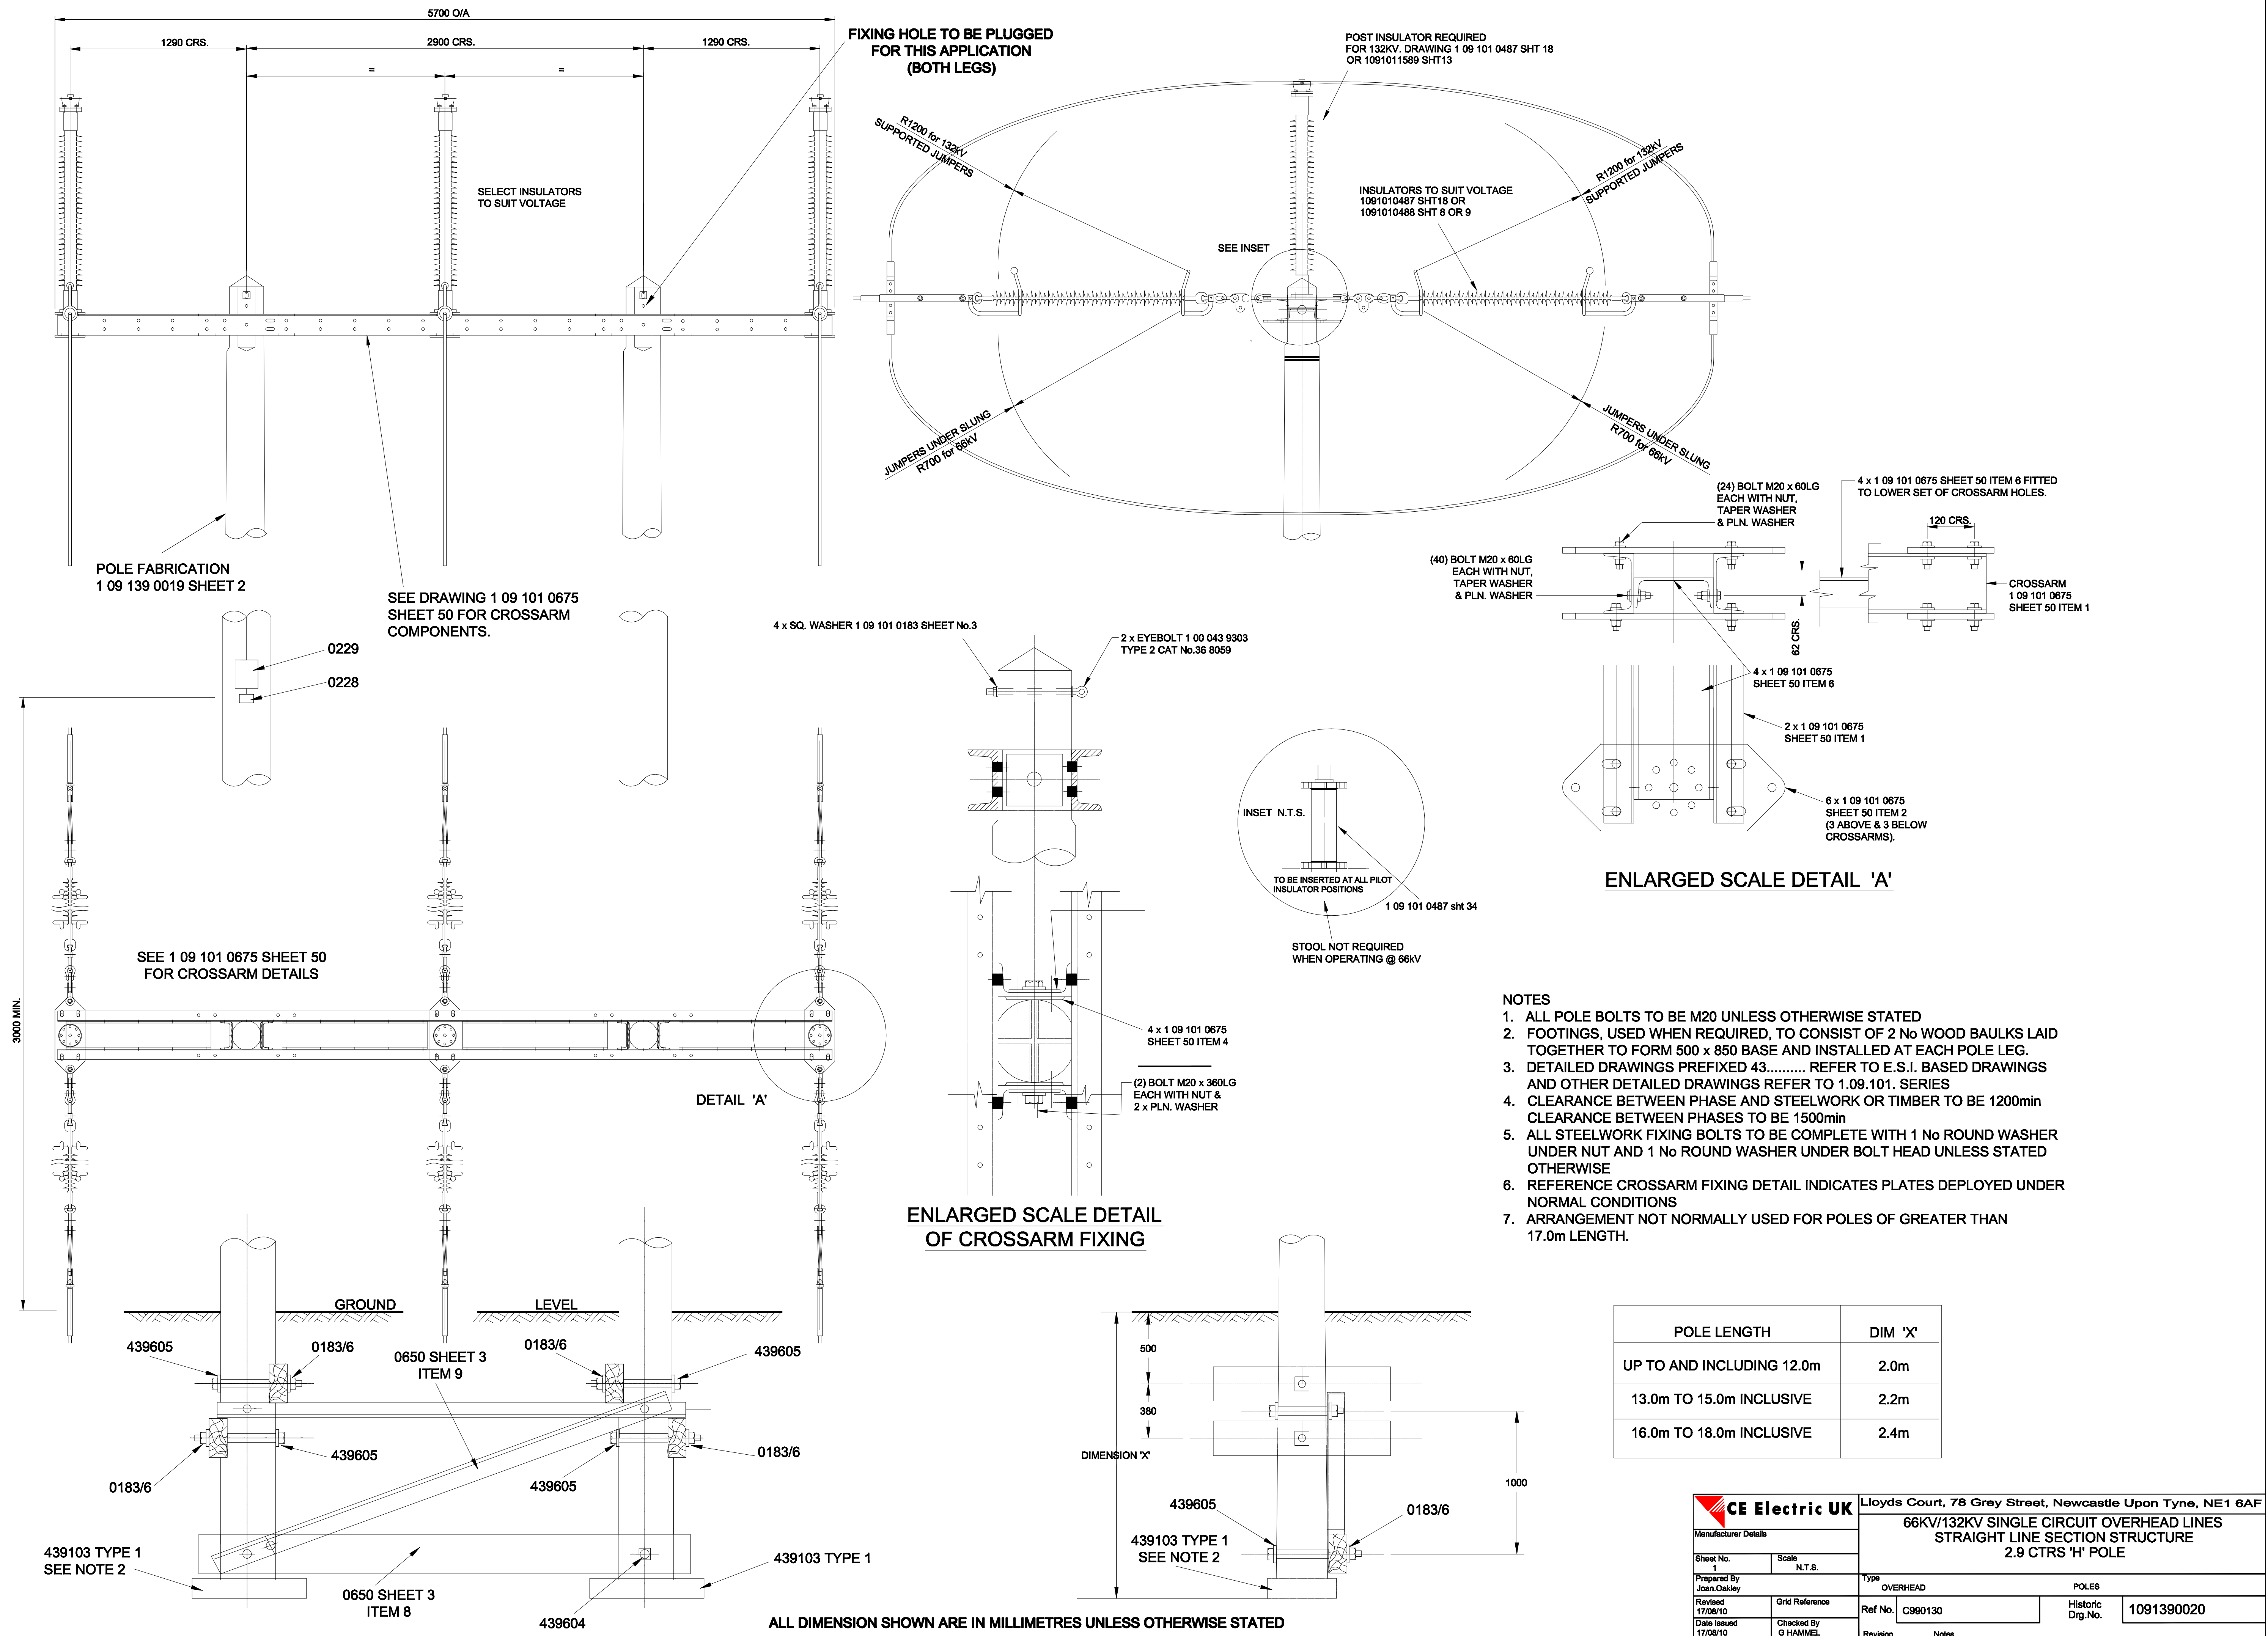

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
  2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 No WOOD BALKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
  3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
  4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200min CLEARANCE BETWEEN PHASES TO BE 1500min
  5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
  6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
  7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

| POLE LENGTH               | DIM 'X' |
|---------------------------|---------|
| UP TO AND INCLUDING 12.0m | 2.0m    |
| 13.0m TO 15.0m INCLUSIVE  | 2.2m    |
| 16.0m TO 18.0m INCLUSIVE  | 2.4m    |

|                         |                     |                                                                                                  |                             |
|-------------------------|---------------------|--------------------------------------------------------------------------------------------------|-----------------------------|
| <b>CE Electric UK</b>   |                     | Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF                                       |                             |
| Manufacturer Details    |                     | 66KV/132KV SINGLE CIRCUIT OVERHEAD LINES<br>STRAIGHT LINE SECTION STRUCTURE<br>2.9 CTRS 'H' POLE |                             |
| Sheet No. 1             | Scale N.T.S.        | Type OVERHEAD                                                                                    | POLES                       |
| Prepared By Joan Oakley | Grid Reference      | Ref No. C990130                                                                                  | Historic Drg.No. 1091390020 |
| Revised 17/08/10        | Checked By G HAMMEL | Revision                                                                                         | Notes                       |
| Date Issued 17/08/10    |                     |                                                                                                  |                             |