


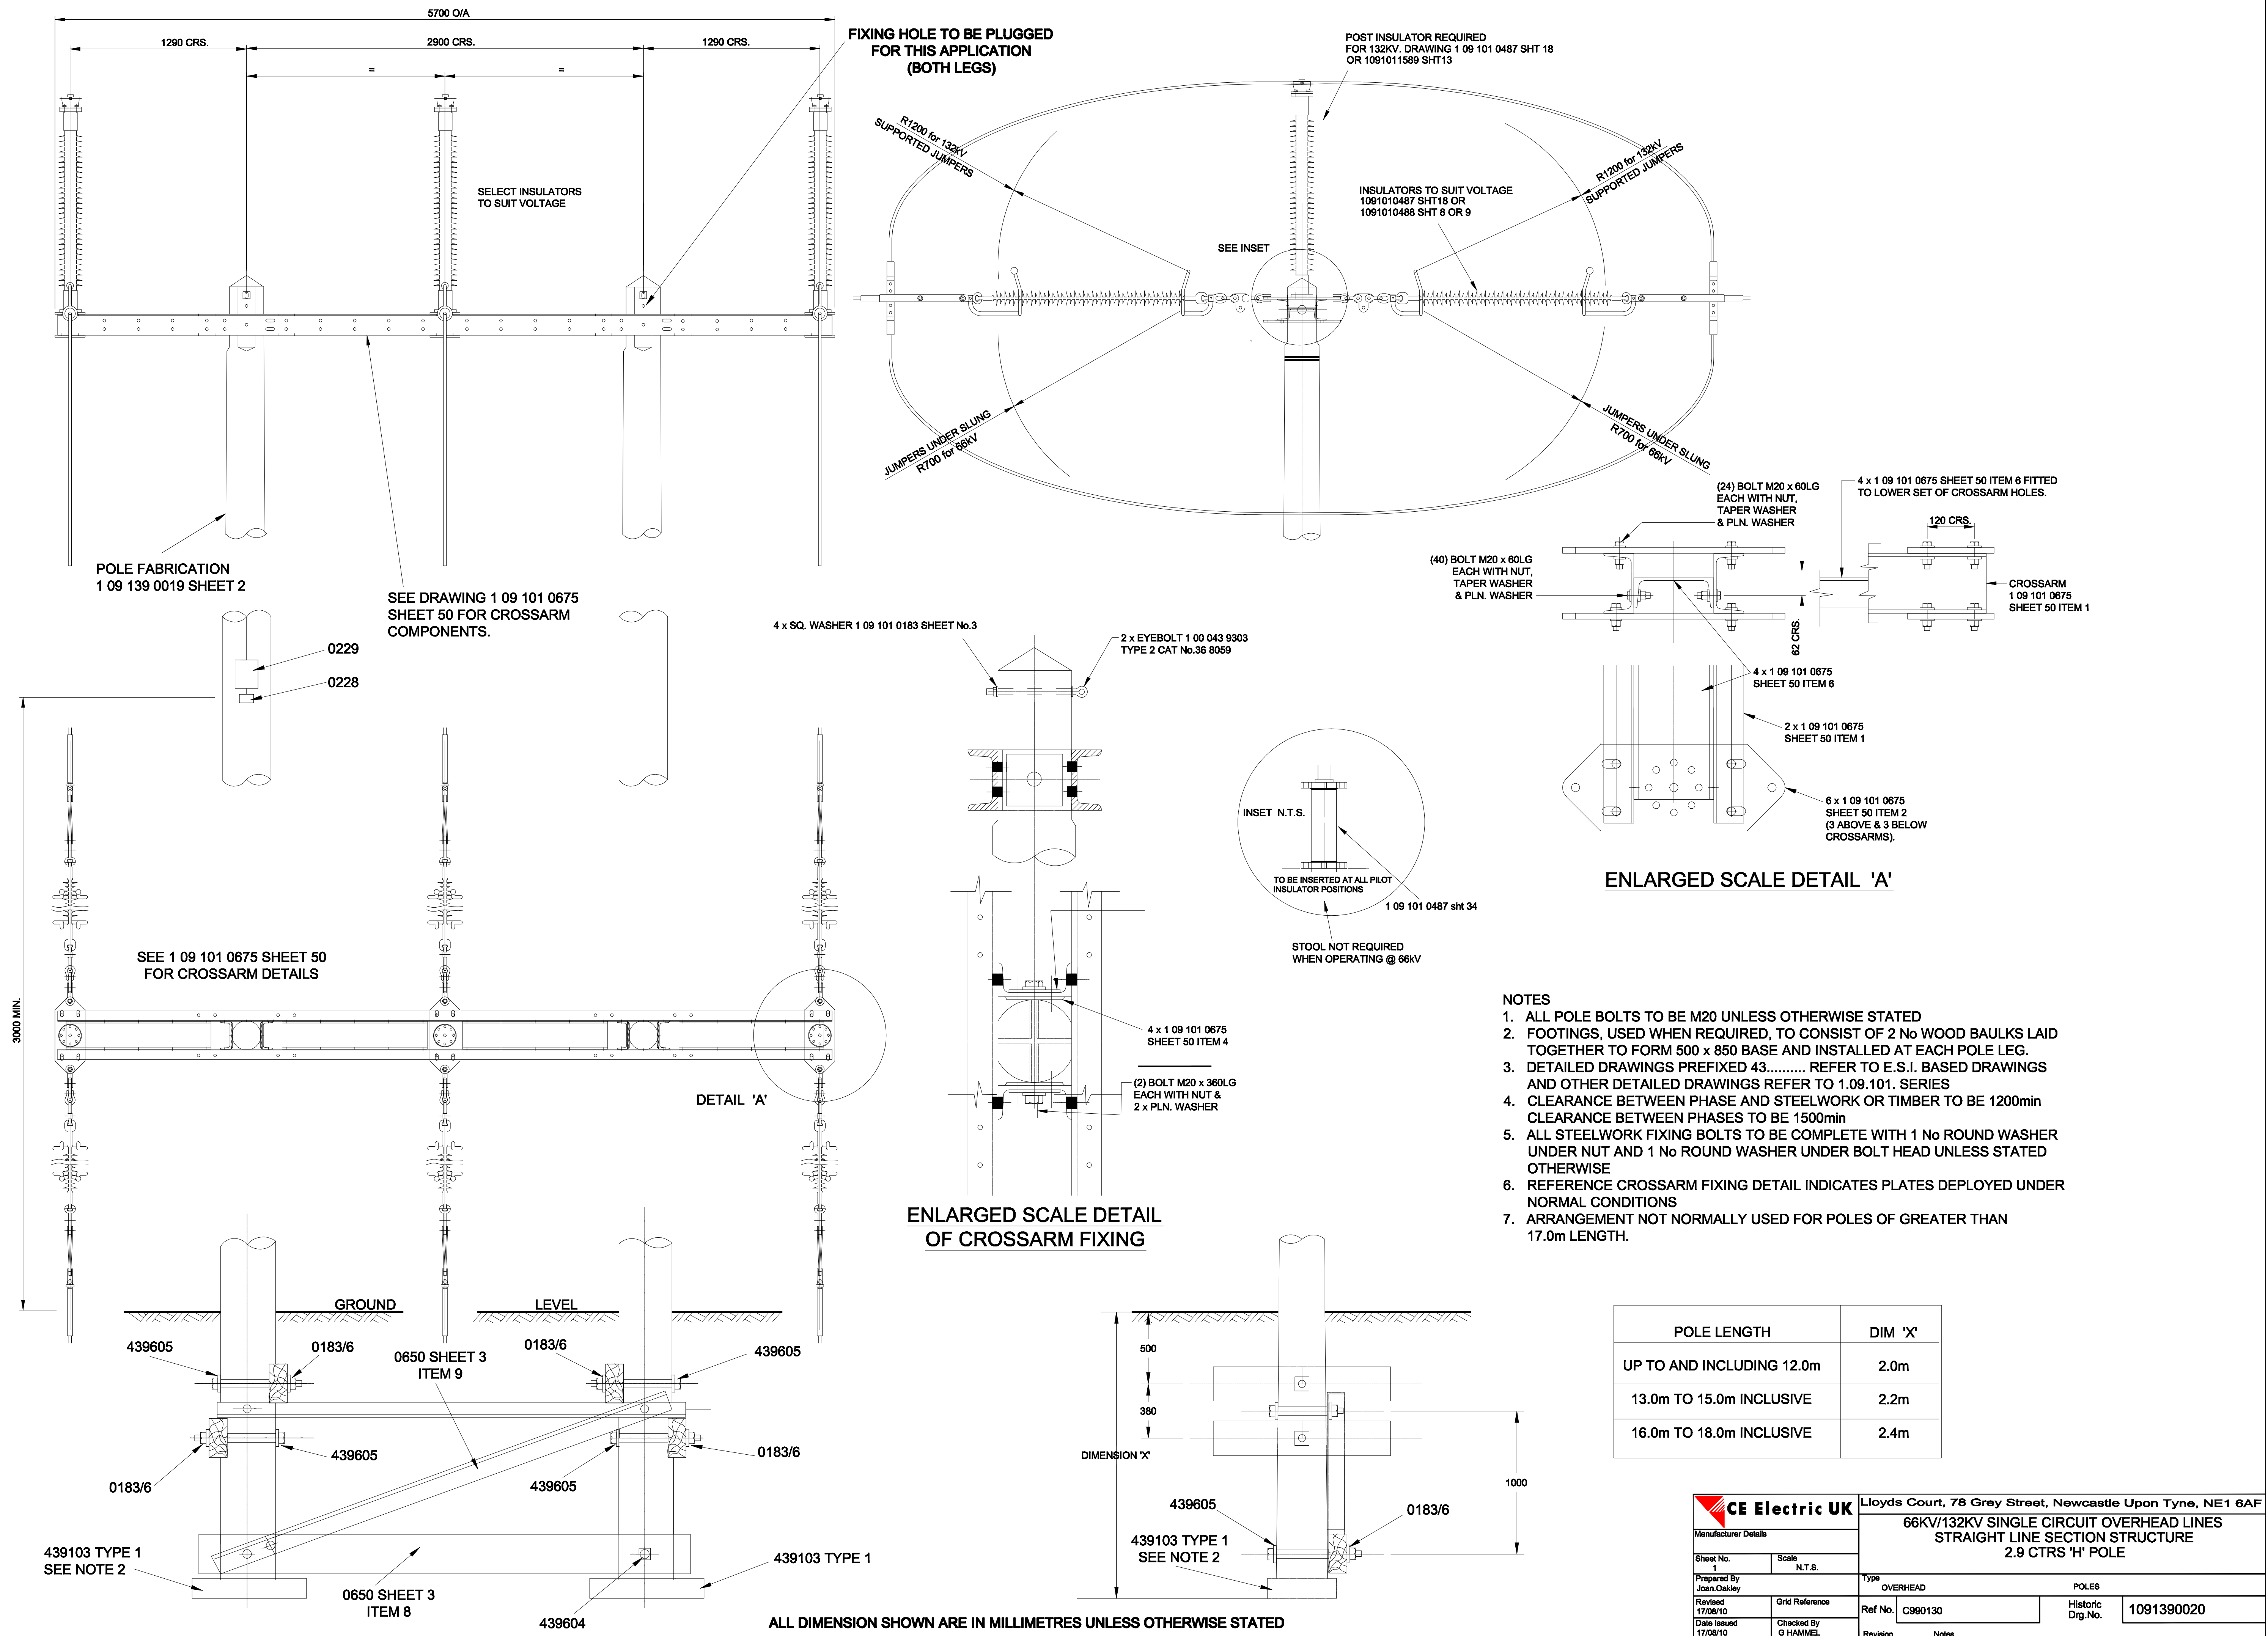

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 No WOOD BAULKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
 3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
 4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200min
CLEARANCE BETWEEN PHASES TO BE 1500min
 5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
 6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV/132KV SINGLE CIRCUIT OVERHEAD LINES STRAIGHT LINE SECTION STRUCTURE 2.9 CTRS 'H' POLE	
Sheet No. 1	Scale N.T.S.	Type OVERHEAD	POLES
Prepared By Joan Oakley	Grid Reference	Ref No. C990130	Historic Drg.No. 1091390020
Revised 17/08/10	Checked By G HAMMEL	Revision	Notes
Date issued 17/08/10			