


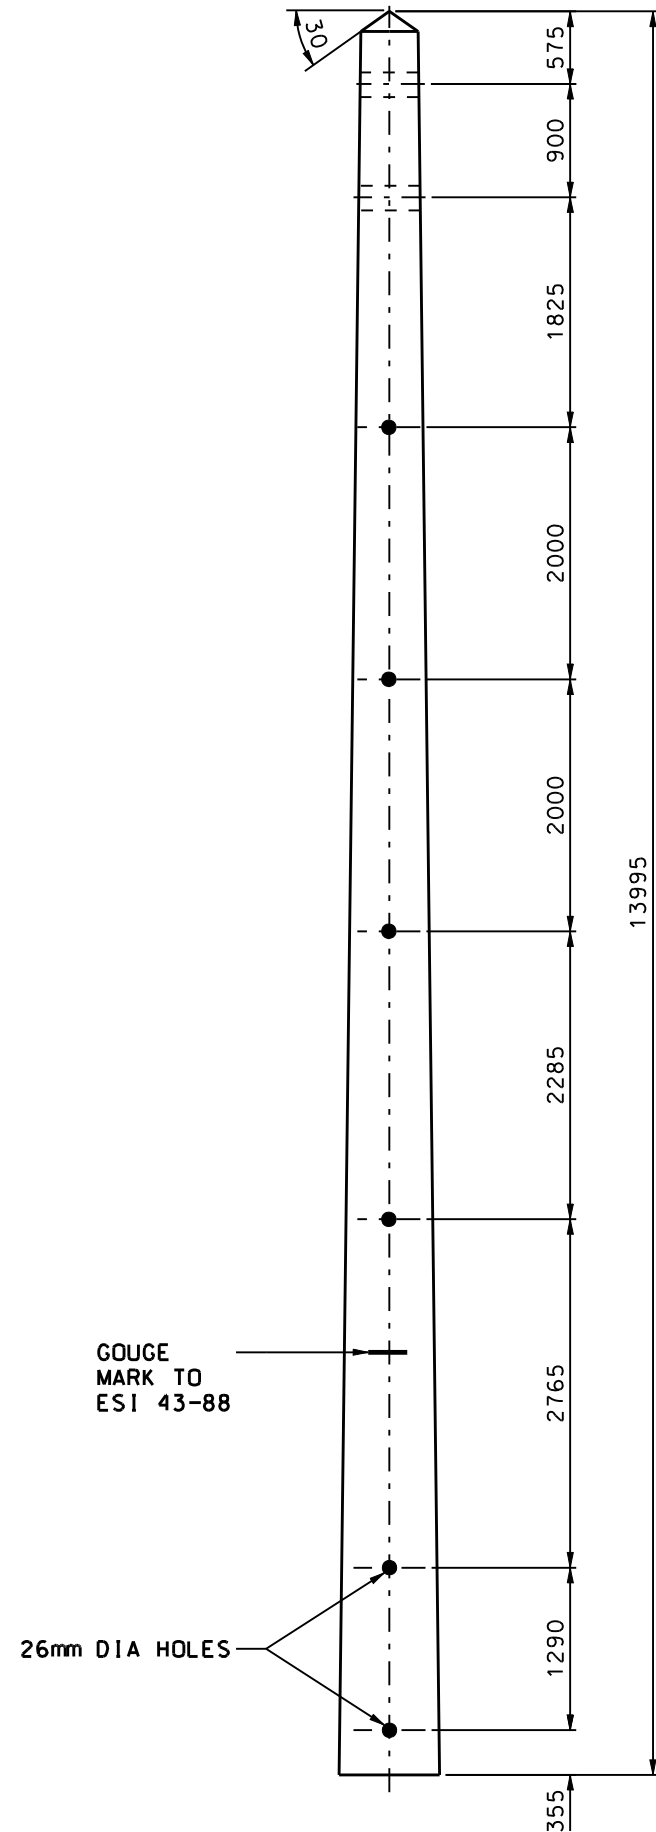

NOTES

1. POLES TO BE 'STOUT CLASS'.
2. POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. ALL HOLES 22mm DIA (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PROIR TO PRESERVATION TREATMENT.

THIS DRAWING WAS PRODUCED USING MICROSTATION
AND SHOULD ON NO ACCOUNT BE AMENDED BY HAND

REV	DATE	BY	CHKD	APPD

DESCRIPTION

THIS DRAWING IS THE PROPERTY OF INTERSERVE INDUSTRIAL SERVICES LTD (THE COMPANY) AND MUST NOT BE COPIED OR REPRODUCED WITHOUT THE COMPANY'S WRITTEN CONSENT. THE DRAWING IS TO BE USED ONLY FOR THE PURPOSE FOR WHICH IT IS SUPPLIED AND MUST BE TREATED AS STRICTLY CONFIDENTIAL AND MUST NOT BE DISCLOSED TO ANY THIRD PARTY WITHOUT THE COMPANY'S WRITTEN CONSENT.

CLIENT

NORTHERN POWER GRID

PROJECT

MIDDLEMOOR WINDFARM

TITLE

POLE DRILLING DETAILS
ISOLATION POLE

SCALE	NTS	ORIGINAL SIZE	A3
DATE	19/09/12	CHECKED	MS
DRAWN	SS	APPROVED	SS



DRAWING NUMBER	REV
10412-MWF-006	00