
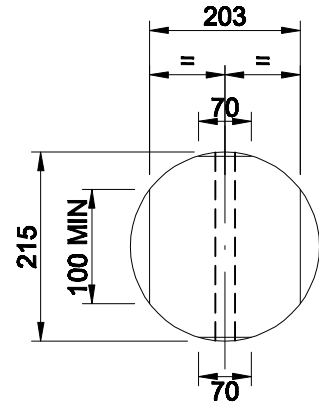
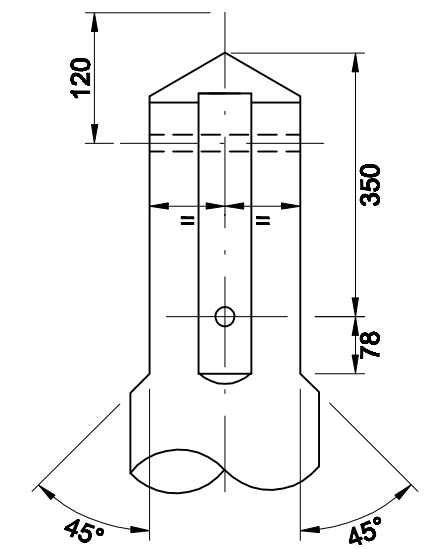


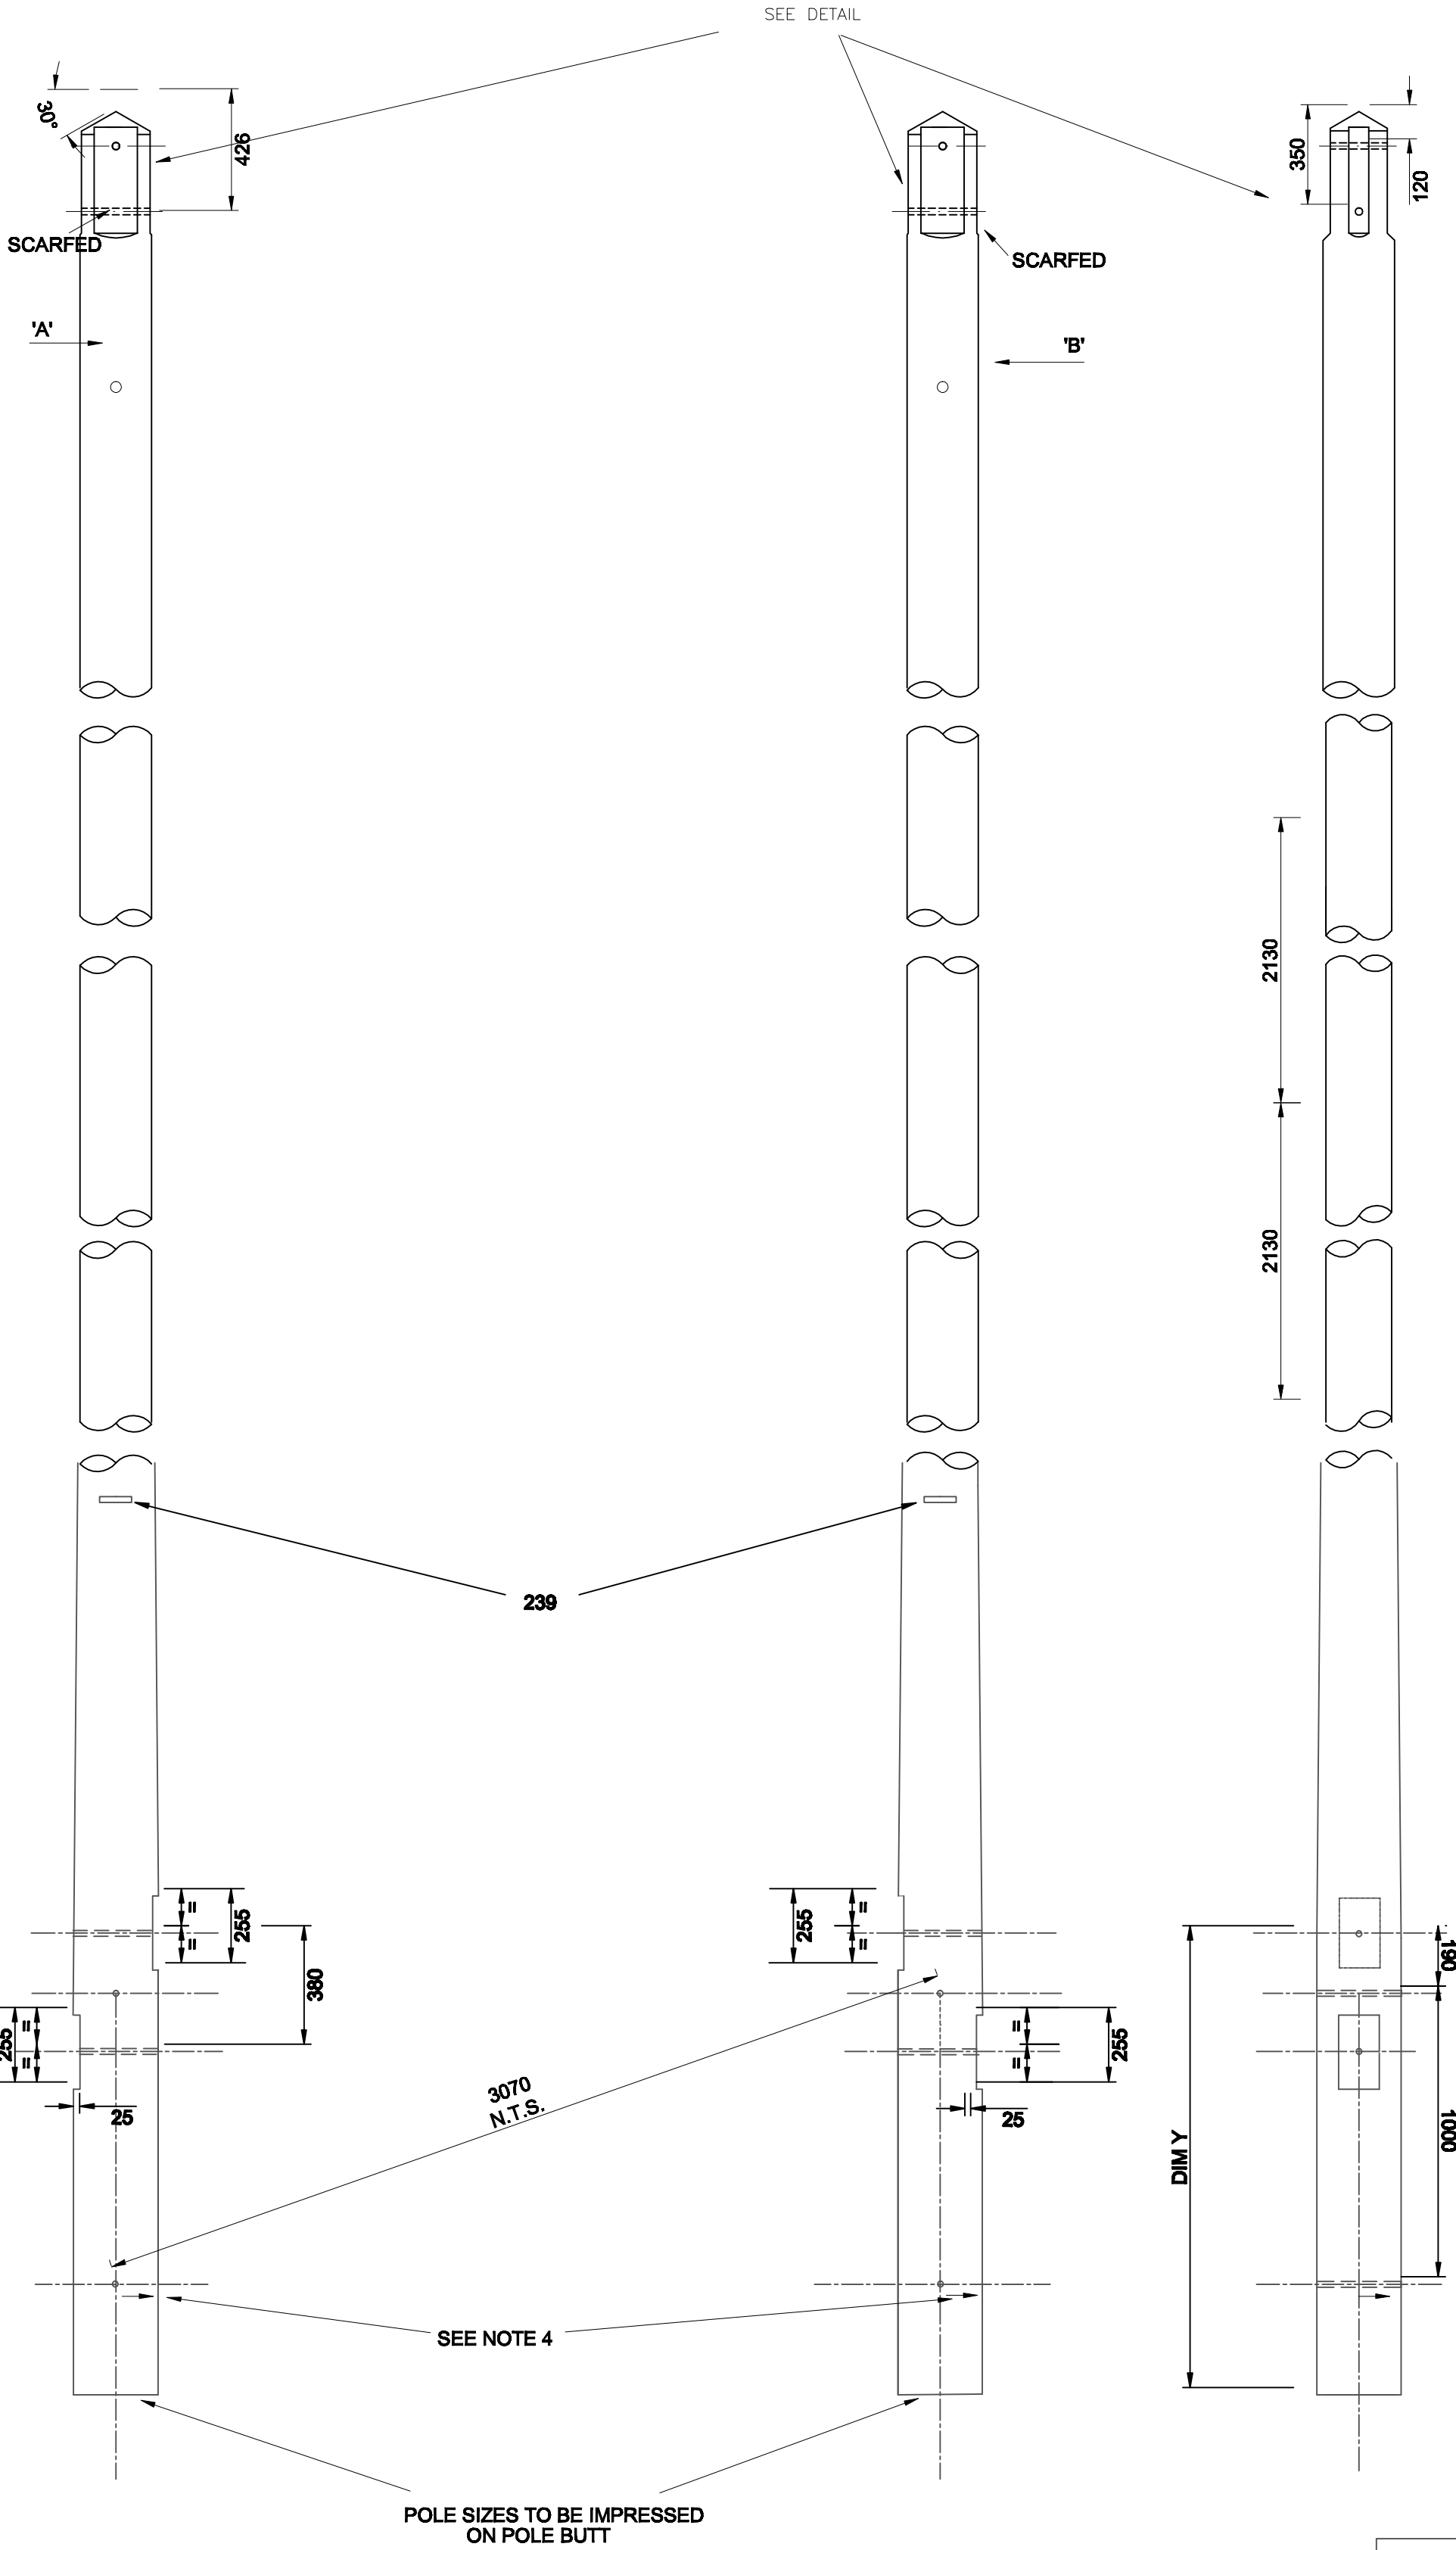

NOTES

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT - 226mm.
2. HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE-LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
3. POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.

All dimensions shown are in millimetres unless stated otherwise

POLE LENGTH	DIM Y
UP TO AND INCLUDING 12.0m	1500
13.0m TO 15.0m INCLUSIVE	1700
16.0m AND 17.0m	1900
18.0m	1900
20.0m	2500
22.0m	2500
24.0m	2500

NORTHERN POWERGRID Manufacturer Details		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Sheet No. 2 Prepared By Joan.Oakley		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING & MARKING FOR LARGE ANGLE 'H' POLE STRUCTURE	
Revised 13/12/13 Date Issued 19/06/13		Type OVERHEAD	STANDARDS
Grid Reference		Ref No. C1023988	Historic Drg.No. 1091390018
Checked By G HAMMEL		Revision A	Notes