
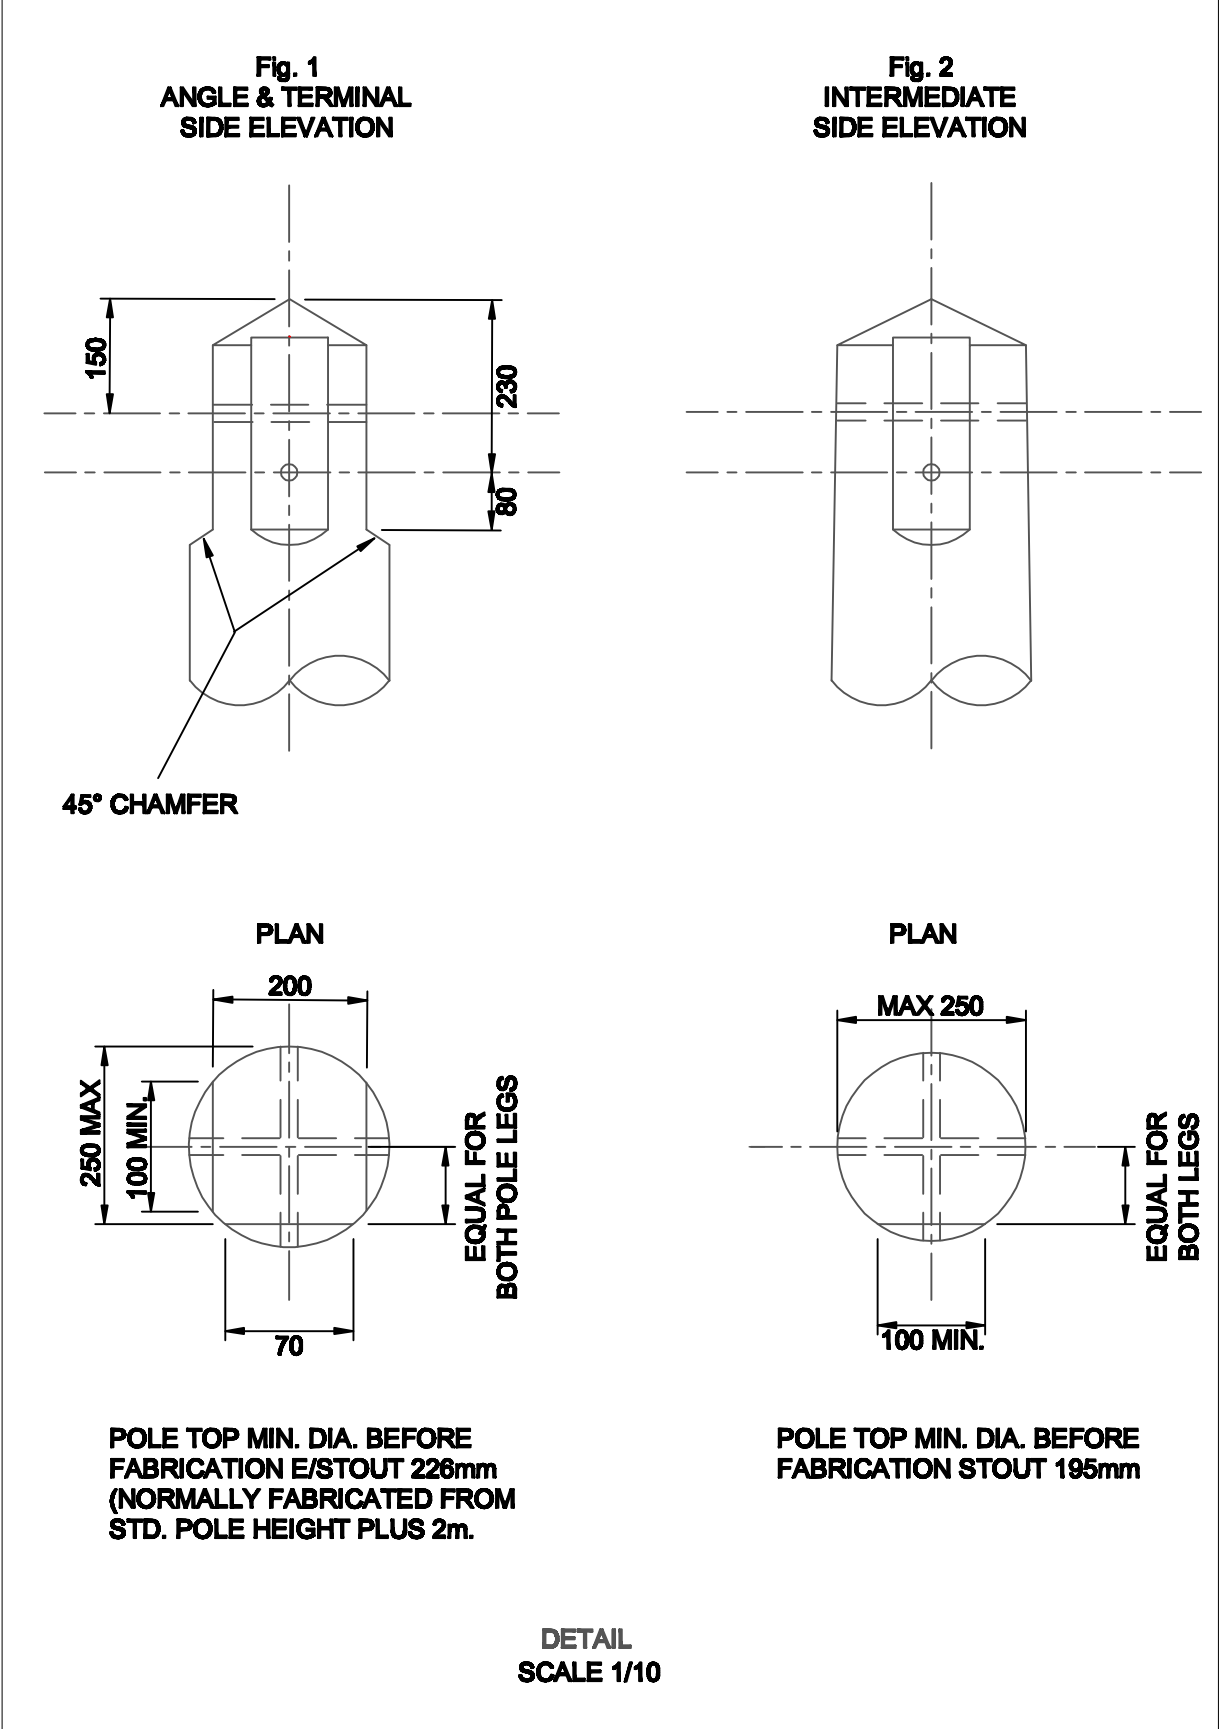


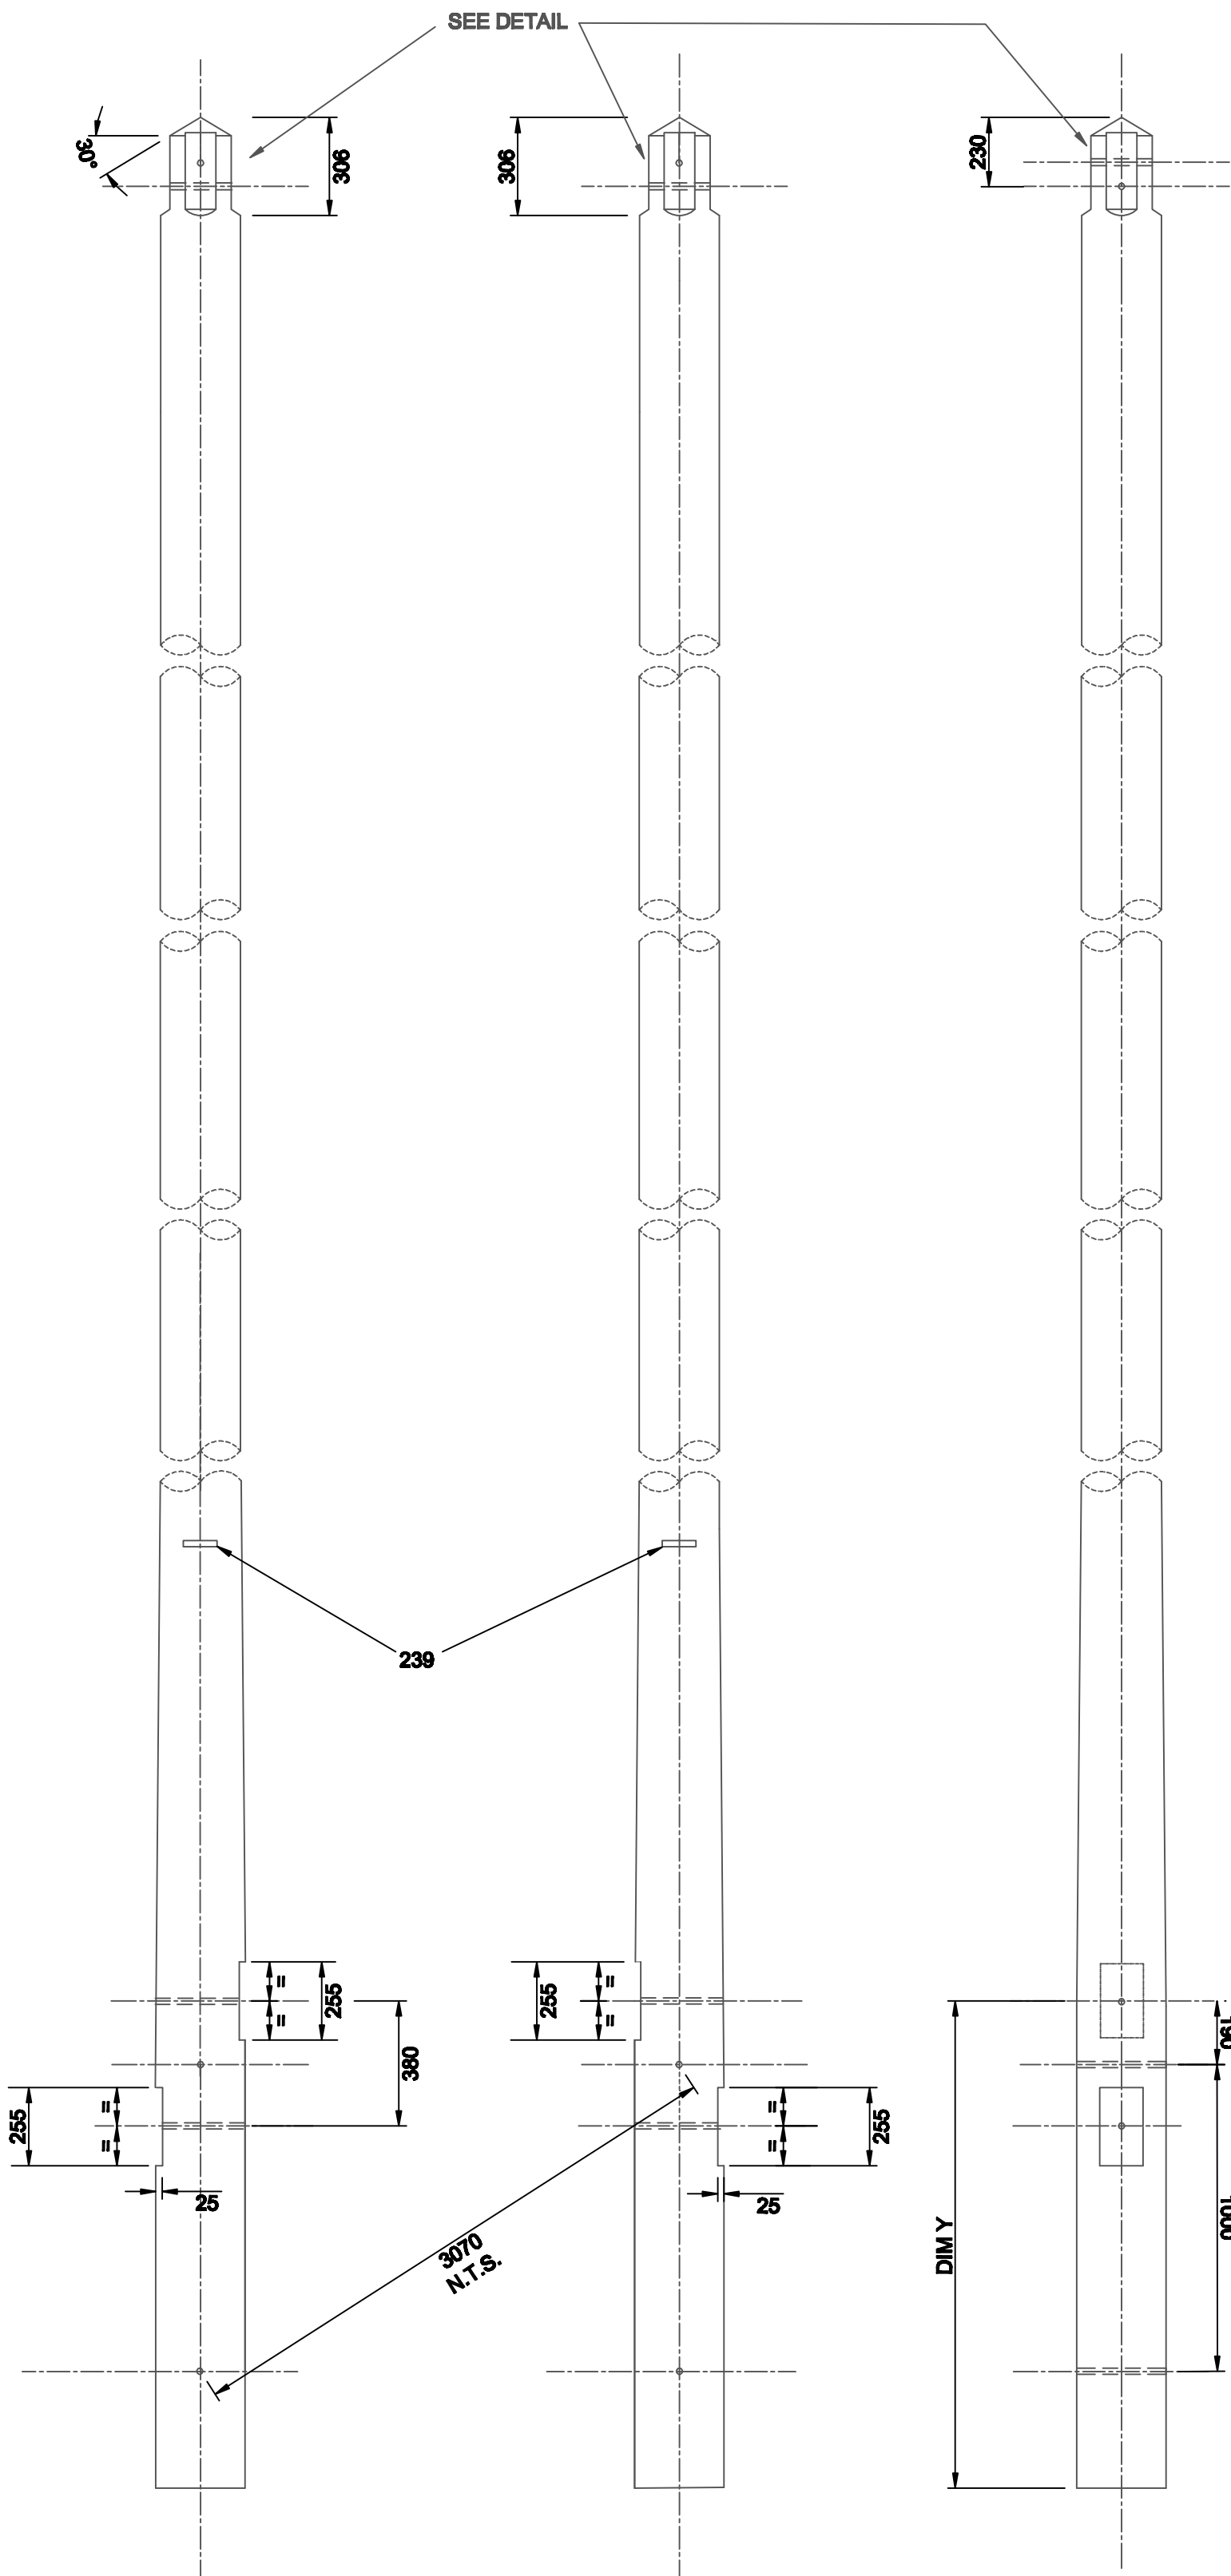

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION TO SUIT POLE FIGS.
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM Y
UP TO AND INCLUDING 12.0m	1500
13.0m TO 15.0m INCLUSIVE	1700
16.0m AND 17.0m	1900
18.0m	1900
20.0m	2500
22.0m	2500
24.0m	2500

NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR STANDARD PORTAL TYPE POLE TO SPECIFICATION OHL 4/84	
Sheet No. 1	Scale 1:20	Type OVERHEAD POLES	
Prepared By Joan.Oakley	Grid Reference	Ref No. C995423	Historic Drg.No. 1091231187
Revised 13/12/13	Checked By S SALKELD	Revision N	Notes
Date Issued 16/02/11			