

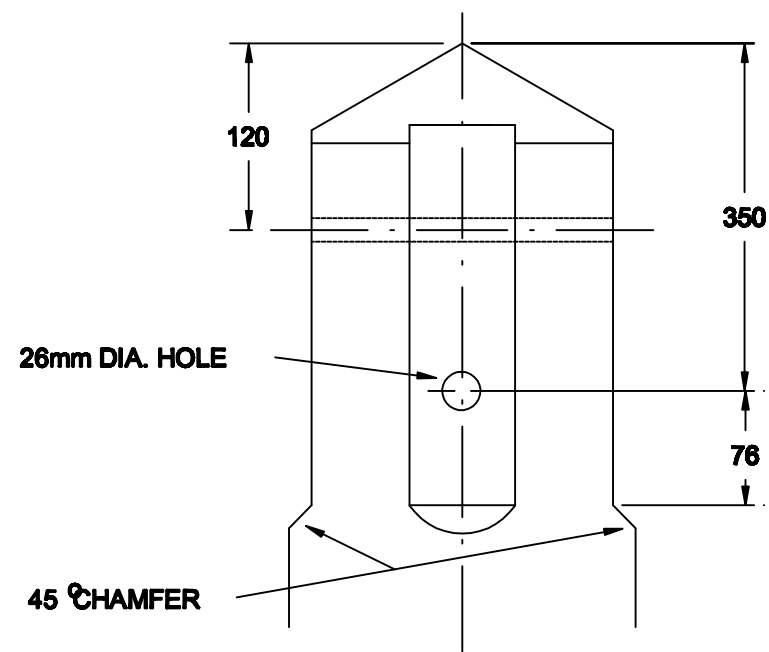


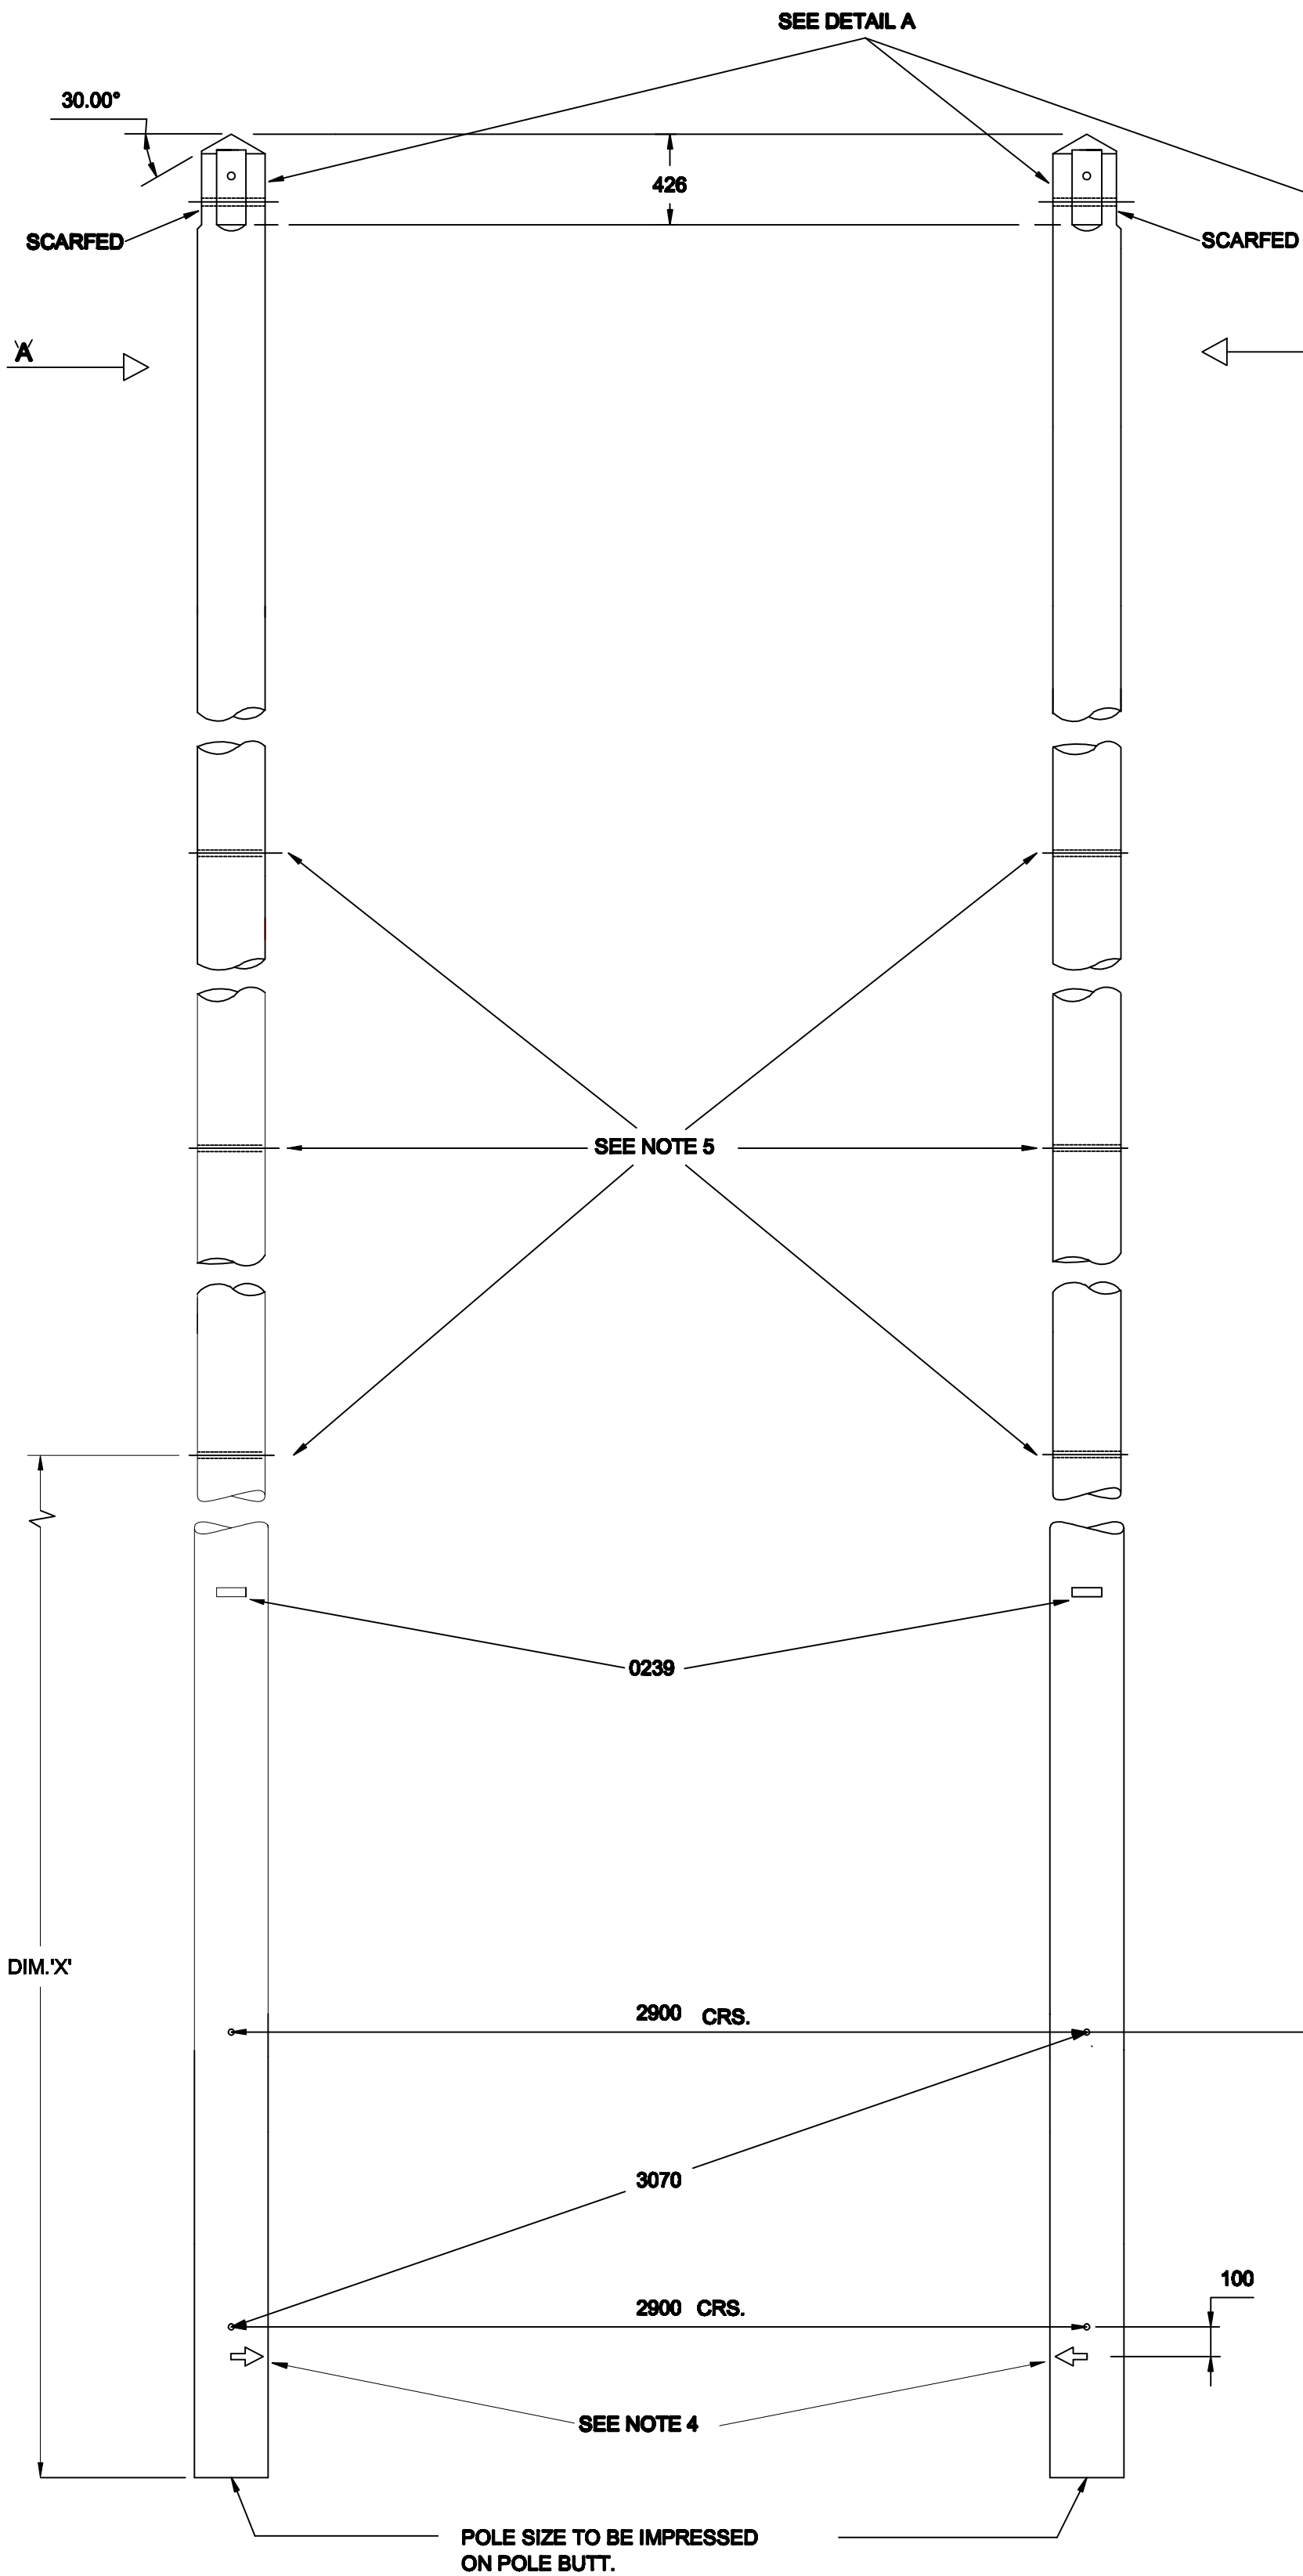

SIDE ELEVATION ON VIEW 'A' & 'B'
SCALE 1:5

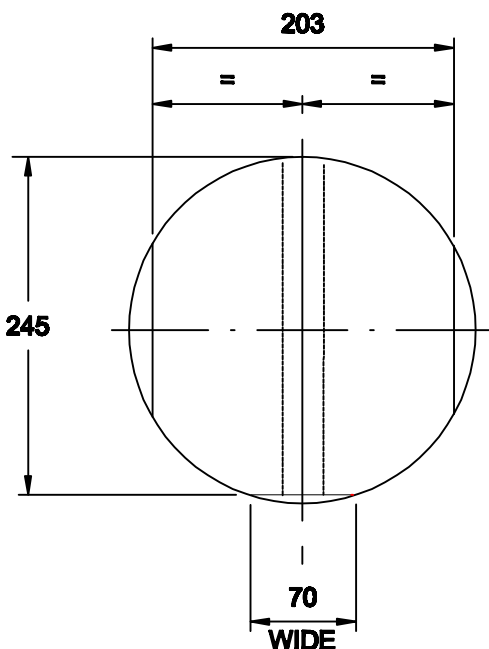

PLAN
DETAIL 'A'

NOTES

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION 'STOUT' - 250mm.
- HOLES TO BE 22mm DIA. EXCEPT AS SHOWN IN DETAIL 'A' (26mm) DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE-LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
- POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
- 50x8x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
- 'H' POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG.No. 1.09.101.129.

All dimensions shown are in millimetres unless stated otherwise

POLE LENGTH	DIM 'X'	DIM 'Y'
UP TO AND INCLUDING 12.0m	—	1500
13.0m-15.0m INCLUSIVE	—	1700
16.0m AND 17.0m	—	1900
18.0m	7955	1900
20.0m	9255	2500
22.0m	10255	2500
24.0m	11255	2500

NORTHERN POWERGRID Manufacturer Details		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR SECTION/ ANGLE 'H' POLE	
		Type	OVERHEAD POLES
Sheet No. 2	Scale 1:20	Ref No.	C1040652
Prepared By Barbara Gordon	Grid Reference	Historic Drg.No.	1091380003
Revised 01/10/14	Checked By G HAMMEL	Revision	C Notes
Date Issued 01/10/14			