
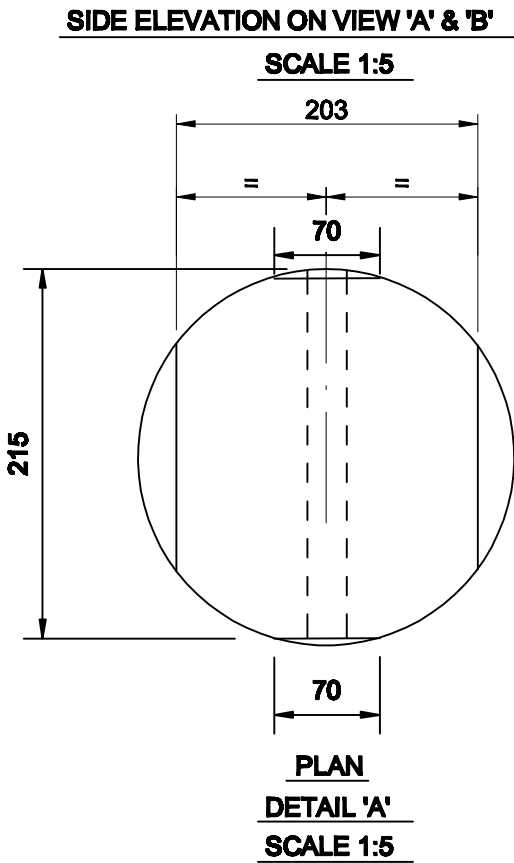
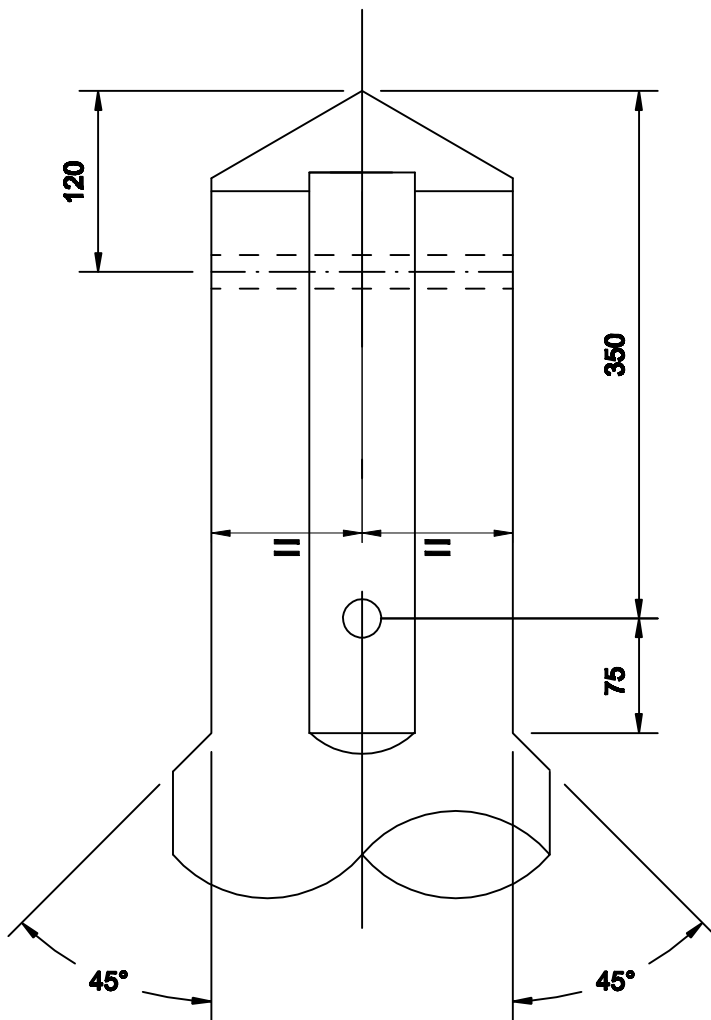


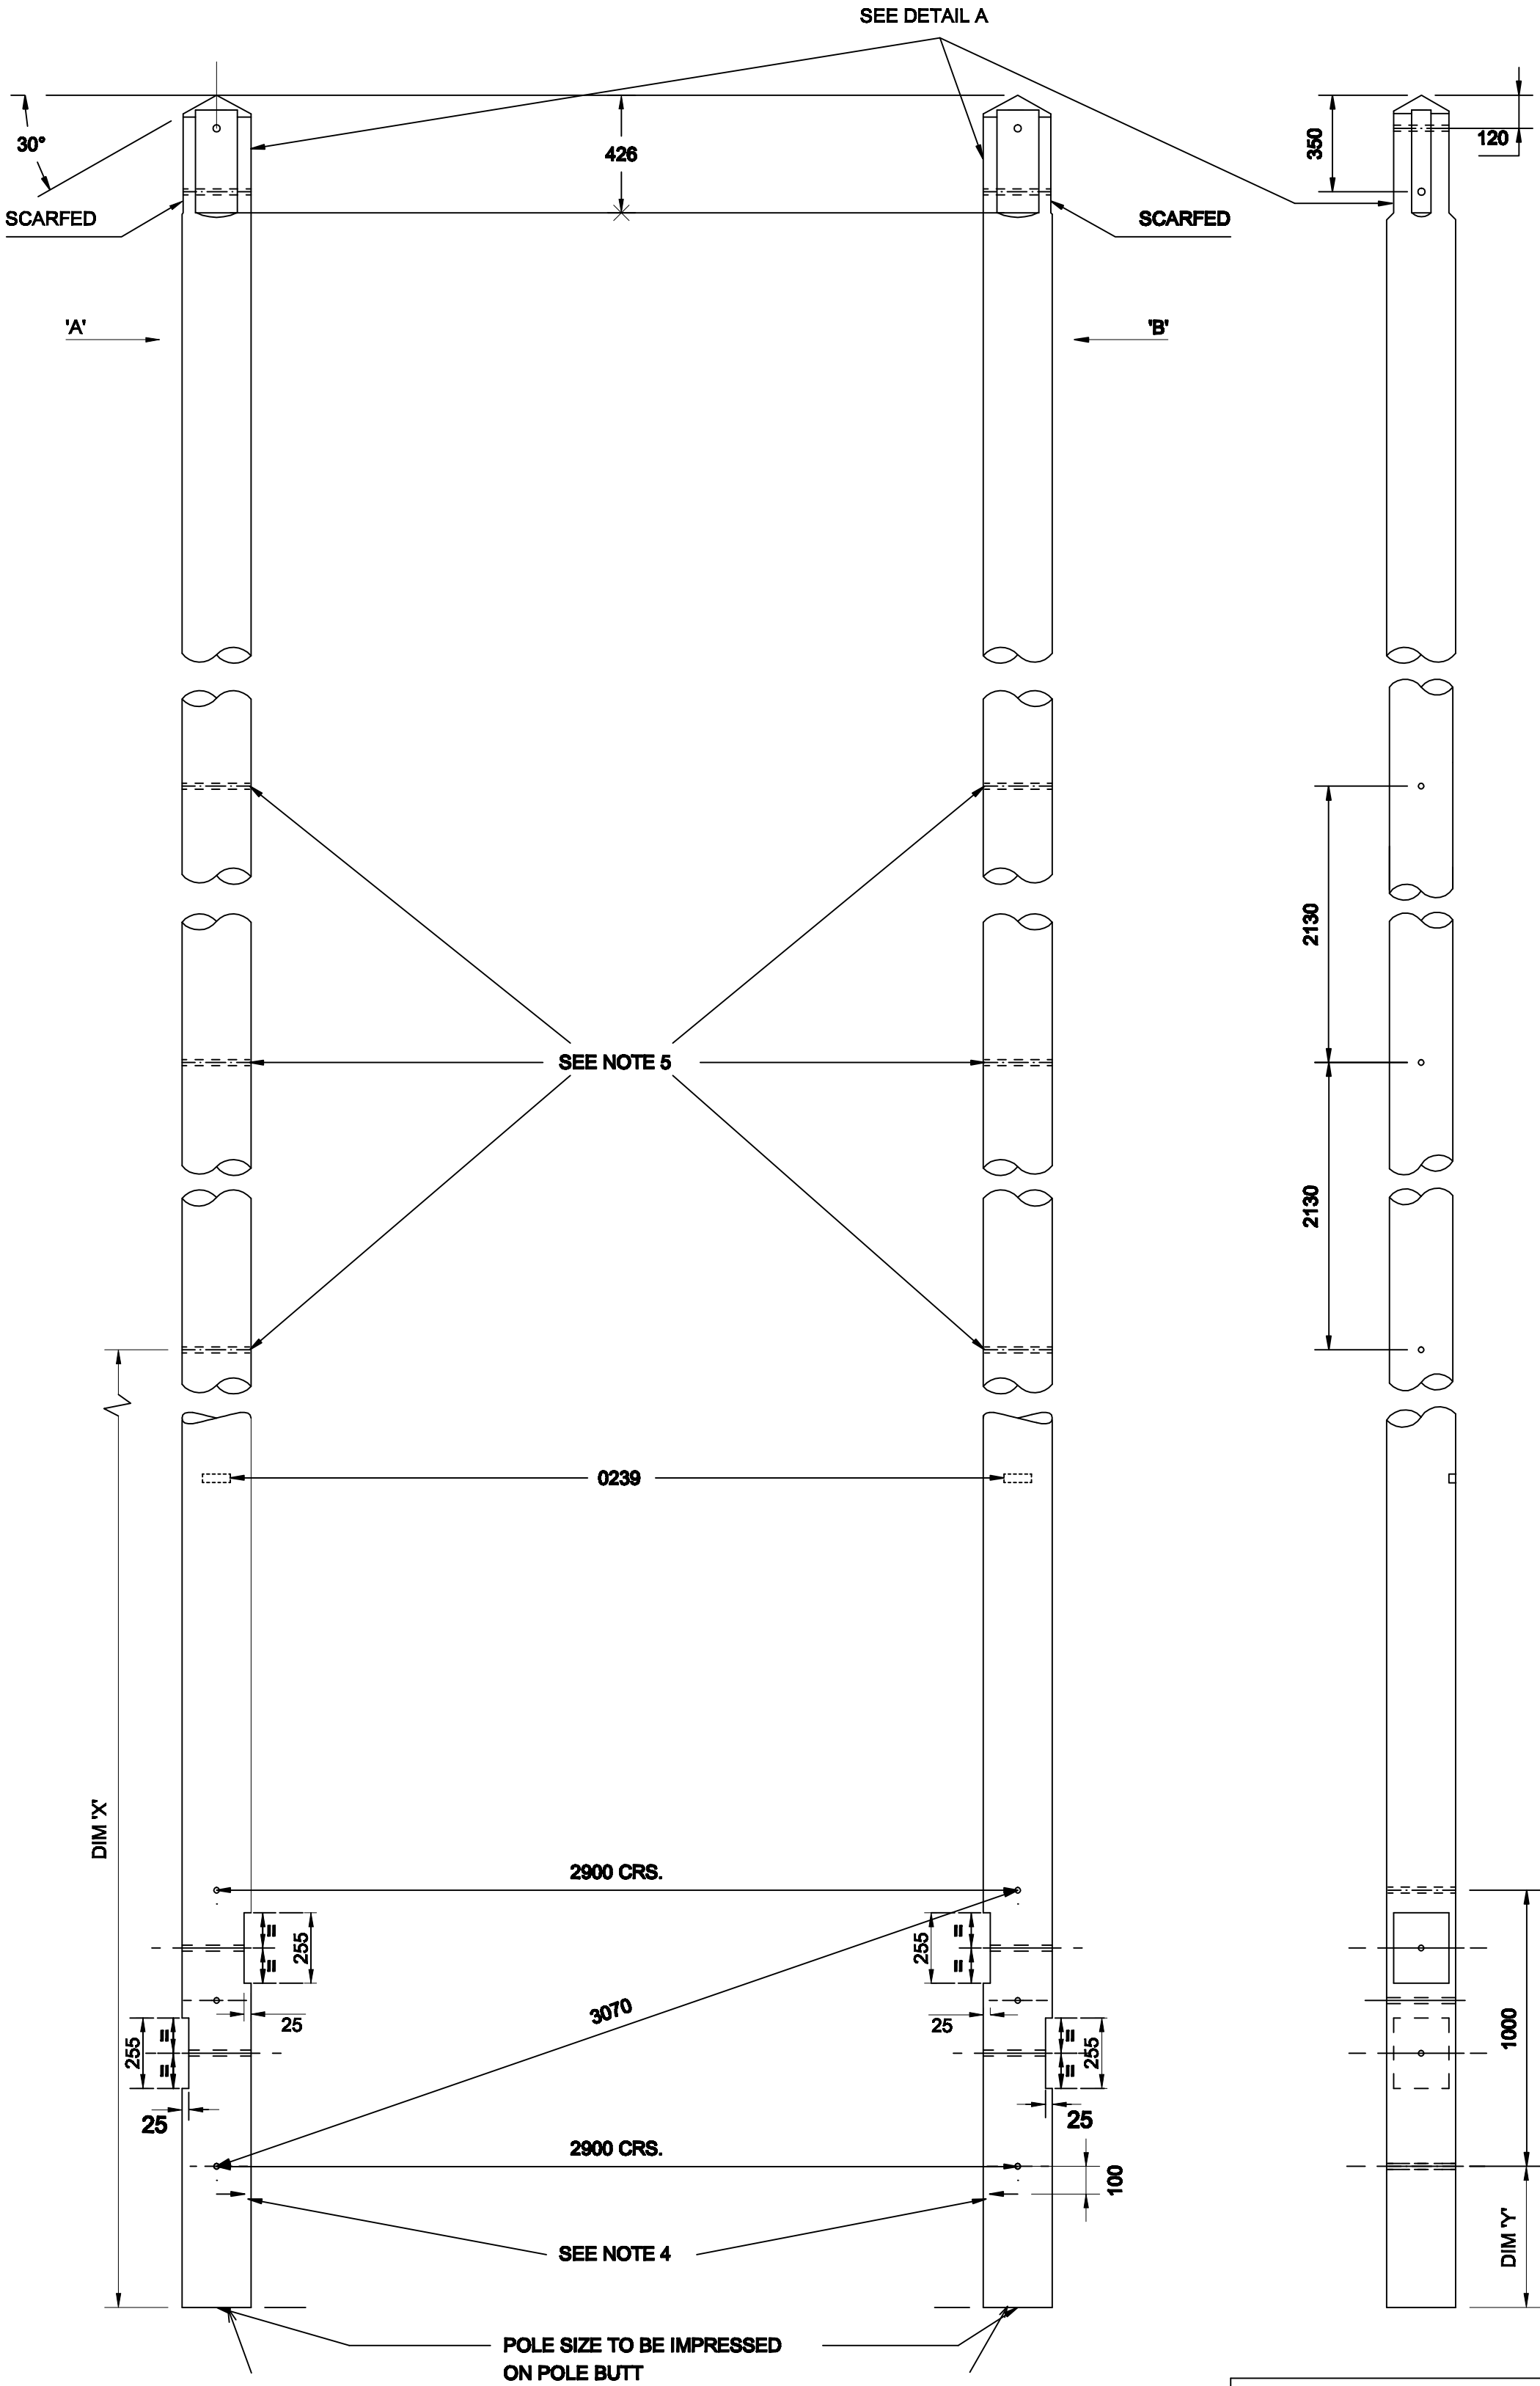

POLE LENGTH. (m)	DIM. 'X' (mm)
9.0 - 11 INCLUSIVE.	1900
12.0	1700
13 - 15 INCLUSIVE.	1400
16 - 18 INCLUSIVE.	1100
20	500

NOTES

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION "STOUT" – 250mm.
- HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE–LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
- POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
- 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
- "H" POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG.No. 1.09.101.0129.

All dimensions shown are in millimetres unless stated otherwise

 NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING SCARFING AND MARKING FOR TERMINAL 'H' POLE			
Sheet No. 2	Scale 1:20				
Prepared By Janis.Webb		Type OVERHEAD	POLES		
Revised 18/01/07	Grid Reference	Ref No.	C102518	Historic Drg.No.	1091380004
Date Issued 28/10/99	Checked By M. MOODY	Revision C	Notes		