
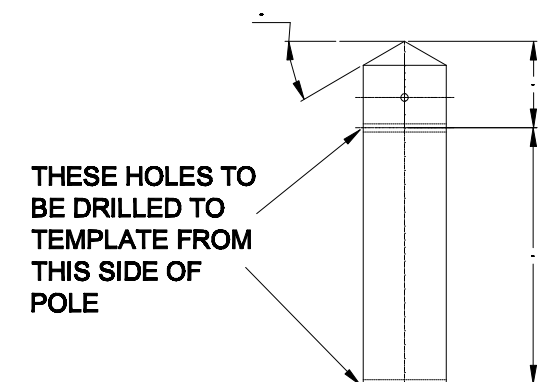


SCARFING TO BE CUT TO GIVE A 70mm WIDE FLAT ON TWO FACES THE ENDS CHAMFERED OFF AS SHOWN. BACK TO BACK BETWEEN FLAT FACES 220mm

45° CHAMFER

SCALE 1:10

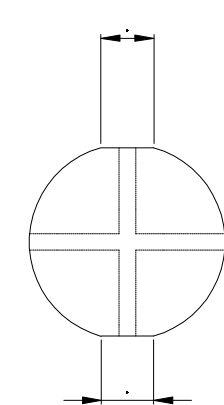


DETAIL 'A'

NOTES

1. CLASS OF POLE TO BE 'STOUT' OR EXTRA STOUT IN ACCORDANCE WITH 1.09.101.0238
2. POLE TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE
3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING
4. POLE TO BE NOTCHED AND DRILLED FOR 1 x 250 x 125 x 2500 AND 1 x 250 x 125 x 1300 LONG BAULKS

POLE LENGTH	DIM 'S'
8.5m - 12.0m INCLUSIVE	1.5
13.0m - 15.0m INCLUSIVE	1.7
16.0m - 18.0m INCLUSIVE	1.9
20.0m - 24.0m INCLUSIVE	2.5

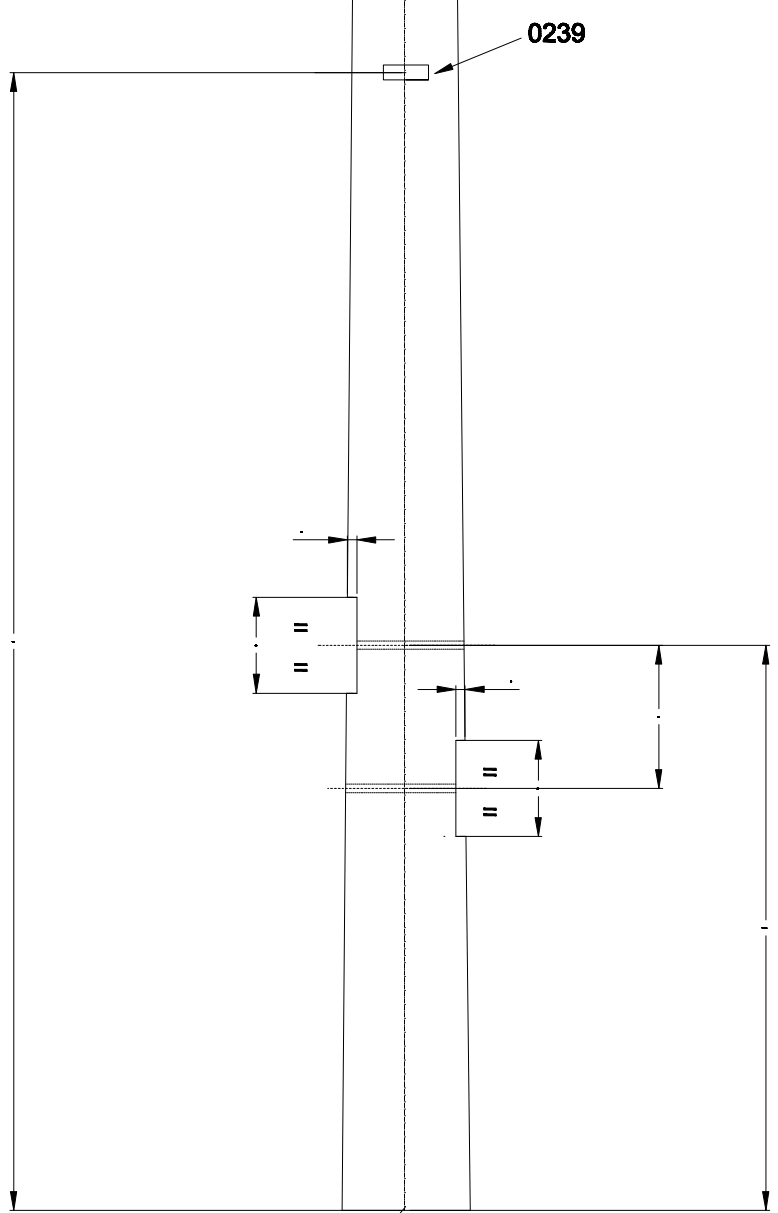

POLE LENGTH / CLASS TO BE IMPRESSED ON POLE BUTT

THIS VIEW SHOWS THE POLE FACE (NATURAL LIE OF POLE)

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES

 NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR SINGLE POLE SECTION/ SECTION ANGLE ARRANGEMENT			
Sheet No. 2	Scale 1:20				
Prepared By Barbara.Gordon		Type OVERHEAD		LINES	
Revised 01/10/14	Grid Reference	Ref No.	C1040651	Historic Drg.No.	1091380005
Date Issued 01/10/14	Checked By M MOODY	Revision	Notes		