

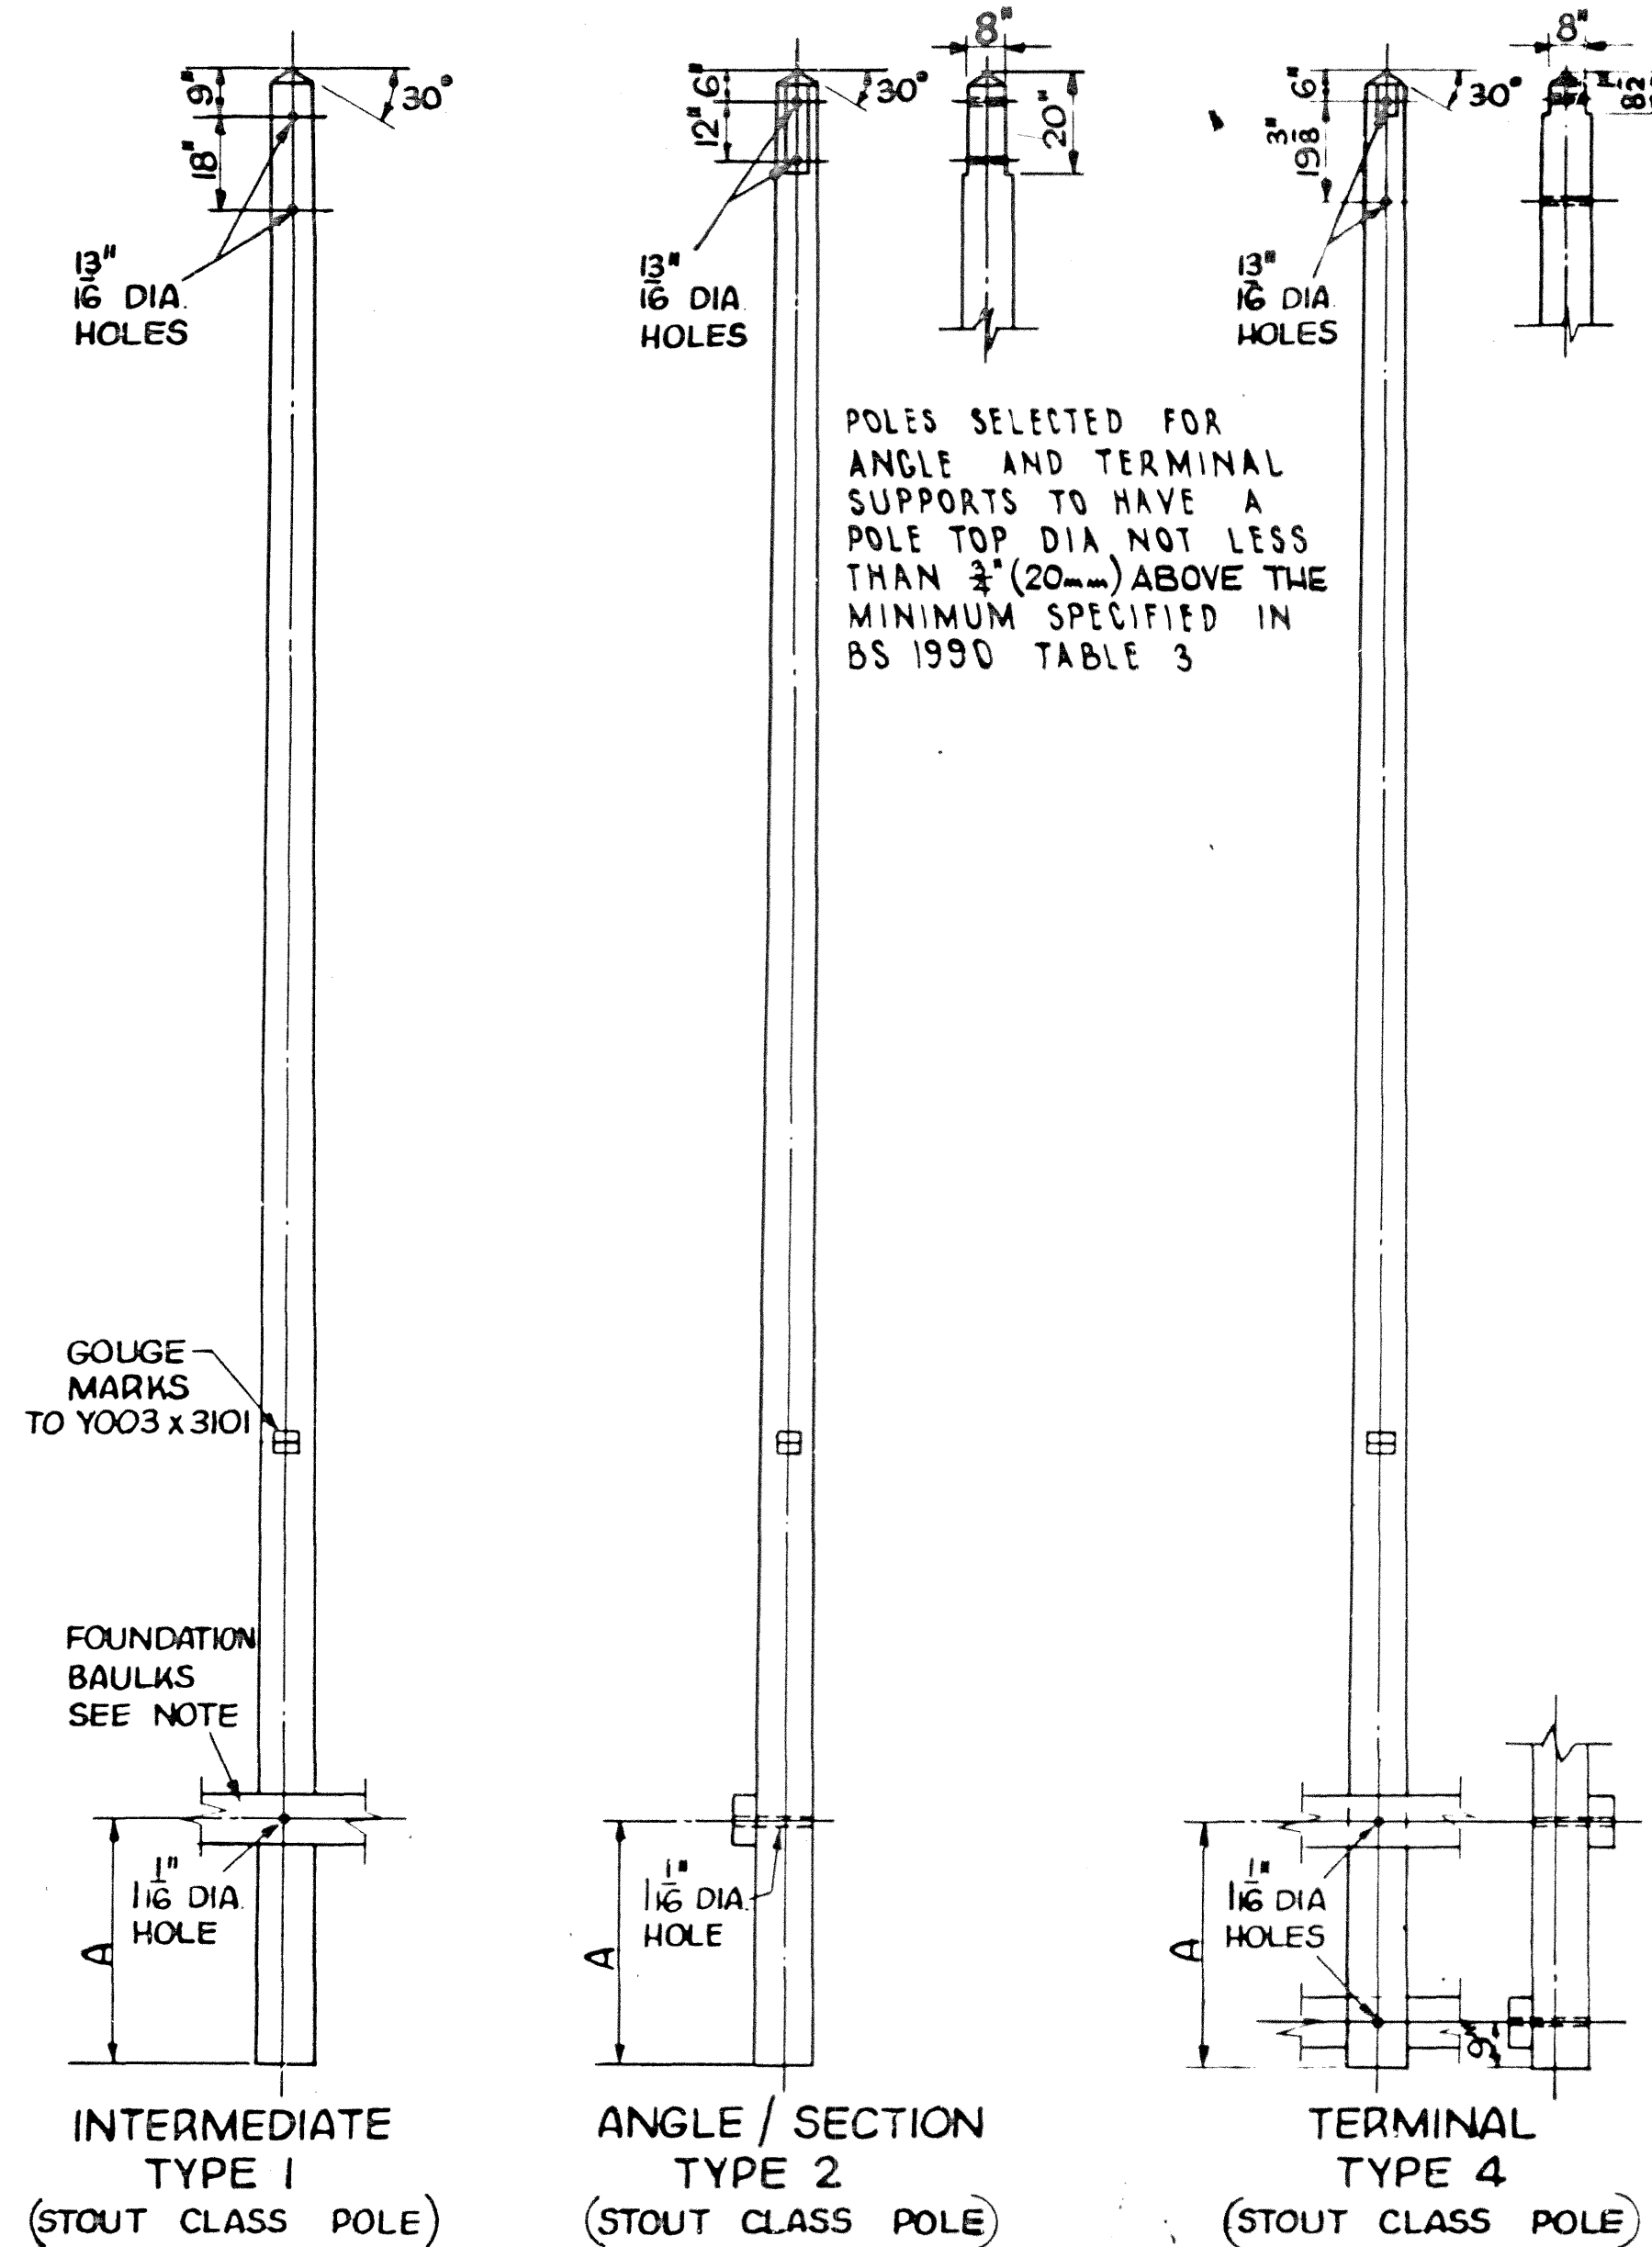


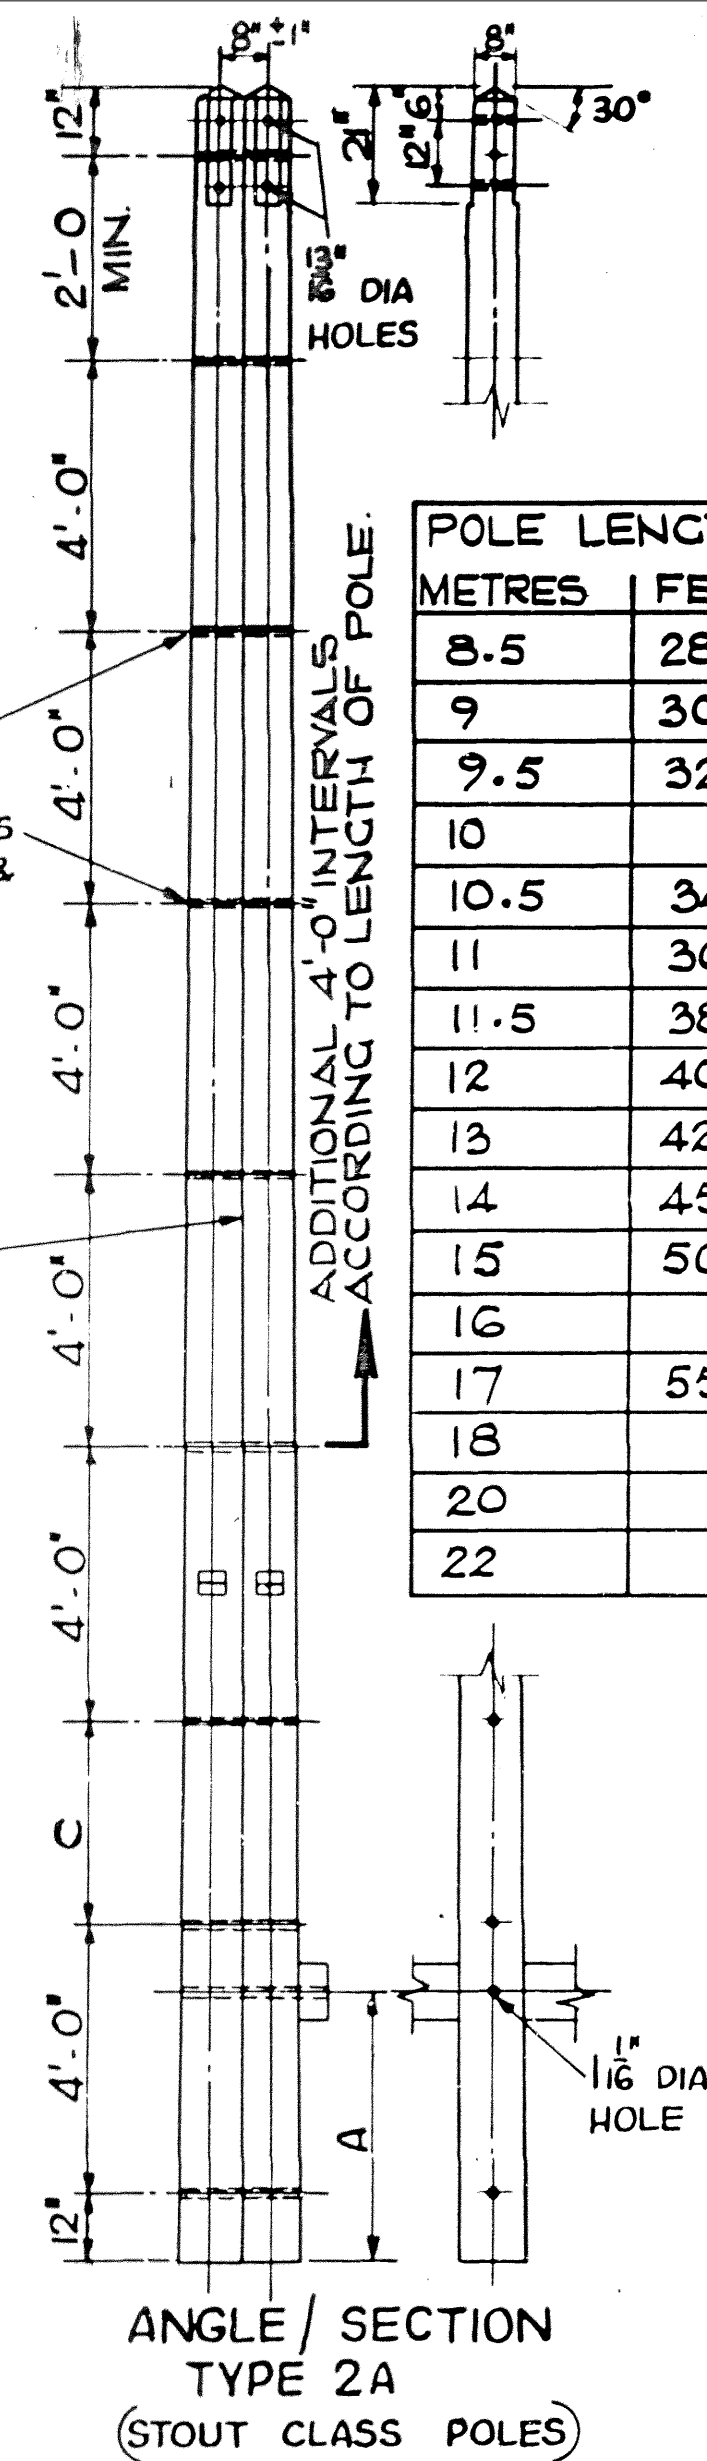

ADDITIONAL 4'-0" INTERVALS ACCORDING TO LENGTH OF POLE.

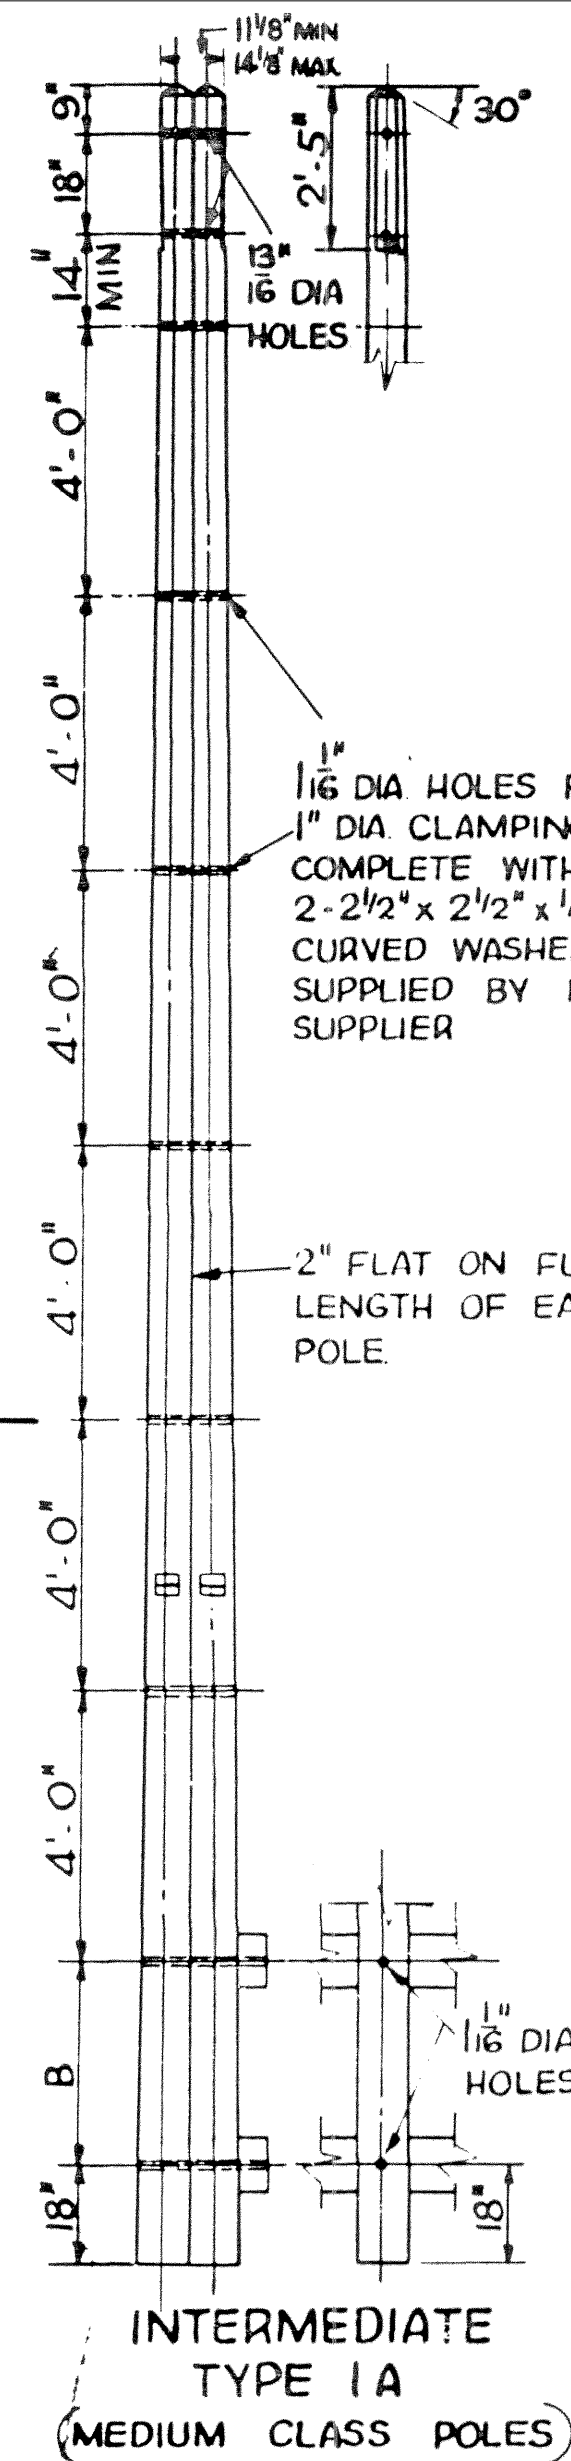

POLE LENGTH METRES	FEET	DIM 'A'	DIM 'B'	DIM 'C'
8.5	28'-0"	4'-0"	3'-0"	3'-0"
9	30'-0"	4'-0"	3'-0"	4'-0"
9.5	32'-0"	4'-0"	3'-0"	3'-0"
10		4'-0"	3'-0"	3'-0"
10.5	34'-0"	4'-0"	3'-0"	4'-0"
11	36'-0"	4'-0"	3'-0"	3'-0"
11.5	38'-0"	4'-0"	3'-0"	4'-0"
12	40'-0"	4'-6"	3'-6"	3'-0"
13	42'-0"	4'-6"	3'-6"	4'-0"
14	45'-0"	5'-0"	4'-0"	4'-0"
15	50'-0"	5'-0"	4'-0"	4'-0"
16		5'-6"	4'-6"	3'-0"
17	55'-0"	5'-6"	4'-6"	3'-0"
18		6'-0"	5'-0"	3'-0"
20		6'-0"	5'-0"	4'-0"
22		6'-0"	5'-0"	3'-0"

POLE APPLICATION

SUPPORT	11kV CE/C/31	33kV CE/C/36
INTER	1	1
ANGLE / SECTION	2	2
TERMINAL	4	4

MATERIALS

POLES TO BS 1990.
BOLTS TO BS 916 THREADED B.S. WHIT.
GALVANISED TO BS 1729.
CREOSOTING TO BS 913 RUFEPING PROCESS.
TWIN POLES TO BE BOLTED TOGETHER BEFORE
CREOSOTING WITH NUTS SLACKENED 2 FULL TURNS.
NUTS FULLY TIGHTENED AFTER CREOSOTING

NOTE FOUNDATION BAULKS TO Y003 x 3201 (TYPE 2)
POLE DRILLED ONLY WHEN BAULKS REQUIRED

NORTHERN POWERGRID

Manufacturer Details

Sheet No.

Scale

Prepared By
Caralyn Palmer

Revised
01/10/14

Date Issued
01/10/14

Grid Reference

Checked By
G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

POLE DETAILS FOR SINGLE SUPPORT LINES
UNEARTHED CONSTRUCTION

Type

OVERHEAD

POLES

Ref No.

C1040624

Historic
Drg.No.

Y003X3102

Revision B

Notes

A TYPE NO. OF POLES
MODIFIED

B TABLE MODIFIED, HEIGHT
TO GOUGE MARK REMOVED
NOTES ADDED

C

D