


POLE SIZE TO BE IMPRESSED
ON POLE BUTT.

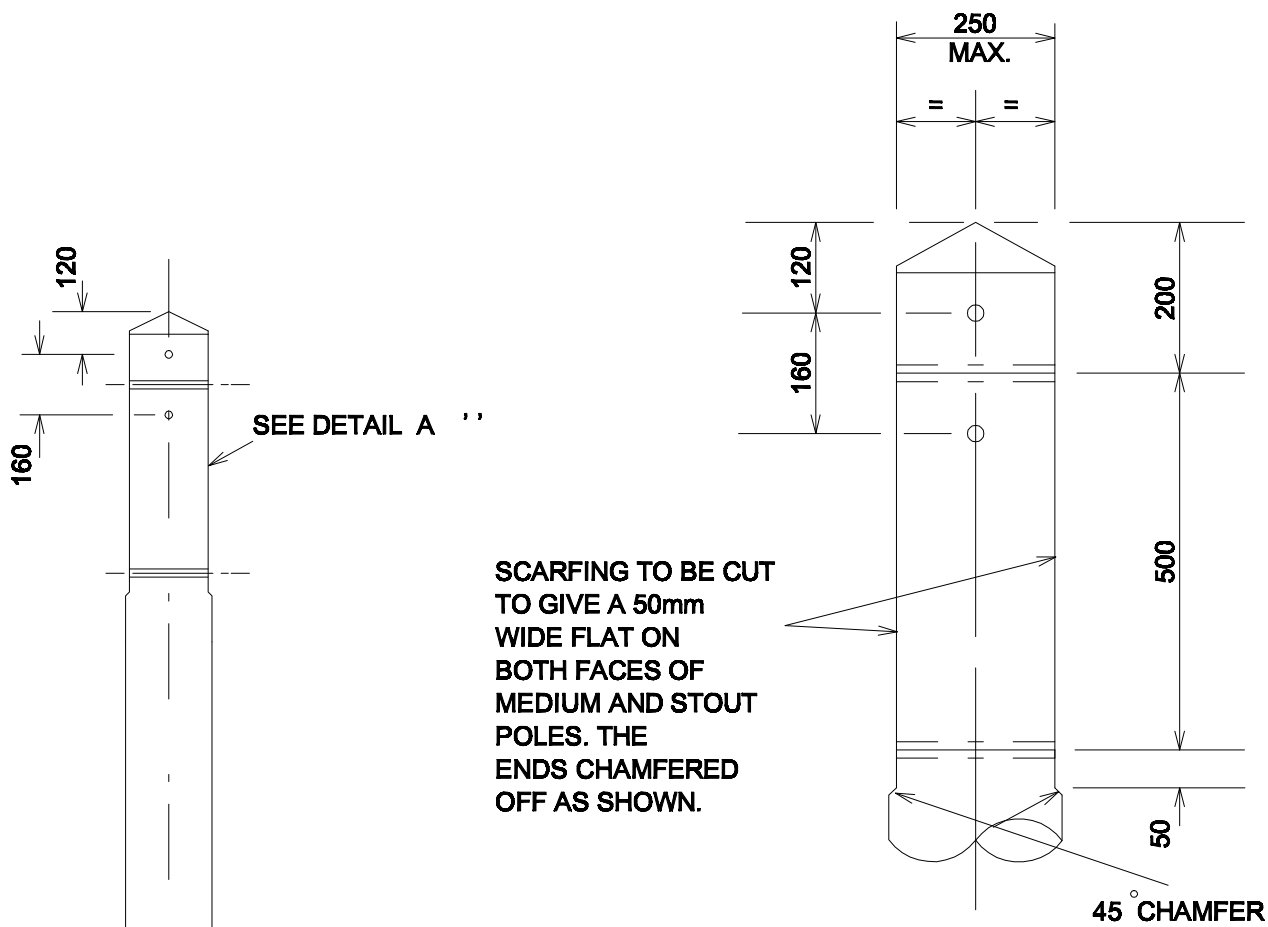

SEE DETAIL A ''

SCARFING TO BE CUT
TO GIVE A 50mm
WIDE FLAT ON
BOTH FACES OF
MEDIUM AND STOUT
POLES. THE
ENDS CHAMFERED
OFF AS SHOWN.

DETAIL A ''

SCALE 1:10

NOTES:

1. CLASS OF POLE TO BE MEDIUM OR STOUT AS SPECIFIED.
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
3. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE TO BE NOTCHED AND DRILLED FOR DUPLICATE 250 x 125 BAULKS.

POLE LENGTH. (m)	DIM. X (mm)
9.0 - 11 INCLUSIVE	1900
12.0	1700
13 - 15 INCLUSIVE.	1400
16 - 18 INCLUSIVE.	1100
20	500

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		HV OVERHEAD LINES SINGLE POLE FABRICATION FOR ARRANGEMENTS TO ESI 43 - 40	
Sheet No. 1	Scale 1:20		
Prepared By Janis.Webb		Type ESI	ESI
Revised 24/04/06	Grid Reference	Ref No. C147651	Historic Drg.No. 1000434001
Date Issued 23/02/05	Checked By G HAMMEL	Revision F	Notes