


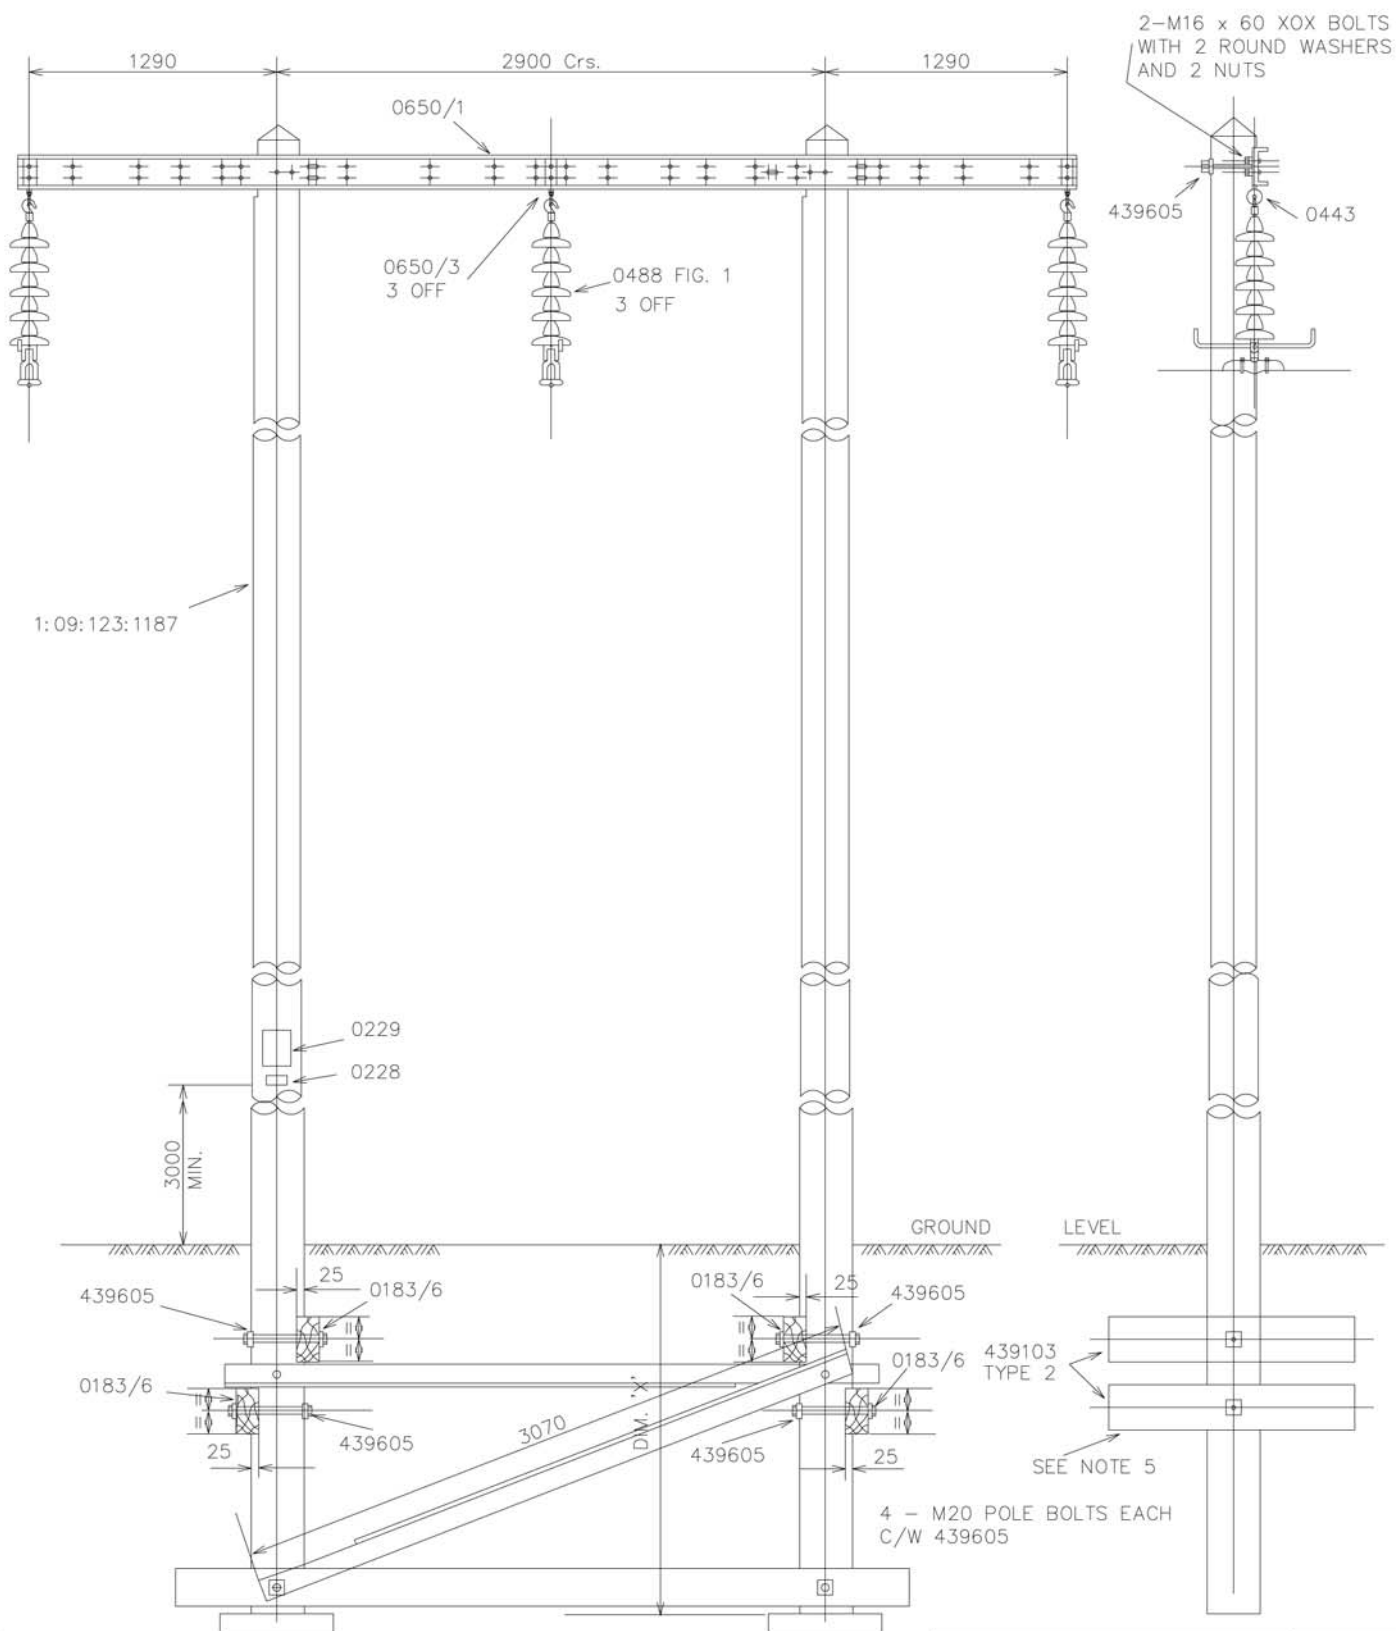

NOTES: -

1. ALL POLE BOLTS TO BE M20 DIA.
2. DETAIL DRGS. PREFIXED 43 REFER TO ESI BASED DRGS. OTHER DETAIL DRGS. REFER TO 1:09:101 SERIES
3. THIS ARRANGEMENT MAY BE USED WITH EXISTING POLES TO EARLY ISSUE OF 1:09:123:1165 AND 66.5/10.1161 POLE TOP REFABRICATION WILL BE REQUIRED IN THE LATTER CASE TO ACCEPT THE CROSSARM TO 1:09:101:0650
4. ALL UNUSED POLE HOLES TO BE PLUGGED ON SITE.
5. LOWER BAULKS TO BE FITTED WHERE ABNORMAL AND CONDITIONS WARRANT IT.

TO BE READ IN CONJUNCTION WITH 1:09:123:1165 SHEET 2

WORK SPEC. 04/223

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m
20.0m TO 24.0m INCLUSIVE	3.0m

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

		Northern Electric Distribution Limited, Carliol House, Newcastle Upon Tyne, NE1 6NE.	
66kV SINGLE CIRCUIT OVERHEAD LINES PORTAL POLE ARRANGEMENT FOR LONG SPAN LINE APPLICATION.			
Prepared by	J.A.B.	Drg.No.	1 09 123 1165
Checked	M.W.	Date Issued	FEB'87
Mod.	1	Sheet No.	1
		Revised	SEP'99(RC)
		Scale	1:20