

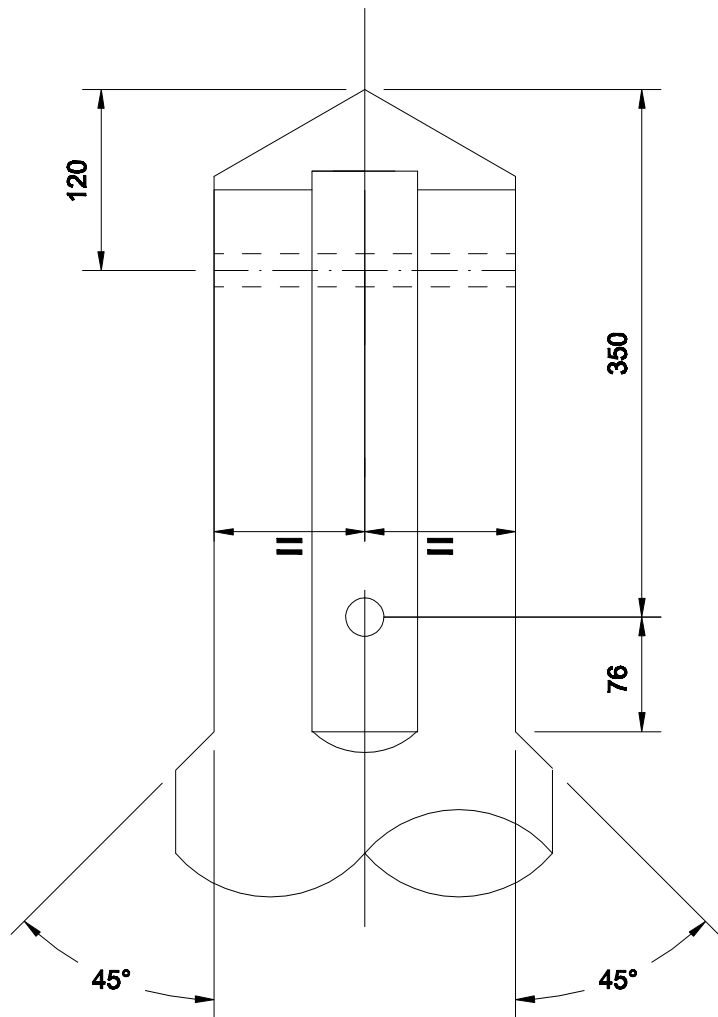


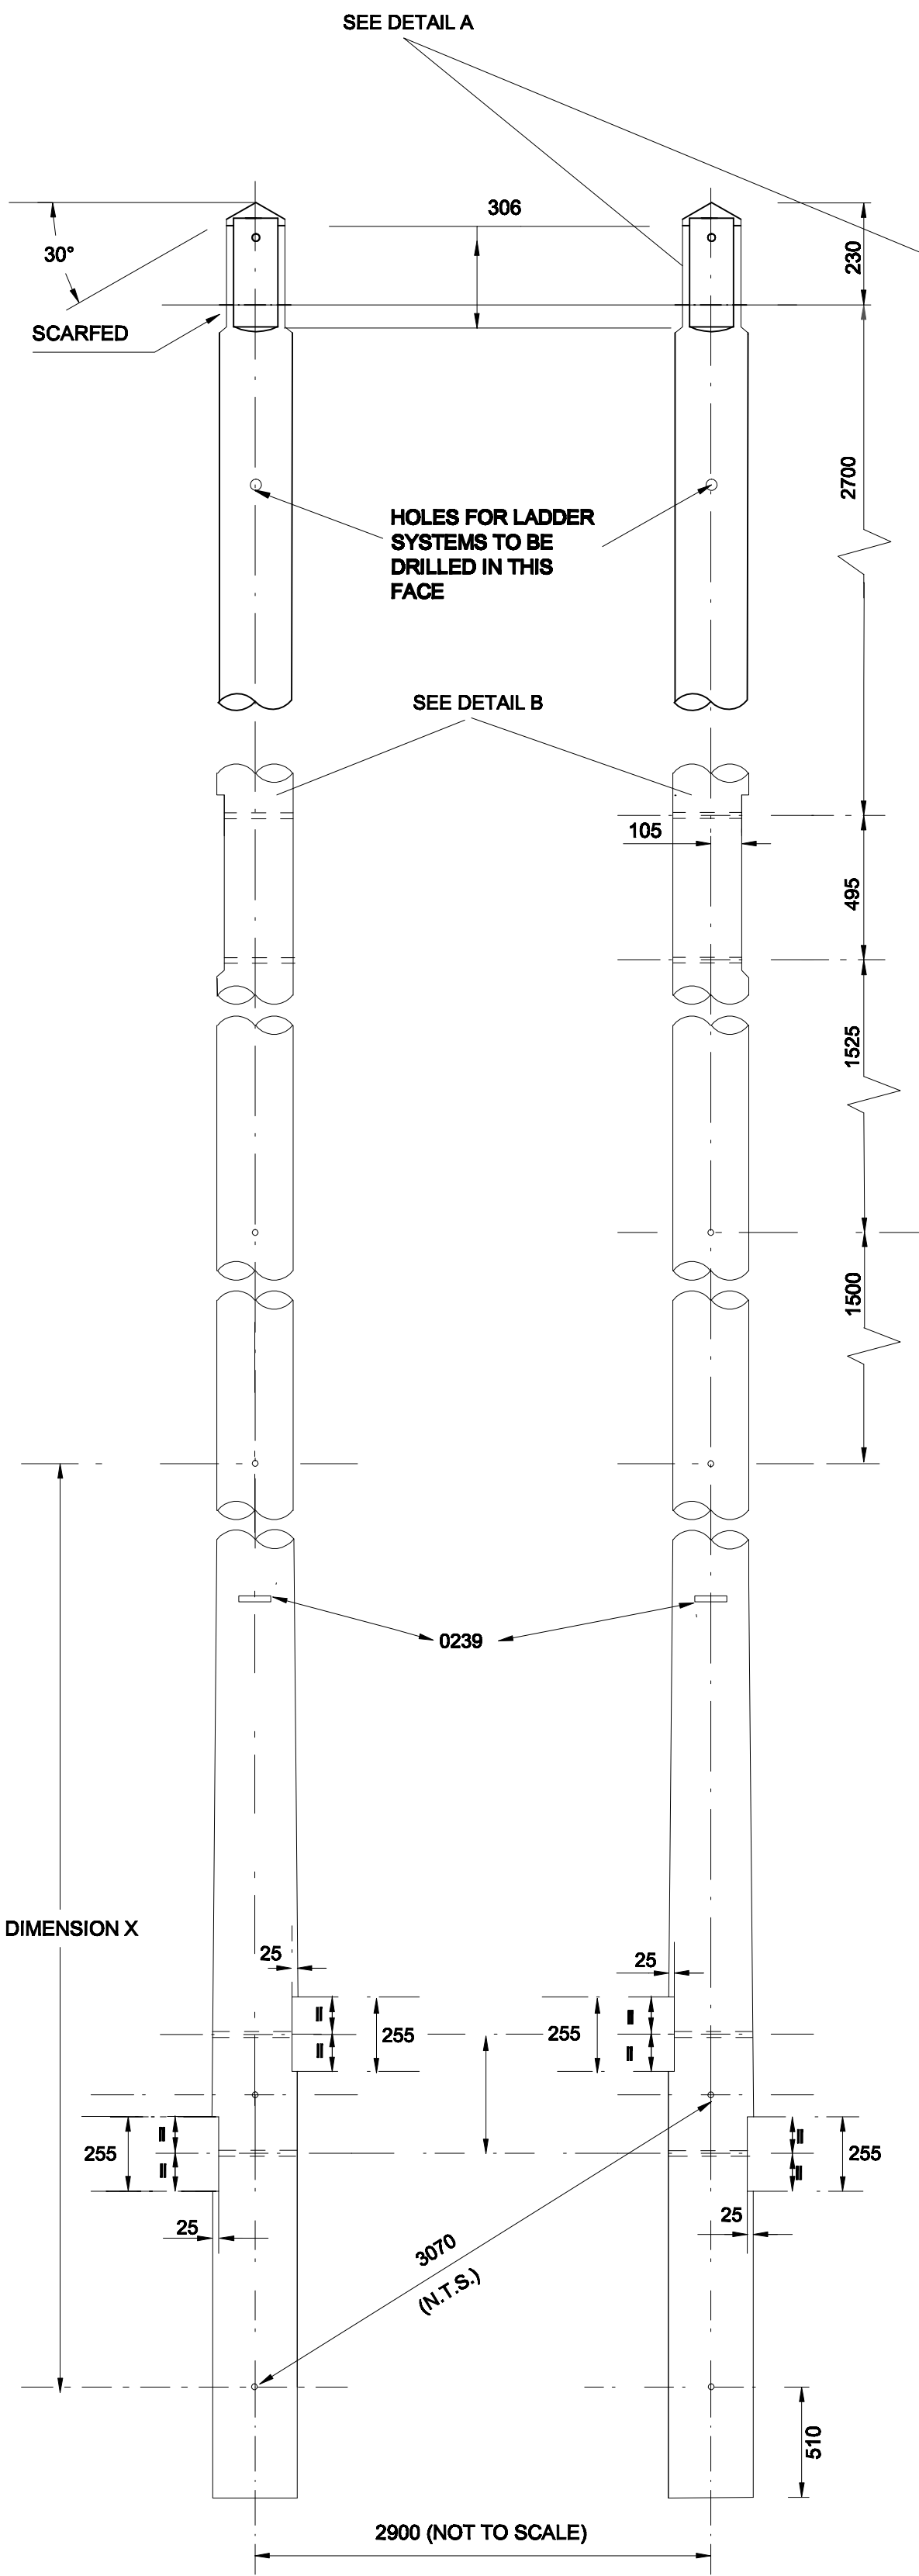

SIDE ELEVATION

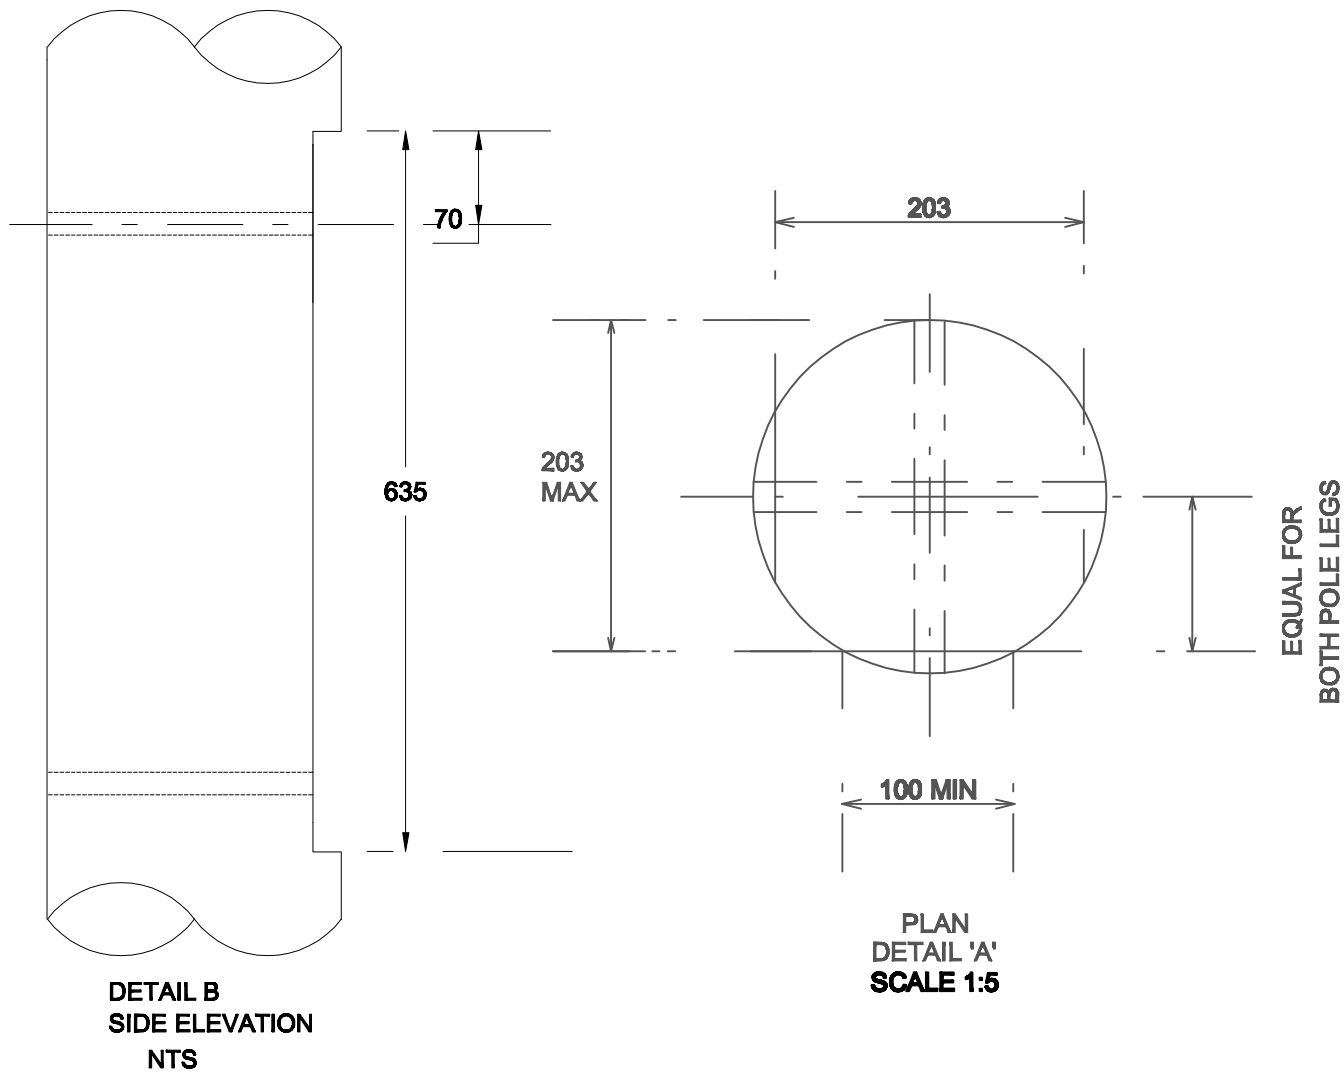

DETAIL B
PLAN

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 230mm
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9804 AND 9805 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	5040	1700
13.0m	6040	1700
14.0m	7040	1700
15.0m	8040	1700
16.0m	9040	1900

 NORTHERN POWERGRID		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV SINGLE CIRCUIT LINES DRILLING AND SCARFING FOR TERMINAL SUPPORT WITH SURGE ARRESTERS - 1173 SHEET 4	
Sheet No. 5	Scale 1:20	Type OVERHEAD POLES	
Prepared By Barbara.Gordon	Grid Reference	Ref No. C995434	Historic Drg.No. 1091231173
Revised 16/06/15	Checked By S SALKELD	Revision G	Notes
Date Issued 16/02/11			