


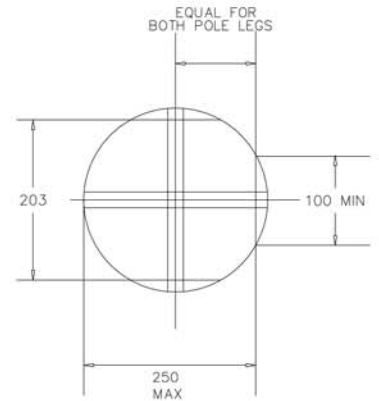
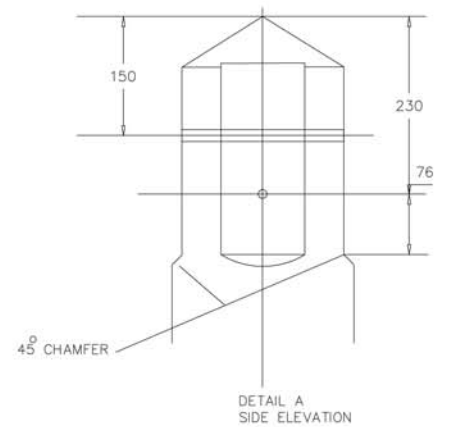


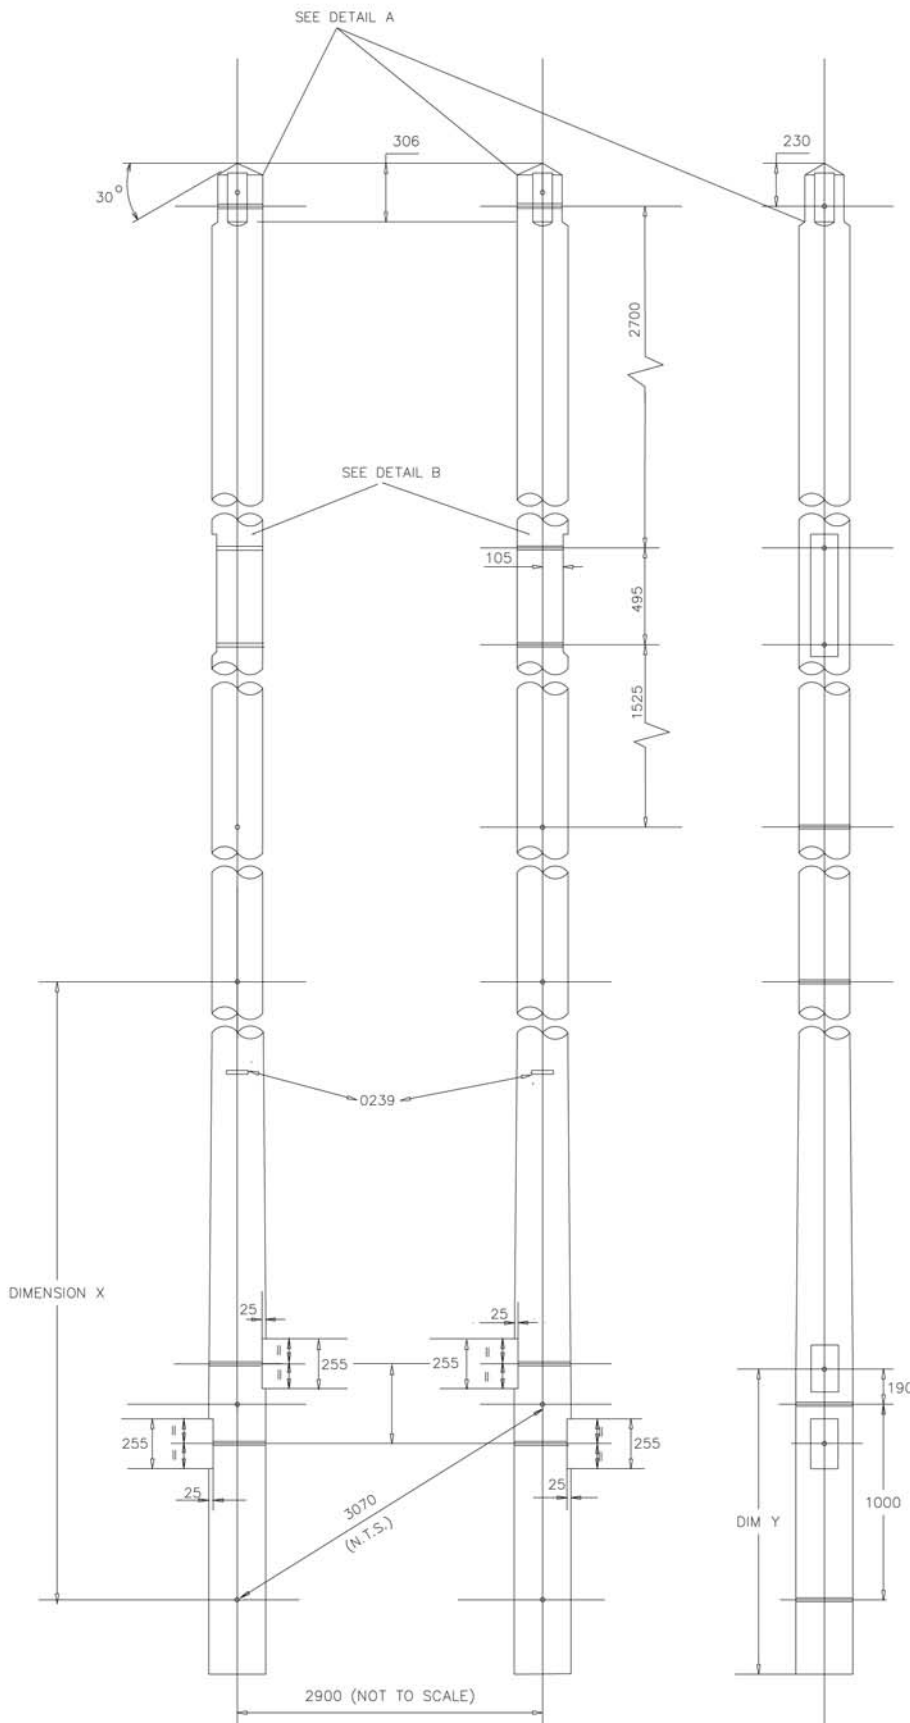

DETAIL A
PLAN

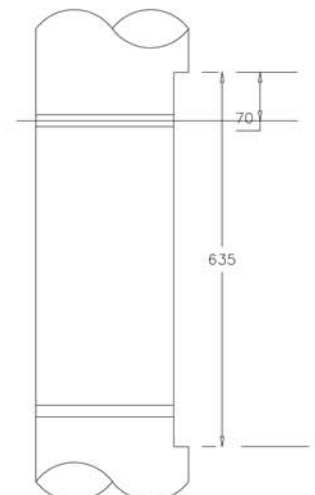

DETAIL B
SIDE ELEVATION
NTS



DETAIL B
PLAN

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 230mm
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	5655	1700
13.0m	6655	1700
14.0m	7655	1700
15.0m	8655	1700
16.0m	9655	1900

NEDL

Prepared by C.T.

Checked C.S. Date issued AUG 96

NEDL, Manor House, Station Road, Houghton le Spring, DH4 7LA.

66KV SINGLE CIRCUIT LINES

DRILLING AND SCARFING FOR TERMINAL SUPPORT

WITH SURGE ARRESTERS - 1173 SHEET 4

Drg.No.	1 09 123 1173	Sheet No.	5
Revised		Scale	1:20 & 1:5