


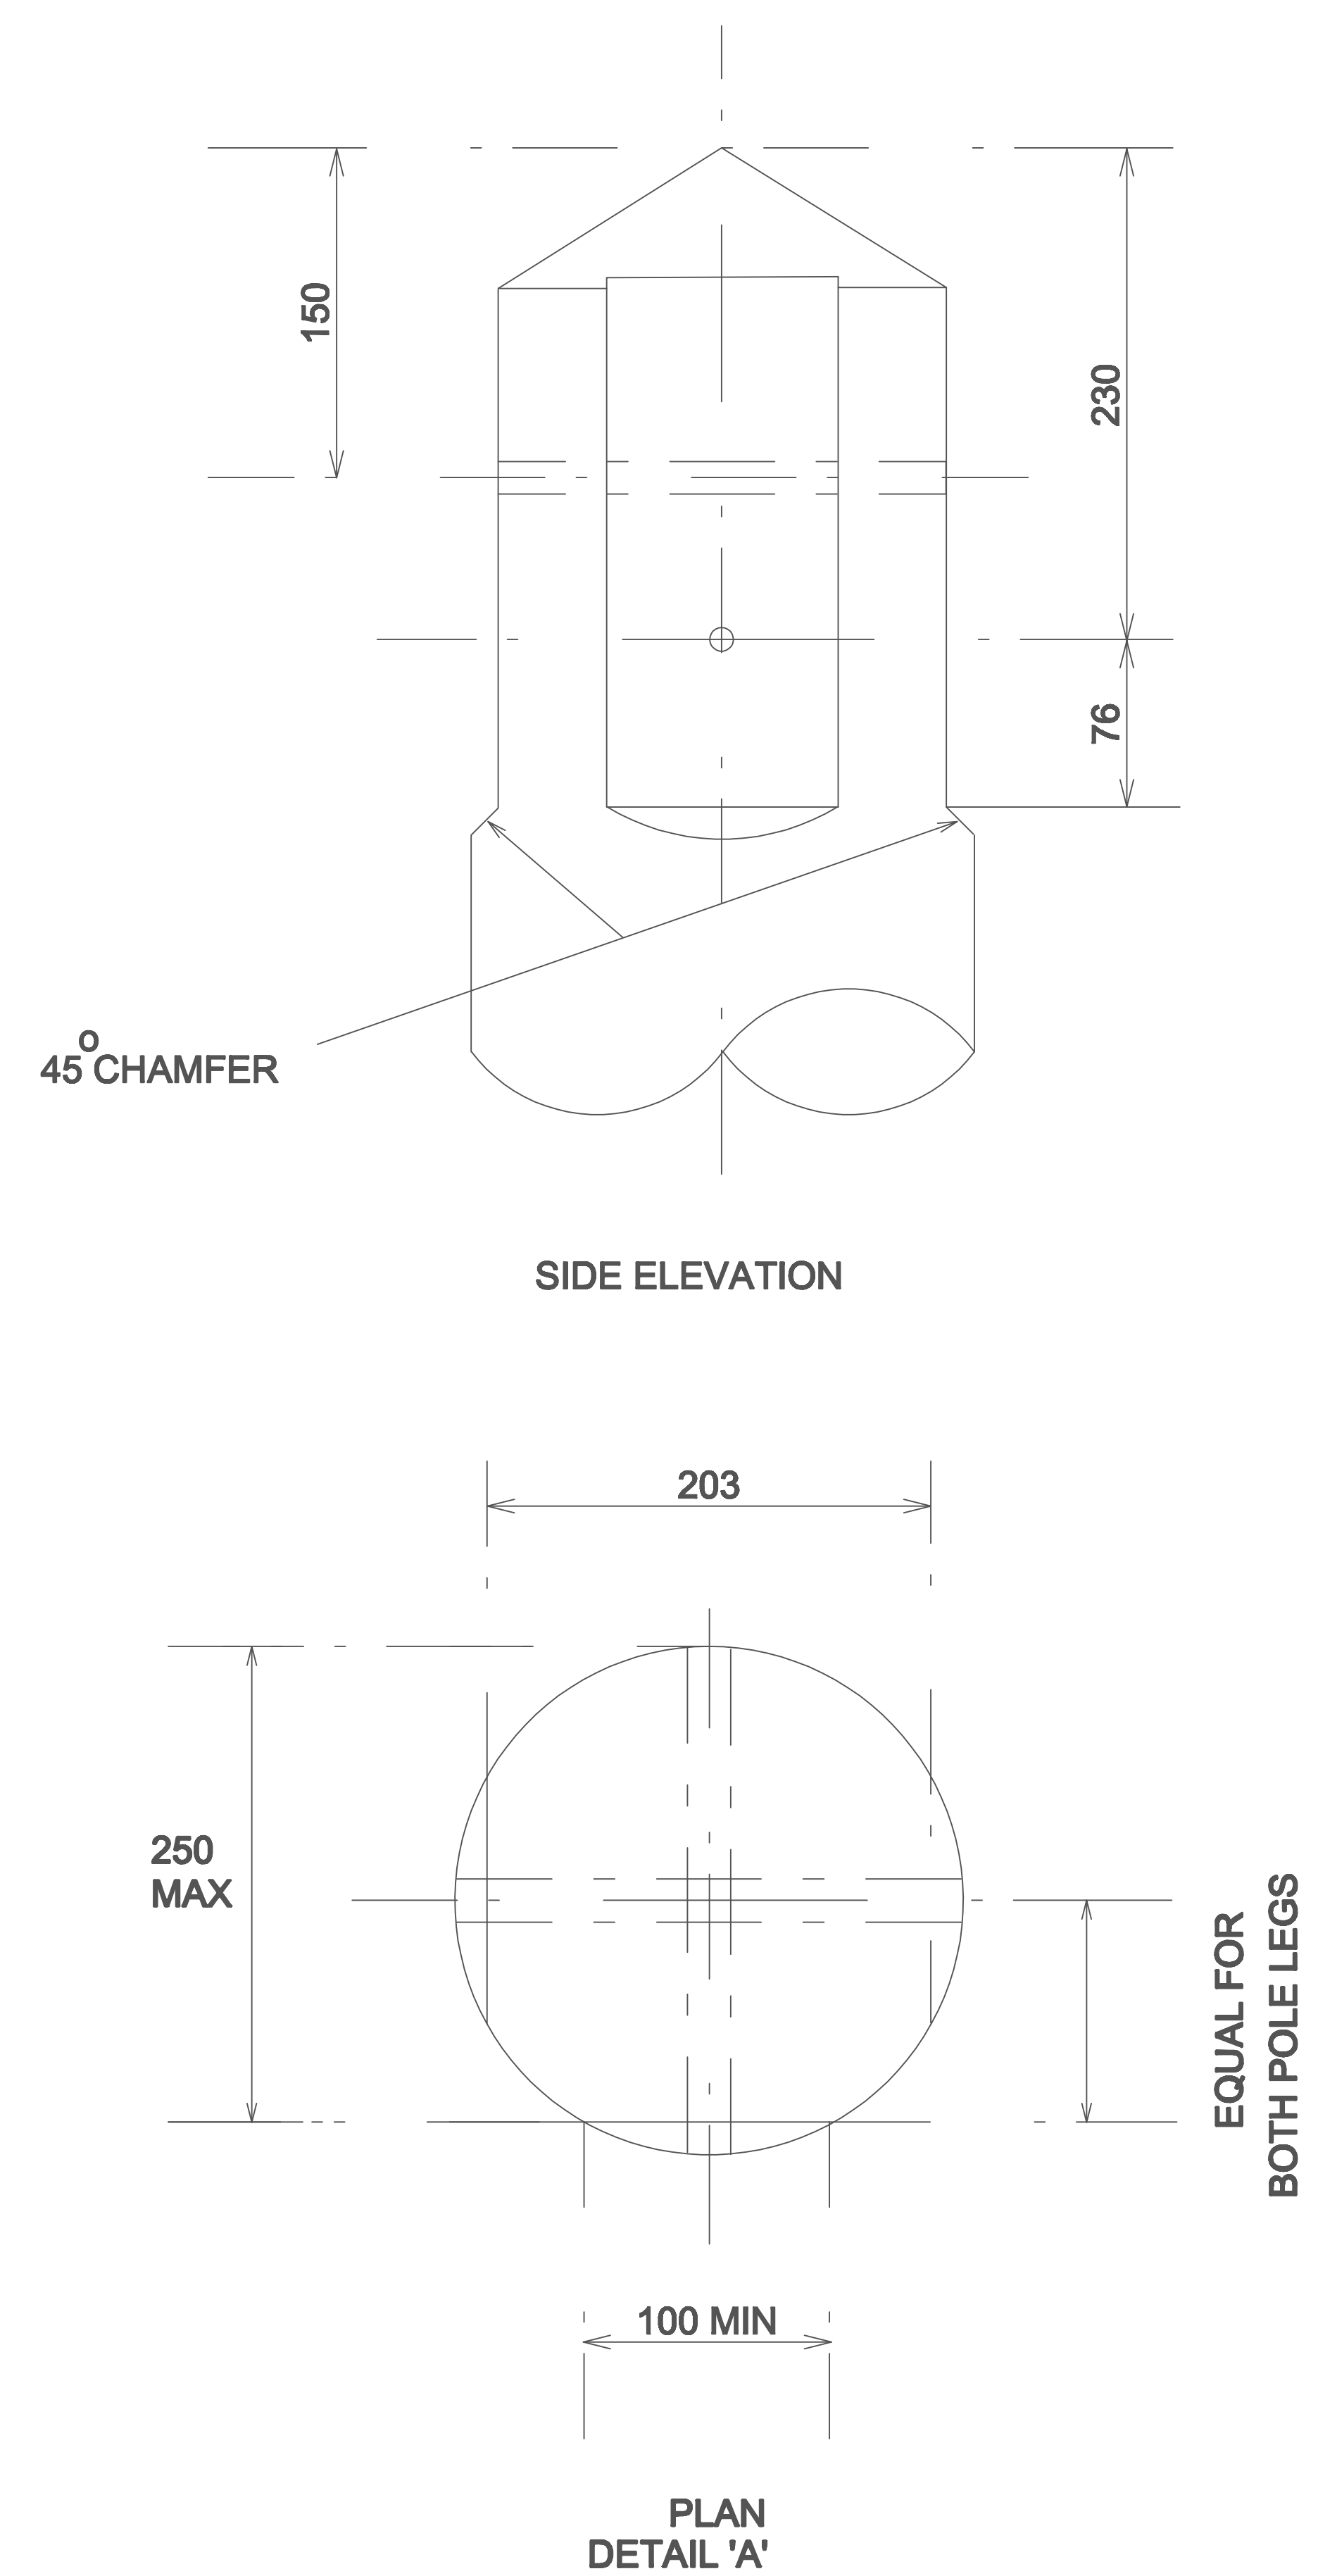

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION
STOUT - 230mm
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE
OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO
CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO
DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS
EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS
1 00 043 9604 AND 9605 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL
BE PLUGGED ON SITE

POLE LENGTH	DIM X	DIM Y
UP TO AND INCLUDING 12.0m	-	1500
13.0m TO 15.0m INCLUSIVE	-	1700
16.0m AND 17.0m	-	1900
18.0m	7955	1900
20.0m	9255	2500
22.0m	10255	2500
24.0m	11255	2500

		NEDL, Lloyds Court, 78, Grey Street, Newcastle Upon Tyne NE1 6AF													
		66kV SINGLE CIRCUIT OVERHEAD LINES													
		DRILLING, SCARFING AND MARKING FOR STANDARD													
		PORTAL TYPE POLE TO SPECIFICATION OHL 4/84													
Prepared by C.M.		Drg.No. 1 09 123 1187				Sheet No. 1									
Checked H.S.M.		Date Issued JUN '85						Revised 1.10.2001							
				Mods. G H A J								Scale 1:20 & 1:5			