
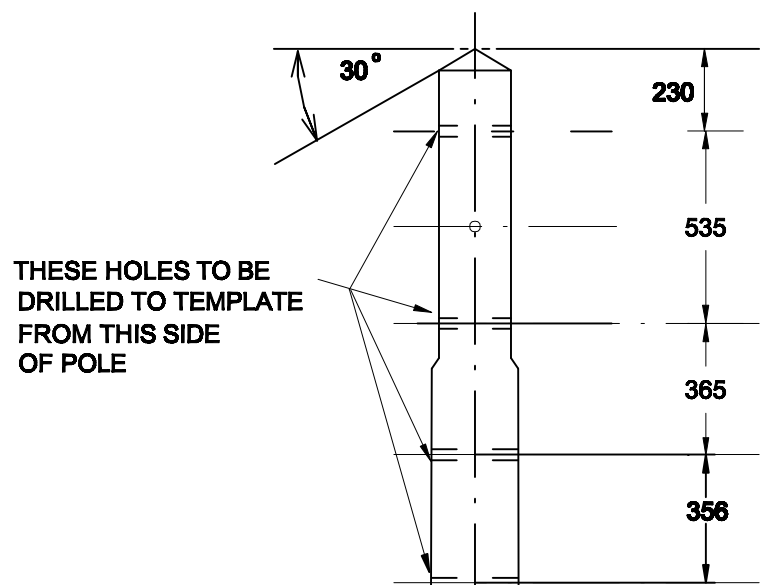



SCARFING TO BE CUT TO GIVE A 50mm WIDE FLAT ON TWO FACES THE ENDS CHAMFERED OFF AS SHOWN.

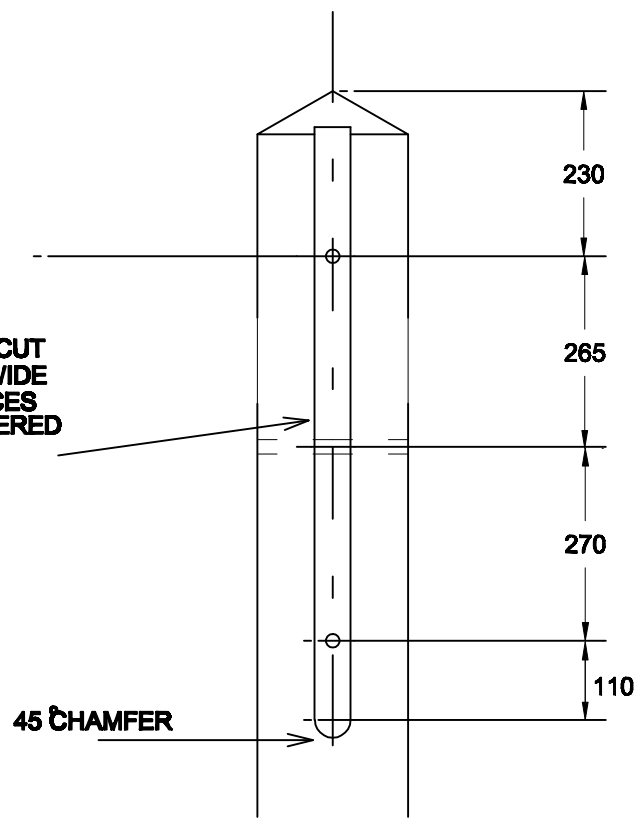

DETAIL 'A'

NOTES

1. CLASS OF POLE TO BE 'STOUT' OR EXTRA STOUT IN ACCORDANCE WITH 1.09.101.0238
2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE
3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING
4. POLE TO BE NOTCHED AND DRILLED FOR
1 x 250 x 125 x 2500 AND
1 x 250 x 125 x 1300 LONG BAULKS
5. EXTRA STOUT POLES TO BE NORMALLY FITTED WITH DOUBLE BAULKS. EXTRA STOUT POLES DESIGNED TO INCREASE WIND SPANS MAY BE UNSUITABLE FOR POOR GROUND CONDITIONS. SEE SPECIFICATION.

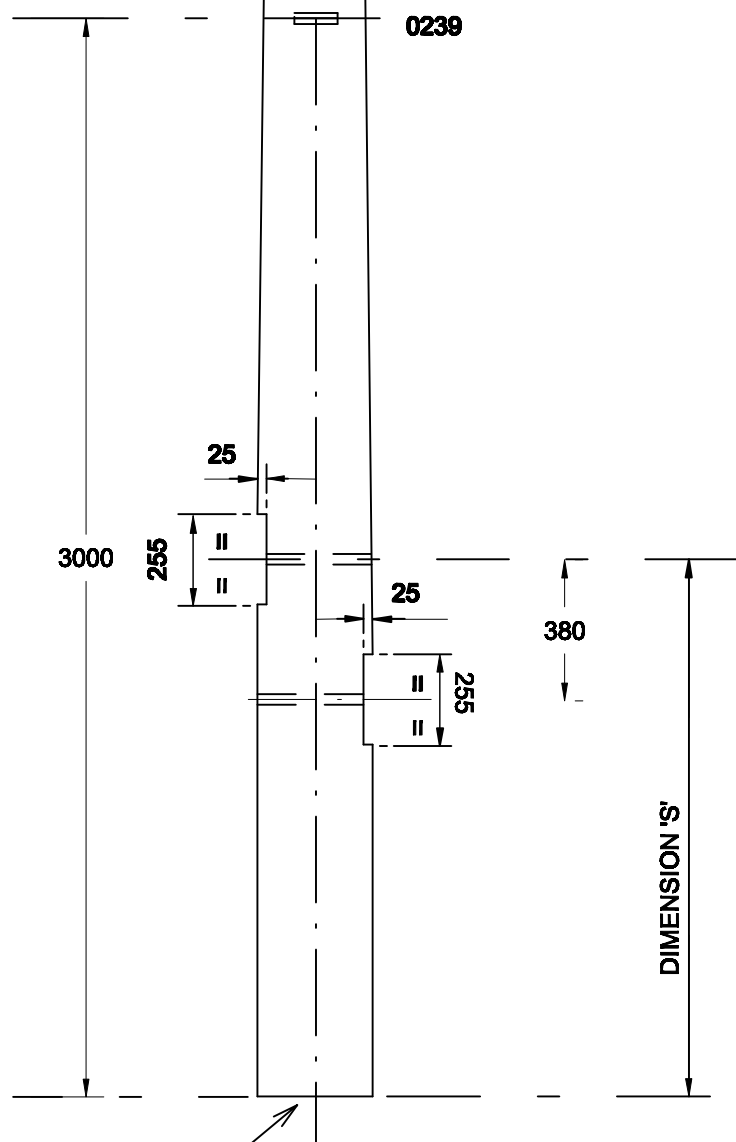

POLE LENGTH/ CLASS TO BE IMPRESSED ON POLE BUTT

THIS VIEW SHOWS THE POLE FACE (NATURAL LIE OF POLE.)

POLE LENGTH	DIM. 'S'
13.0m - 15.0m INCLUSIVE	2.1
16.0m - 18.0m INCLUSIVE	2.1
20.0m - 24m INCLUSIVE	2.5

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR SINGLE INTERMEDIATE POLE ARRANGEMENT	
Sheet No. 2	Scale 1:20	Type OVERHEAD	POLES
Prepared By Barbara Gordon	Grid Reference	Ref No. C102523	Historic Drg.No. 1091380006
Revised 24/04/12	Checked By M. MOODY	Revision D	Notes
Date Issued 08/11/99			