

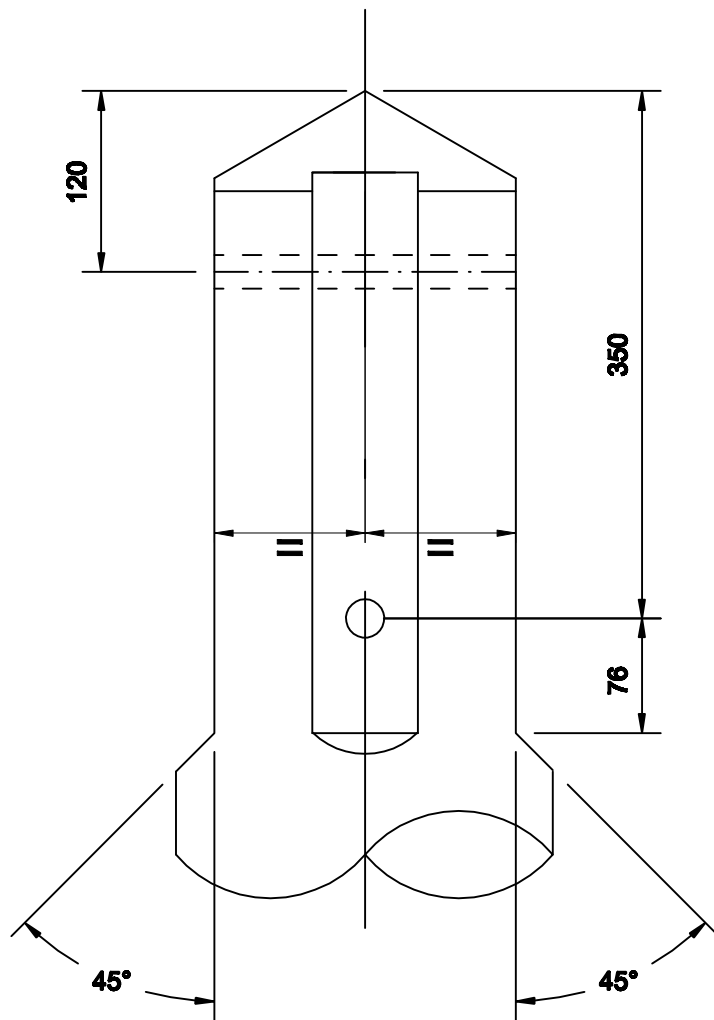


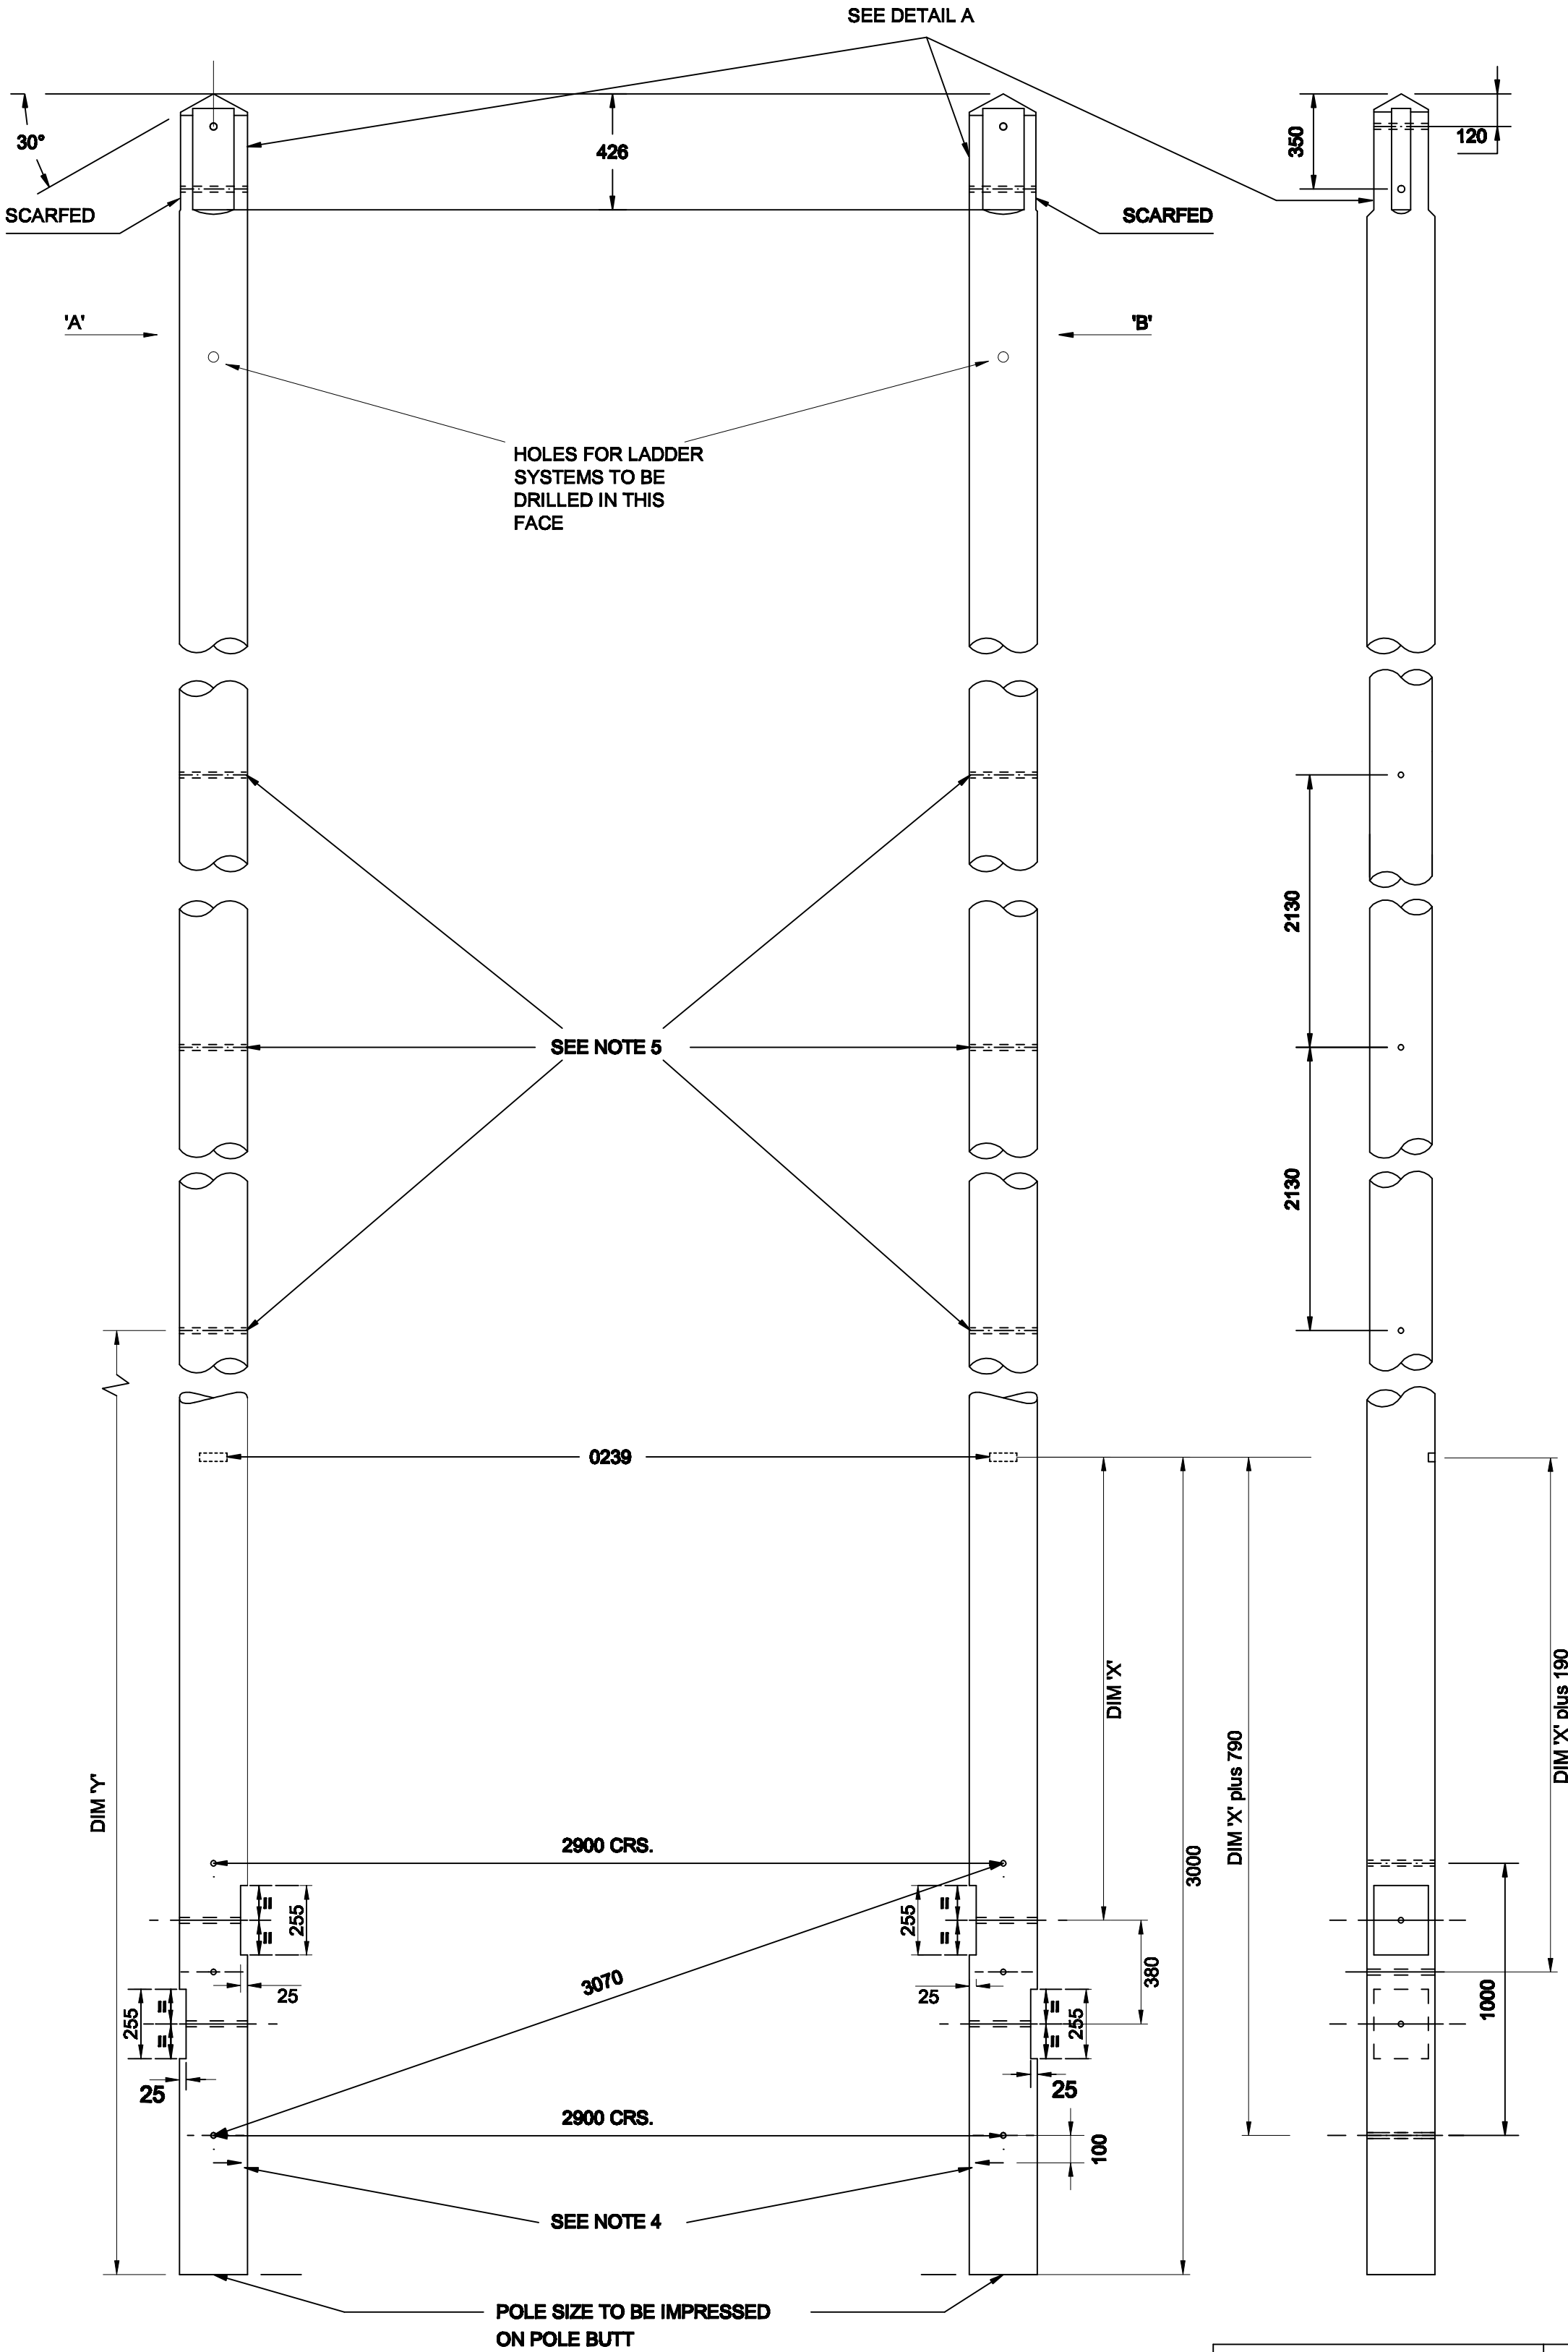

SIDE ELEVATION ON VIEW 'A' & 'B'

SCALE 1:5

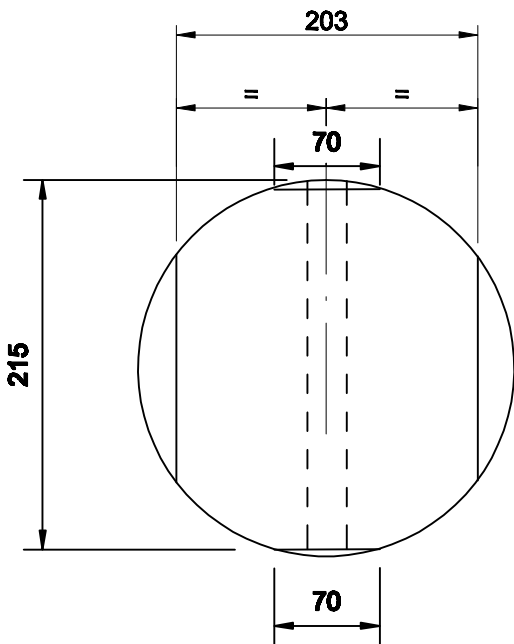

PLAN

DETAIL 'A'

SCALE 1:5

NOTES

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT – 250mm.
- HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE-LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
- POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
- 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
- 'H' POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG.No. 1.09.101.0129.

All dimensions shown are in millimetres unless stated otherwise

POLE LENGTH. (m)	DIM. 'X' (mm)	DIM. 'Y' (mm)
9.0 - 11 INCLUSIVE.	1900	-
12.0	1700	-
13 - 15 INCLUSIVE.	1400	-
16 - 18 INCLUSIVE.	1100	7955
20	500	

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR TERMINAL 'H' POLE STRUCTURE	
Manufacturer Details		Type	STANDARDS
Sheet No. 2	Scale 1:20	OVERHEAD	
Prepared By Barbara.Gordon		Ref No.	C949776
Revised 12/11/07	Grid Reference	Historic Drg.No.	1091390019
Date Issued 03/07/07	Checked By G. HAMMEL	Revision	C Notes