
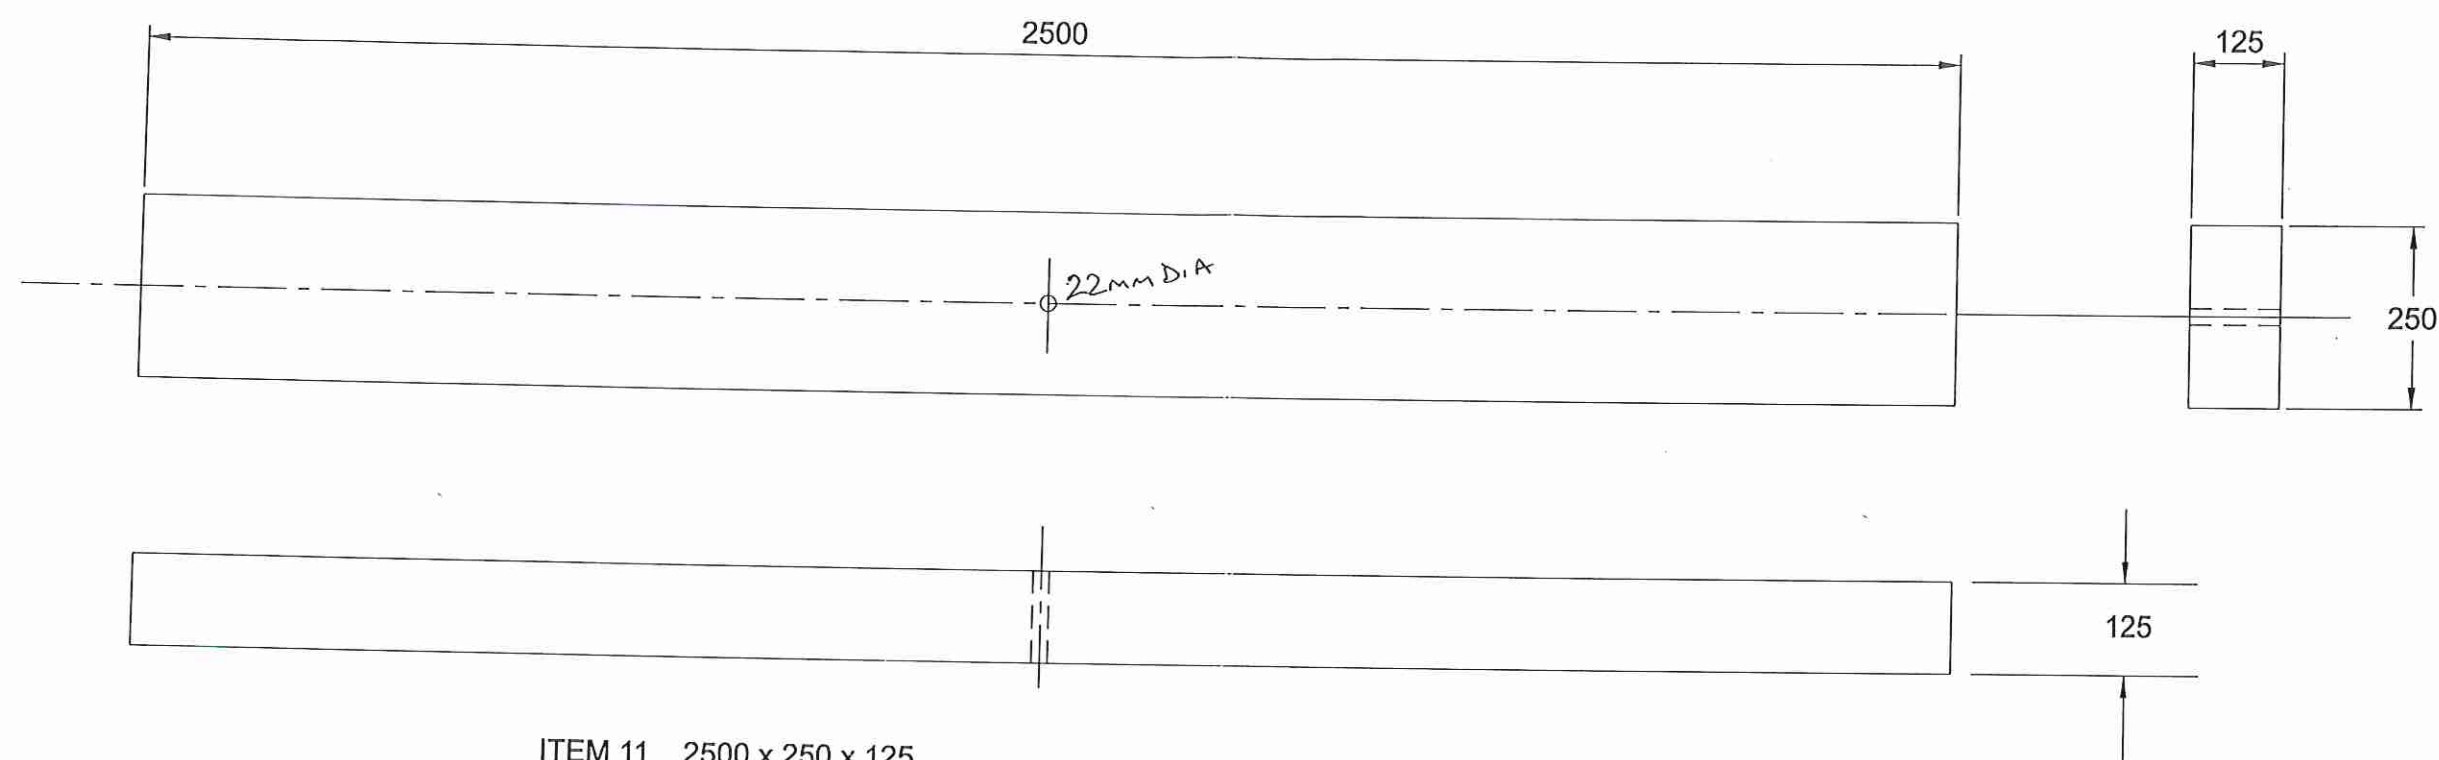


NOTES:-

1. TIMBER TO BE BALTIC REDWOOD, SCOTS PINE (PINUS SYLVESTRIS) OR FRENCH MARITIME PINE GENERALLY IN ACCORDANCE WITH BS 1990
2. BLOCKS TO BE CUT FROM SAWN TIMBER
3. THE LONGITUDINALLY CUT SURFACES OF BLOCKS SHALL BE STRAIGHT AND CLEAN CUT AND THE ANNULAR RINGS SHALL BE APPROX, PARALLEL TO THE WIDE FACE. PLANING IS NOT REQUIRED. WANE IS PERMISSABLE ON ONE FACE
4. BLOCKS SHALL BE TREATED AFTER FABRICATION WITH
 - A) CREOSOTE TO BS913 (RUEPING PROCESS)
 - OR
 - B) WATER-BORNE SALTS (TANALITH C) TO BS4072



Prepared by J.L.W.

Checked M.M. Date Issued AUG 99

Northern Electric Distribution Limited, Carlisle House, Newcastle Upon Tyne, NE1 6NE.

132kV SINGLE CIRCUITS OVERHEAD LINES
TOP FOUNDATION BAULK
ITEM 11

Drg.No.

1 09 101 0670

Mods.

1 09 101 0670

Sheet No. 11

Revised

Scale 1 : 10