



PLAN VIEW
WITH SOME DETAILS
REMOVED FOR CLARITY.

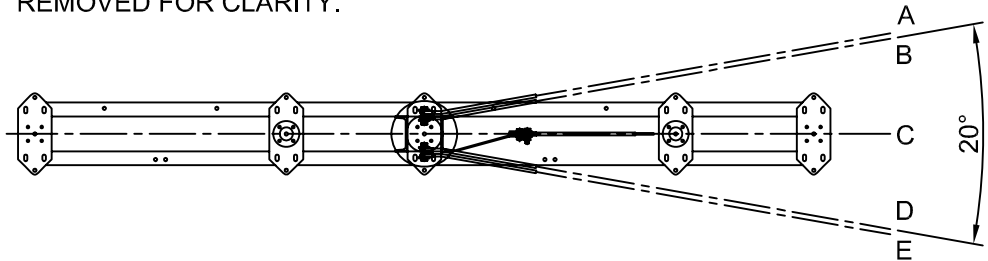

STAY CONFIGURATIONS (SEE 1 09 101 0675 SHEET No.24)

WHERE ONE STAY IS REQUIRED USE ARRANGEMENT 'C' ONLY.
WHERE TWO STAYS ARE REQUIRED USE ARRANGEMENT 'A' & 'E' ONLY.
WHEN THREE STAYS ARE REQUIRED USE ARRANGEMENT 'A', 'C' & 'E' ONLY.
WHERE FOUR STAYS ARE REQUIRED USE ARRANGEMENT 'A', 'B', 'D' & 'E' ONLY

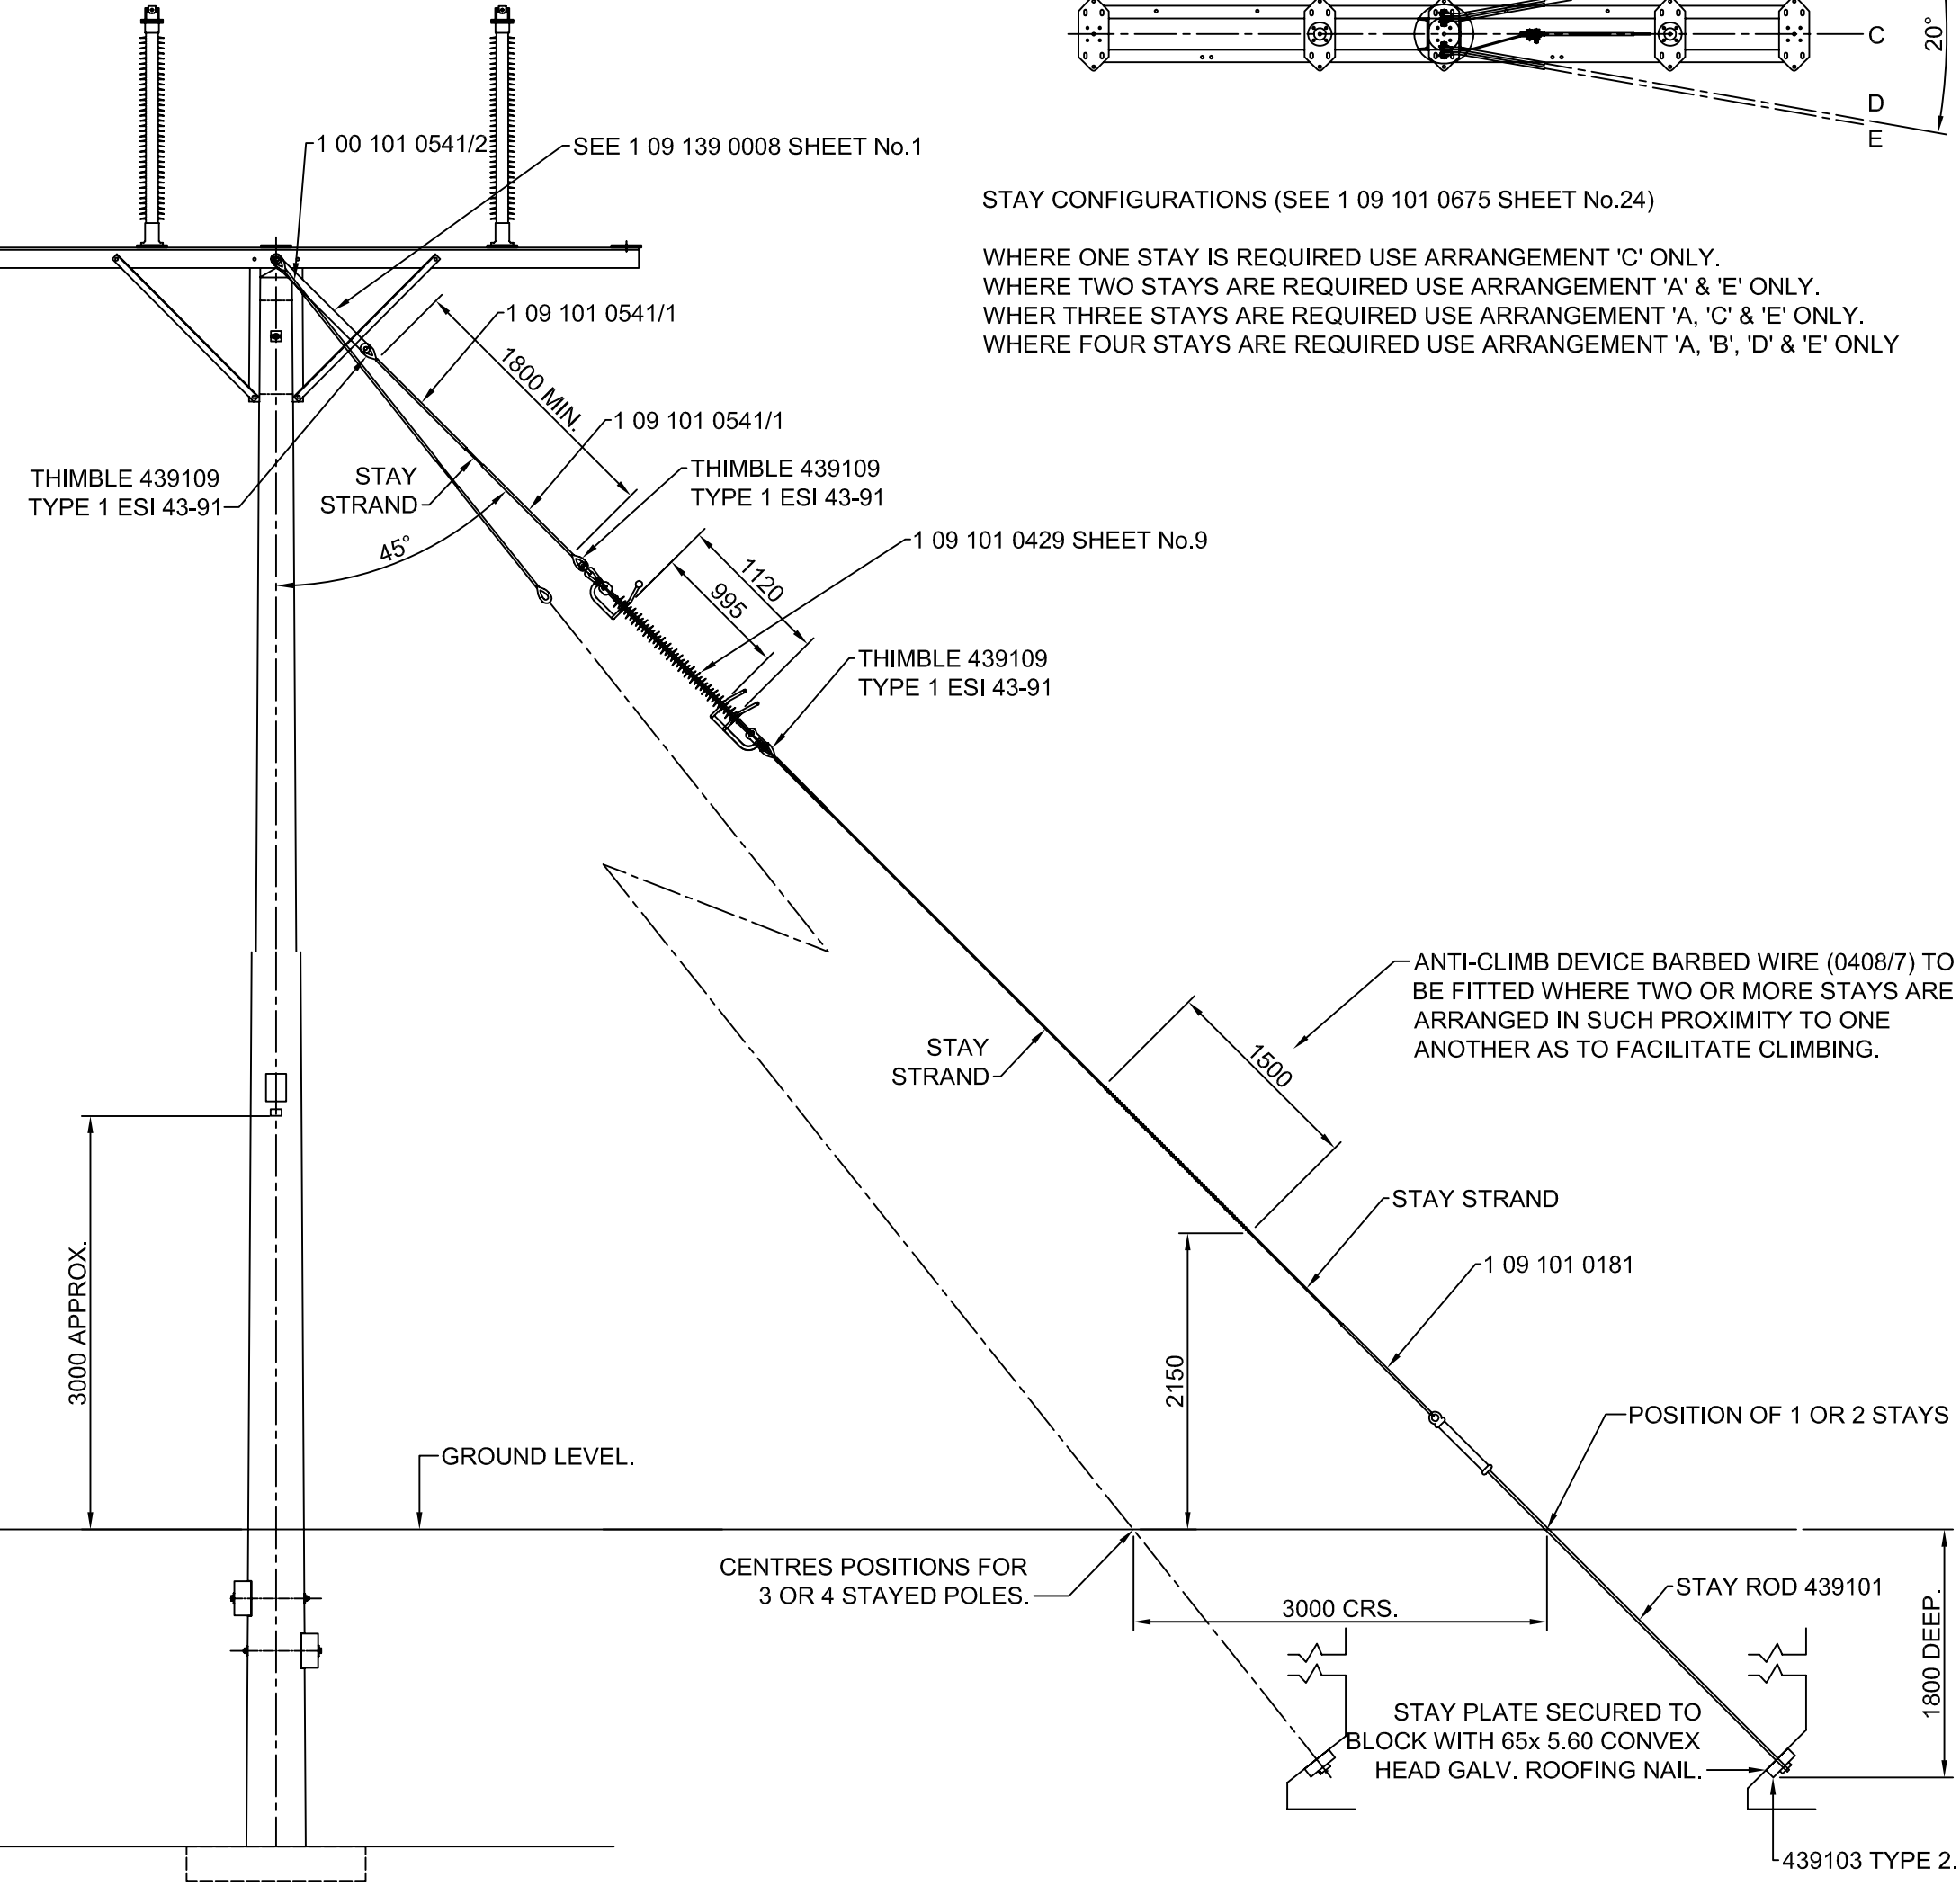

NOTE

1. FOR METHOD OF SETTING STAYS SEE DRAWING No. 1 09 101 0271 & 1 09 101 0273.
2. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. SERIES OF COMPONENTS;
OTHER ITEMS REFER TO 1 09 101..... SERIES.
3. STAY STRAND: 7/4.0 (GRADE 700) (7 x 8 S.W.G.) GALVANIZED STEEL STRAND.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132kV SINGLE CIRCUIT METHOD OF FIXING STAYS			
Sheet No. 8	Scale 1:50				
Prepared By TREVOR R. WILKIN		Type OVERHEAD		DOCUMENT_SUB_CLASS	
Revised	Grid Reference	Ref No.	62470B	Historic Drg.No.	1 09 101 0429
Date Issued 28/04/2006	Checked By	Revision Notes			