


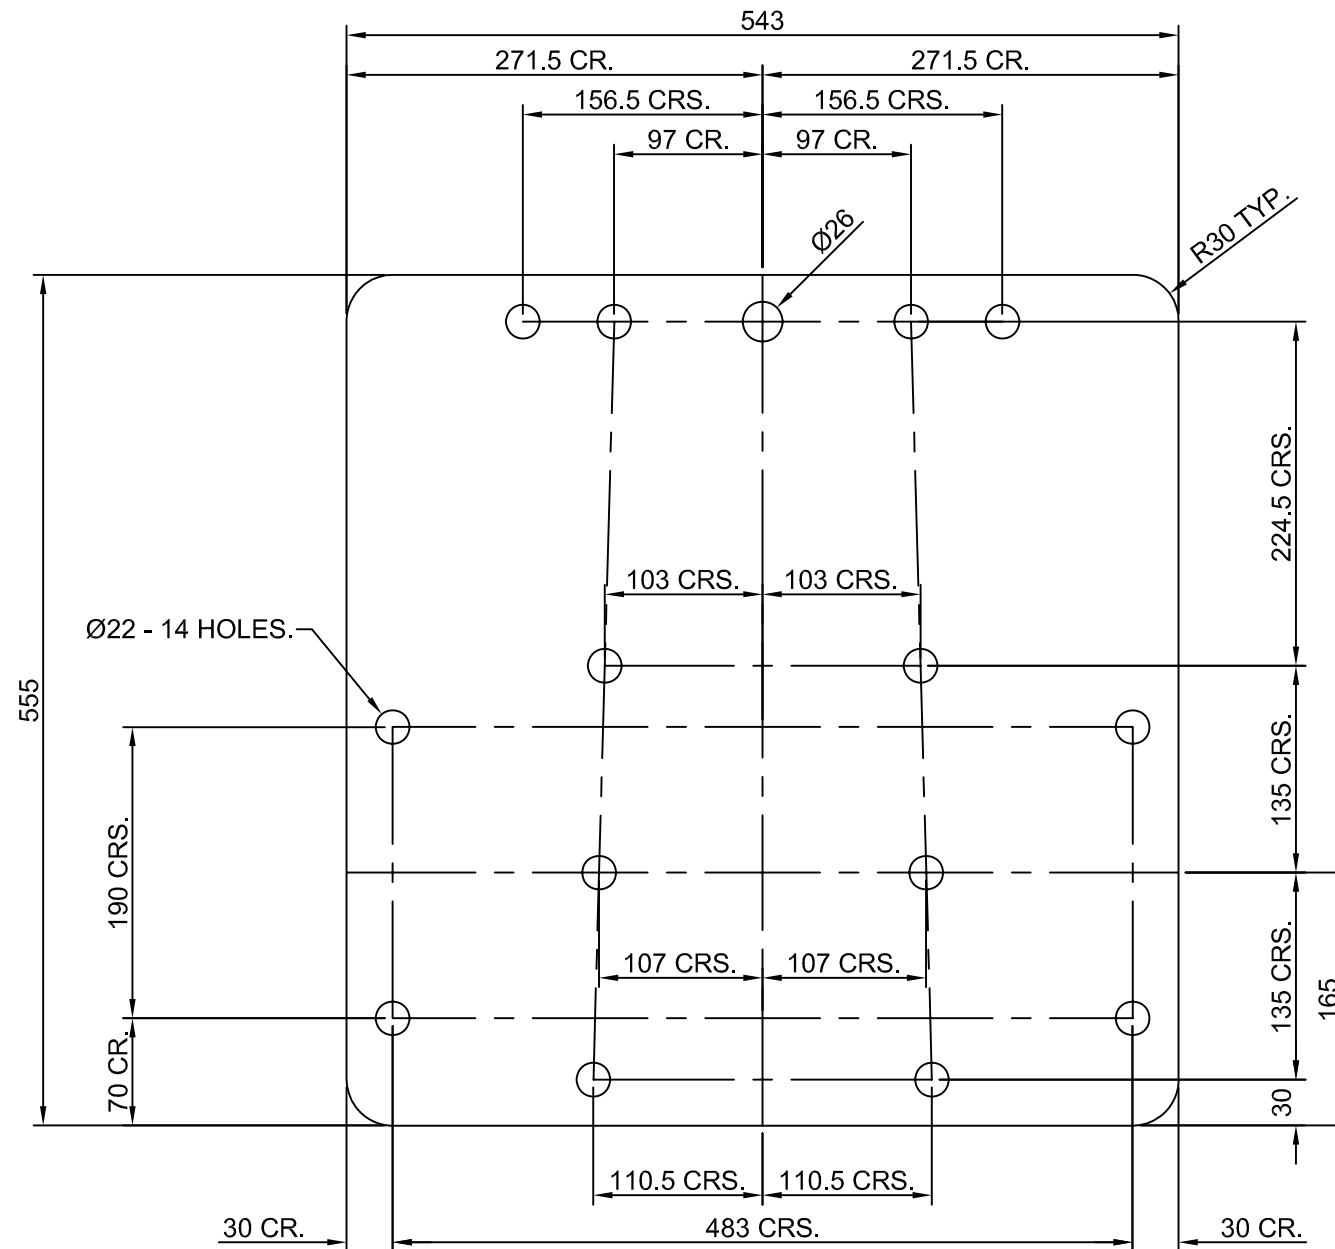

MATERIAL:- 555 LONG x 543 WIDE x 10 PLATE M.S.

- NOTES:-
1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
 2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
 3. ALL BURRS TO BE REMOVED.
 4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132kV OVERHEAD LINES SHORT CROSSARM FOR 'A' FRAME TYPE POLES HORIZONTAL POST INSULATOR CHEEK PLATE	
Manufacturer Details			
Sheet No. 18	Scale 1:2		
Prepared By TREVOR R. WILKIN		Type OVERHEAD	DOCUMENT_SUB_CLASS
Revised	Grid Reference	Ref No. 62470B	Historic Drg.No. 1 09 101 0675
Date Issued 13/04/2006	Checked By	Revision	Notes