


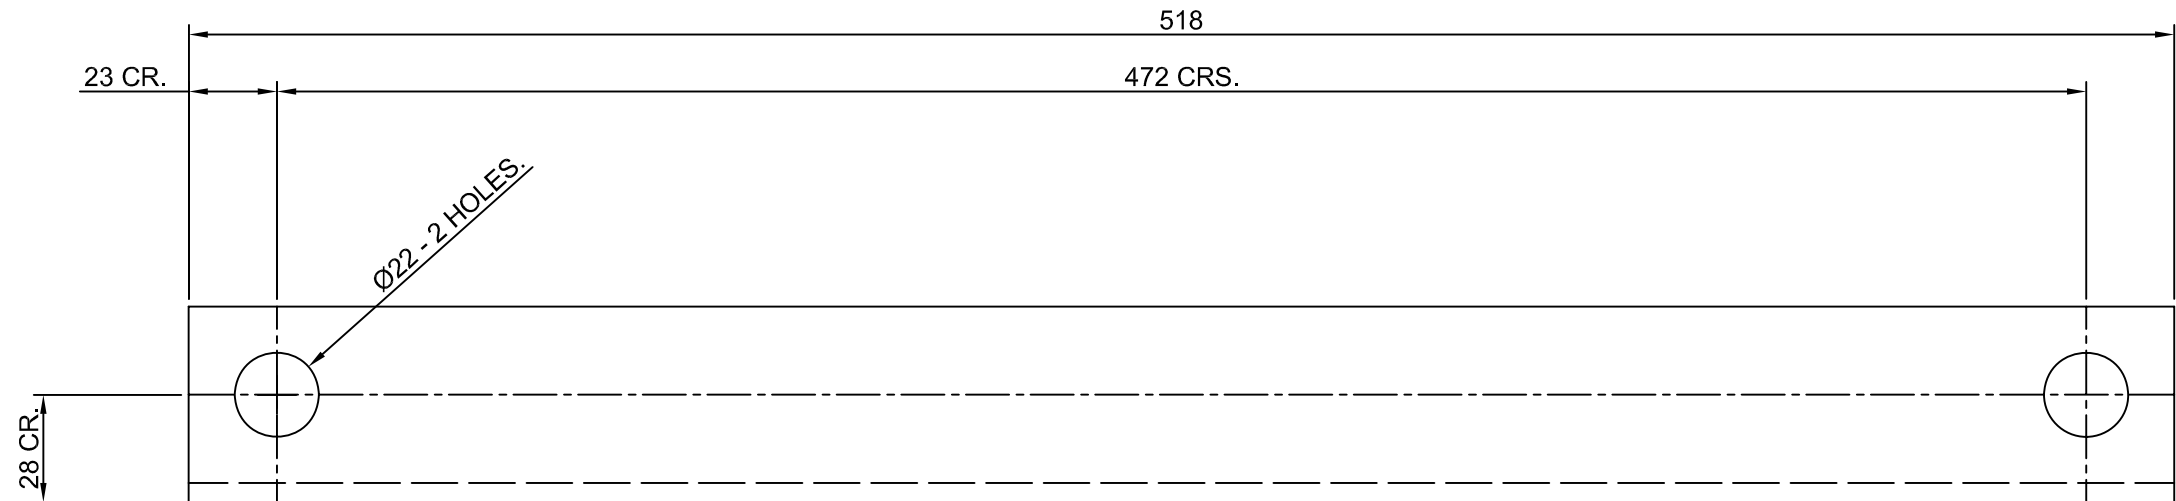

ITEM 4. 518 LONG x 50 x 50 x 5 EQUAL ANGLE.

NOTES:-
1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
3. ALL BURRS TO BE REMOVED.
4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132kV OVERHEAD LINES CROSSARM BRACE ITEM No.4			
Sheet No. 4	Scale 1:2				
Prepared By TREVOR R. WILKIN		Type OVERHEAD	DOCUMENT_SUB_CLASS		
Revised	Grid Reference	Ref No.	62470B	Historic Drg.No.	1 09 101 0675
Date Issued 08/02/2006	Checked By	Revision	Notes		