


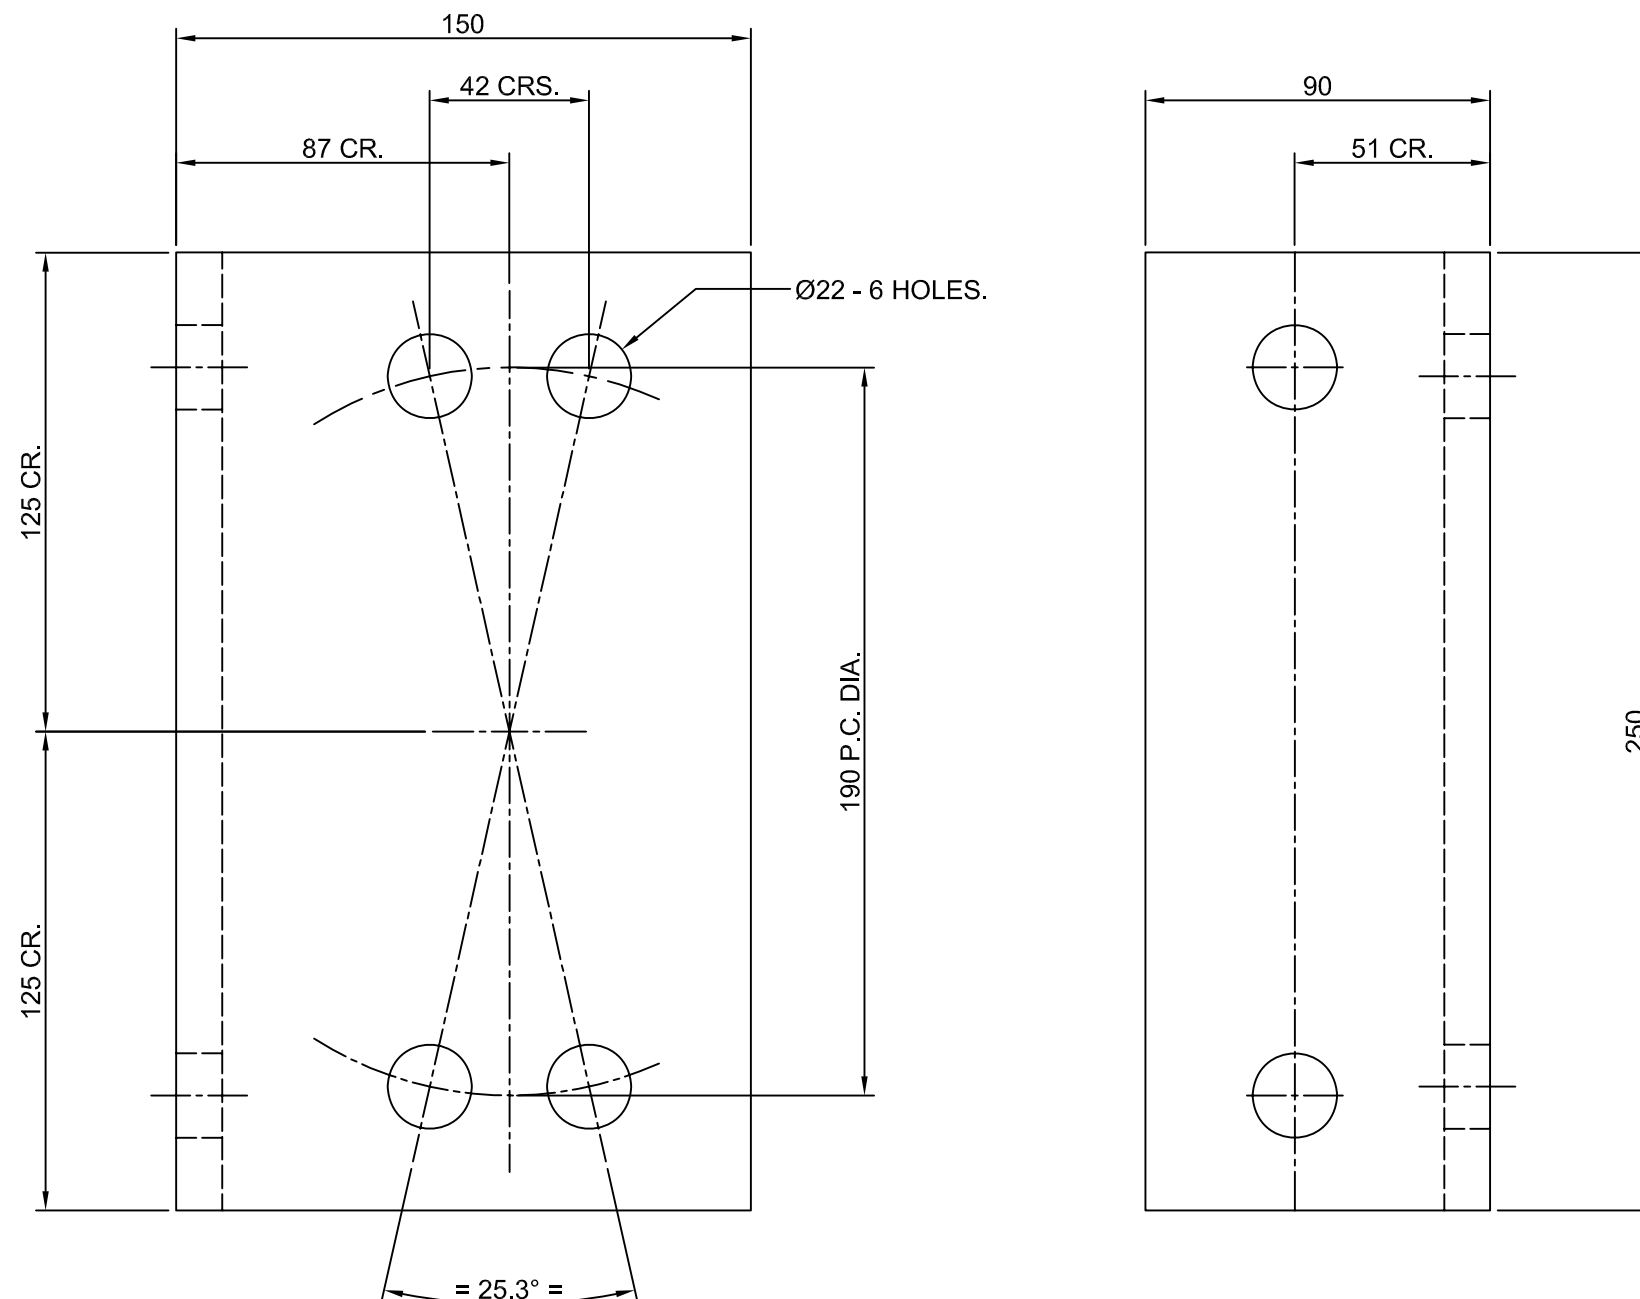

ITEM 9. 250 LONG x 150 x 90 x 12 THICK M.S. UNEQUAL ANGLE B.S. 4848: PART 4: 1972

NOTES:-

1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
3. ALL BURRS TO BE REMOVED.
4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132kV OVERHEAD LINES 125kN TENSION INSULATOR SET INSULATOR SUPPORT PLATE BRACKET FOR IN-LINE POLES ITEM No.9	
Manufacturer Details			
Sheet No. 9	Scale 1:2		
Prepared By TREVOR R. WILKIN		Type OVERHEAD	DOCUMENT_SUB_CLASS
Revised	Grid Reference	Ref No. 62470B	Historic Drg.No. 1 09 101 0675
Date Issued 17/3/2006	Checked By	Revision	Notes