



NOTES:-

- FOR STRAIGHT LINE POLES WHERE SPECIFIED FIT FAILURE CONTAINMENT DEVICE SHOWN IN INSET
- FIT 2 No M20 POLE BOLTS EACH WITH 2 WASHERS 439605 AT POLE TOP
- ALL GALVANISED BOLTS TO BE M20 DIA EACH WITH NUT TO B.S.4190
- INSULATOR PIN TO BE 10kN AS SPECIFIED IN O.H.L.5.
- INSULATOR PINS AT OUTER POSITIONS TO BE 230 LONG AND AT CENTRE POSITION 305mm LONG. EXCEPT AT 33kV WHERE THEY SHALL ALL BE 305mm
- THE DEFAULT POLE FOUNDATION SHALL BE AUGURED WITHOUT WOOD BLOCKS, HOWEVER BLOCKS HAVE BEEN SHOWN FOR WHERE THIS FOUNDATION TYPE IS NOT PRACTICAL
- DETAIL DRGS PREFIXED 43..... REER TO E.S.I. BASED DRGS. OTHER DRG Nos REFER TO 1.09.101. SERIES

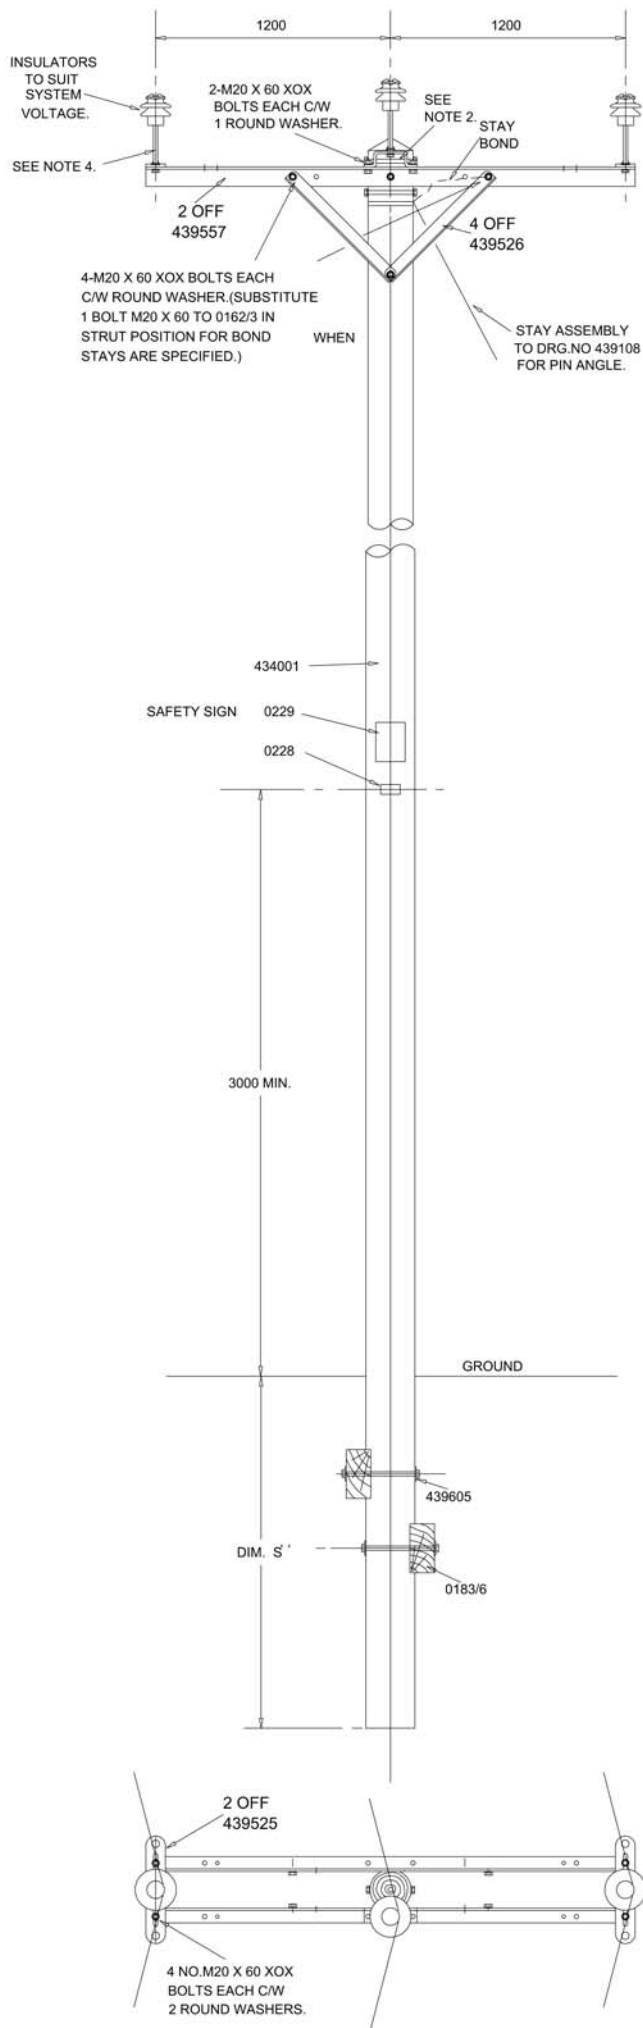

POLE	DIM 'S' (m)		
LENGTH	AUGURED FOUNDATION 'm'	AUGURED FOUNDATION 'S AND E'S'	STD. BLOCKED FOUNDATIONS
9.0 - 11.5 INCL.	2.1	2.4	1.9
12.0 - 14.0 INCL.	2.4	2.6	2.1
14.0 - 18.0 INCL.	2.4	2.8	2.4
19.0 - 24.0 INCL.	NOT ALLOWED	NOT ALLOWED	3.0

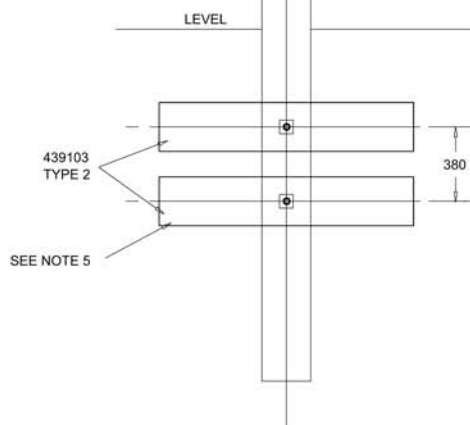

Manufacturer Details

Sheet No. 1 Scale 1:20

Prepared By Joan Oakley

Revised 21/05/10 Grid Reference

Date Issued 20/05/05 Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

HV OVERHEAD LINES (11KV, 20KV & 33KV SYSTEMS)
STRAIGHT LINE OR PIN ANGLE POLE
(DOUBLE MEMBER CROSSARM) THREE PHASE

Type ESI

Ref No. C147657

Revision K Notes

Historic Drg. No. 1000434004

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

THIS DRAWING ALSO REFERRED TO IN WORK SPEC. REF. NO. 04/181