

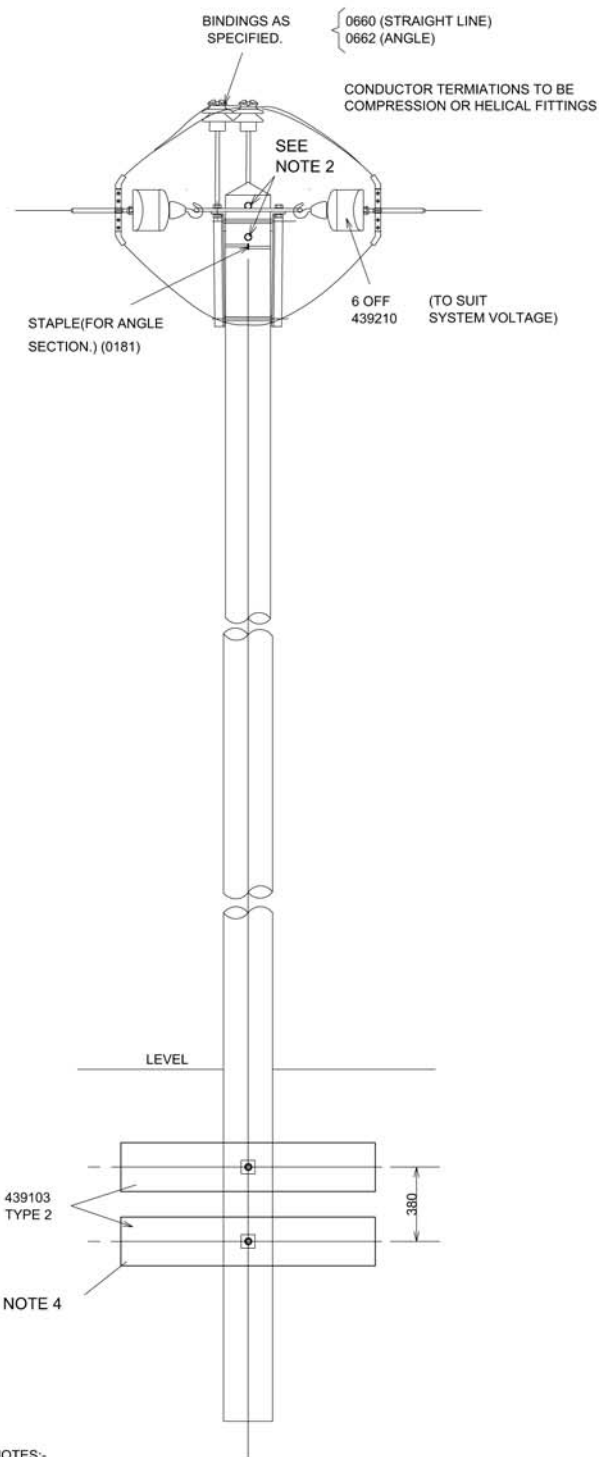


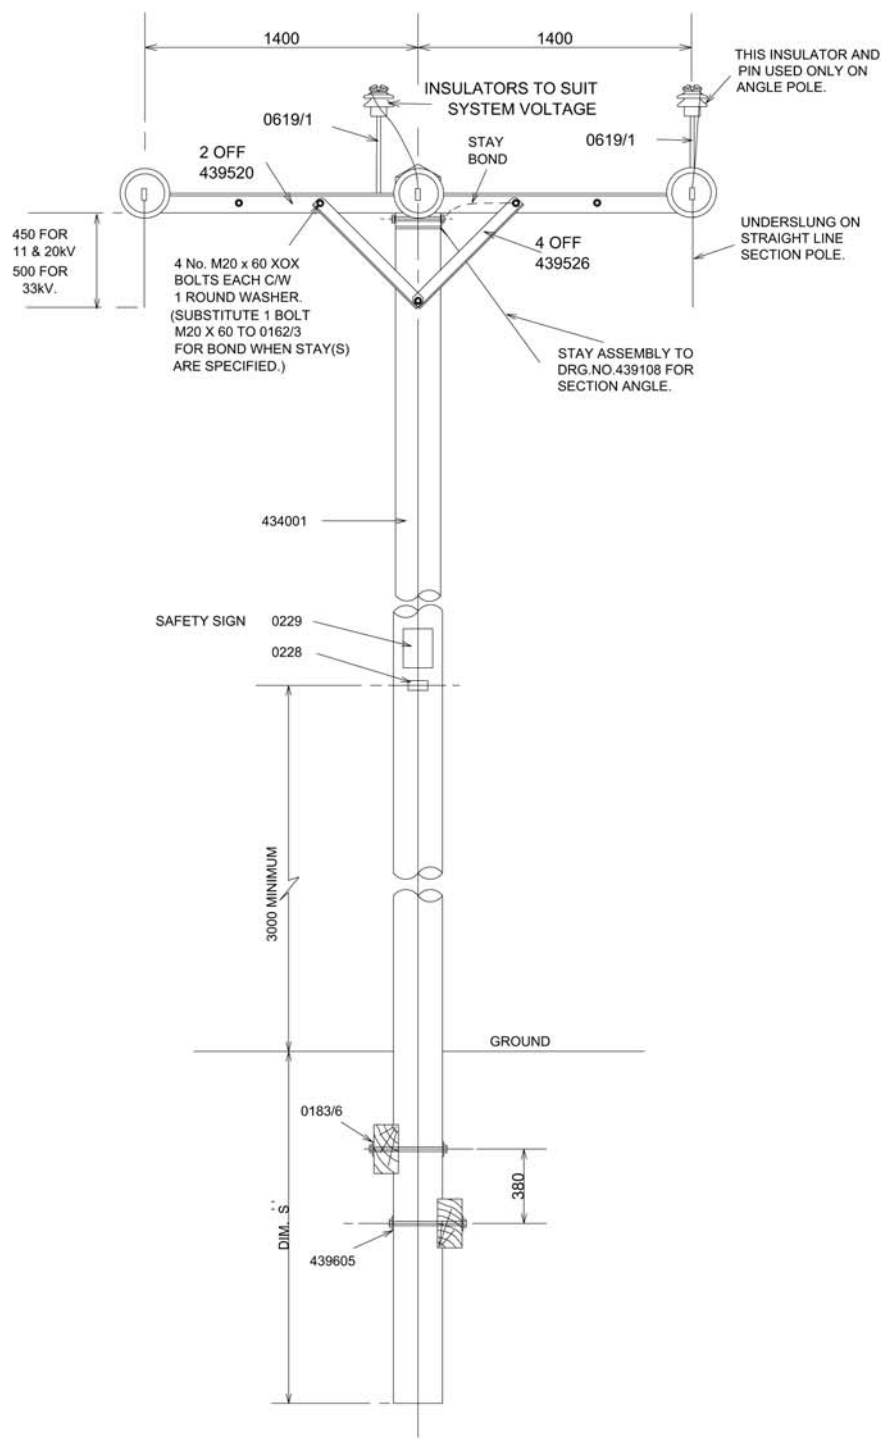

NOTES:-

- FOR STRAIGHT LINE POLES WHERE SPECIFIED FIT FAILURE CONTAINMENT DEVICE SHOWN IN INSET
- FIT 2 No M20 POLE BOLTS EACH WITH 2 WASHERS 439605 AT POLE TOP
- ALL GALVANISED BOLTS TO BE M20 DIA EACH WITH NUT TO B.S.4190
- INSULATOR PIN TO BE 10kN AS SPECIFIED IN O.H.L.5.
- INSULATOR PINS AT OUTER POSITIONS TO BE 230 LONG AND AT CENTRE POSITION 305mm LONG. EXCEPT AT 33kV WHERE THEY SHALL ALL BE 305mm
- THE DEFAULT POLE FOUNDATION SHALL BE AUGURED WITHOUT WOOD BLOCKS, HOWEVER BLOCKS HAVE BEEN SHOWN FOR WHERE THIS FOUNDATION TYPE IS NOT PRACTICAL
- DETAIL DRGS PREFIXED 43..... REER TO E.S.I. BASED DRGS. OTHER DRG Nos REFER TO 1.09.101. SERIES

POLE	DIM 'S' (m)		
LENGTH	AUGURED FOUNDATION 'm'	AUGURED FOUNDATION 'S AND E/S'	STD. BLOCKED FOUNDATIONS
9.0 - 11.5 INCL.	2.1	2.4	1.9
12.0 - 14.0 INCL.	2.4	2.6	2.1
14.0 - 18.0 INCL.	2.4	2.8	2.4
19.0 - 24.0 INCL.	NOT ALLOWED	NOT ALLOWED	3.0

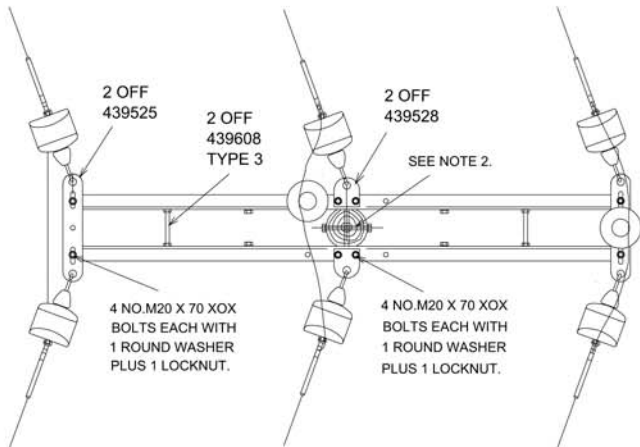

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
THIS DRAWING ALSO REFERRED TO IN WORK SPEC. REF. NO. 04/182.

CE Electric UK

Manufacturer Details

Sheet No. 1

Scale 1:20

Prepared By Joan Oakley

Type ESI

Revised 21/05/10

Grid Reference

Date Issued 20/05/05

Checked By G HAMMEL

Ref No. C147660

Historic Drg. No.

1000434005

Revision K

Notes

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

HV OVERHEAD LINES (11KV 20KV & 33KV SYSTEMS)
SINGLE POLE STRAIGHT LINE SECTION OR SECTION ANGLE