
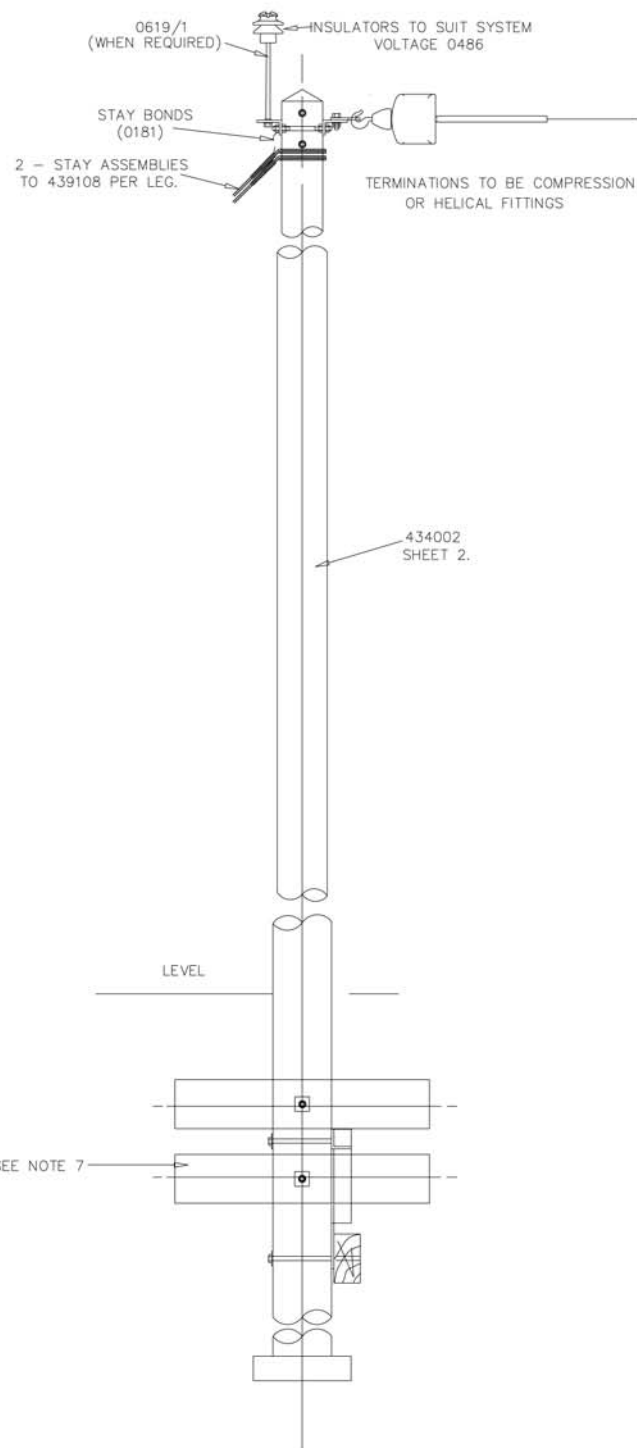
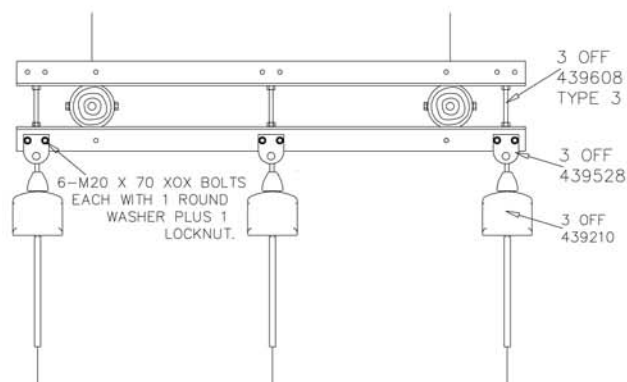


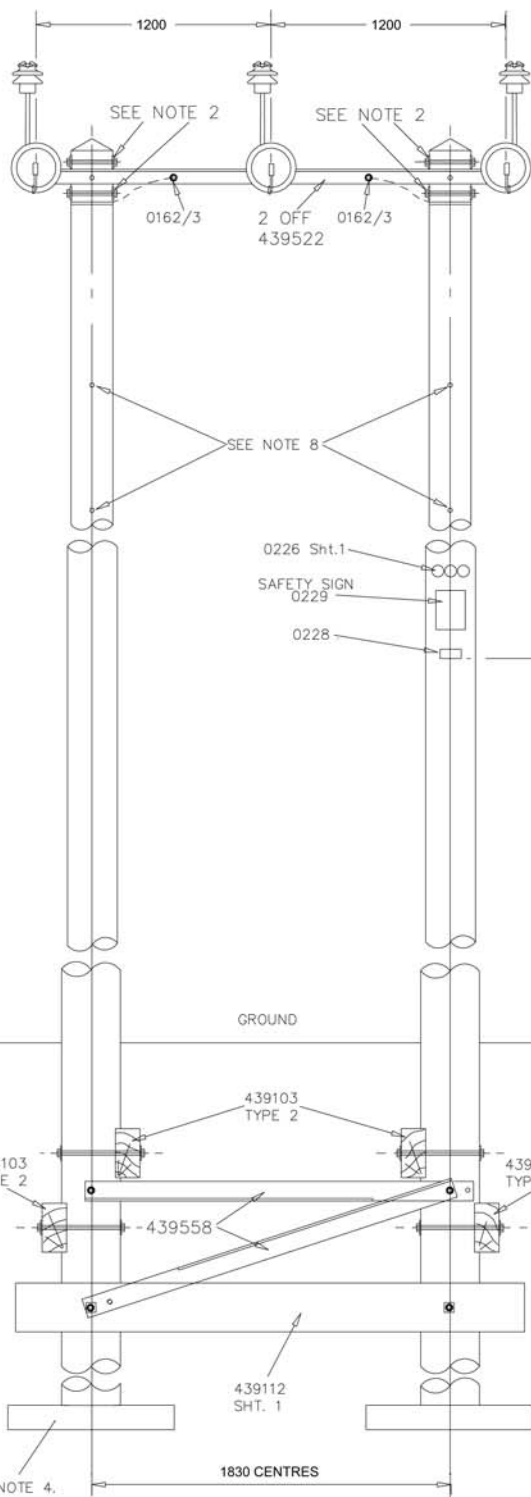

POLE LENGTH (m)	DIM. 'S' (m)
9.0 - 11.5 INCLUSIVE	1.9
12.0 - 14.0 INCLUSIVE	2.1
15.0 - 18.0 INCLUSIVE	2.4
19.0 - 24.0	3.0

NOTES

1. STANDARD POLE HEIGHT - 11.0m.
2. ALL GALVANISED BOLTS TO BE M20 DIA. EACH WITH NUT TO B.S.4190.
3. FIT 2 M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP.
4. 439103 TYPE 2 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE GROUND CONDITIONS EXIST.
5. WHERE A SINGLE PHASE LINE IS REQUIRED, THE STANDARD OF CONSTRUCTION TO BE APPROPRIATE TO THREE PHASE OPERATION, THE CENTRE CONDUCTOR BEING OMITTED.
6. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS; OTHER DRAWINGS REFER TO 1.09.101..... SERIES.
7. THE LOWER BLOCKS MAY BE OMITTED WHERE GOOD GROUND CONDITIONS EXIST.
8. ALL UNUSED POLE BOLT HOLES TO BE PLUGGED.

THIS DRAWING REFERRED TO IN WORK SPECIFICATION No. 04/188.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		HV OVERHEAD LINES (11, 20 AND 33KV SYSTEMS) 'H' TERMINAL POLE	
Sheet No. 1	Scale 1:20	Type ESI	ESI
Prepared By Jonis Webb	Grid Reference	Ref No. C316685	Historic Drg. No. 1000434011
Revised 25/04/06	Checked By M. WILSON	Revision 1	Notes