


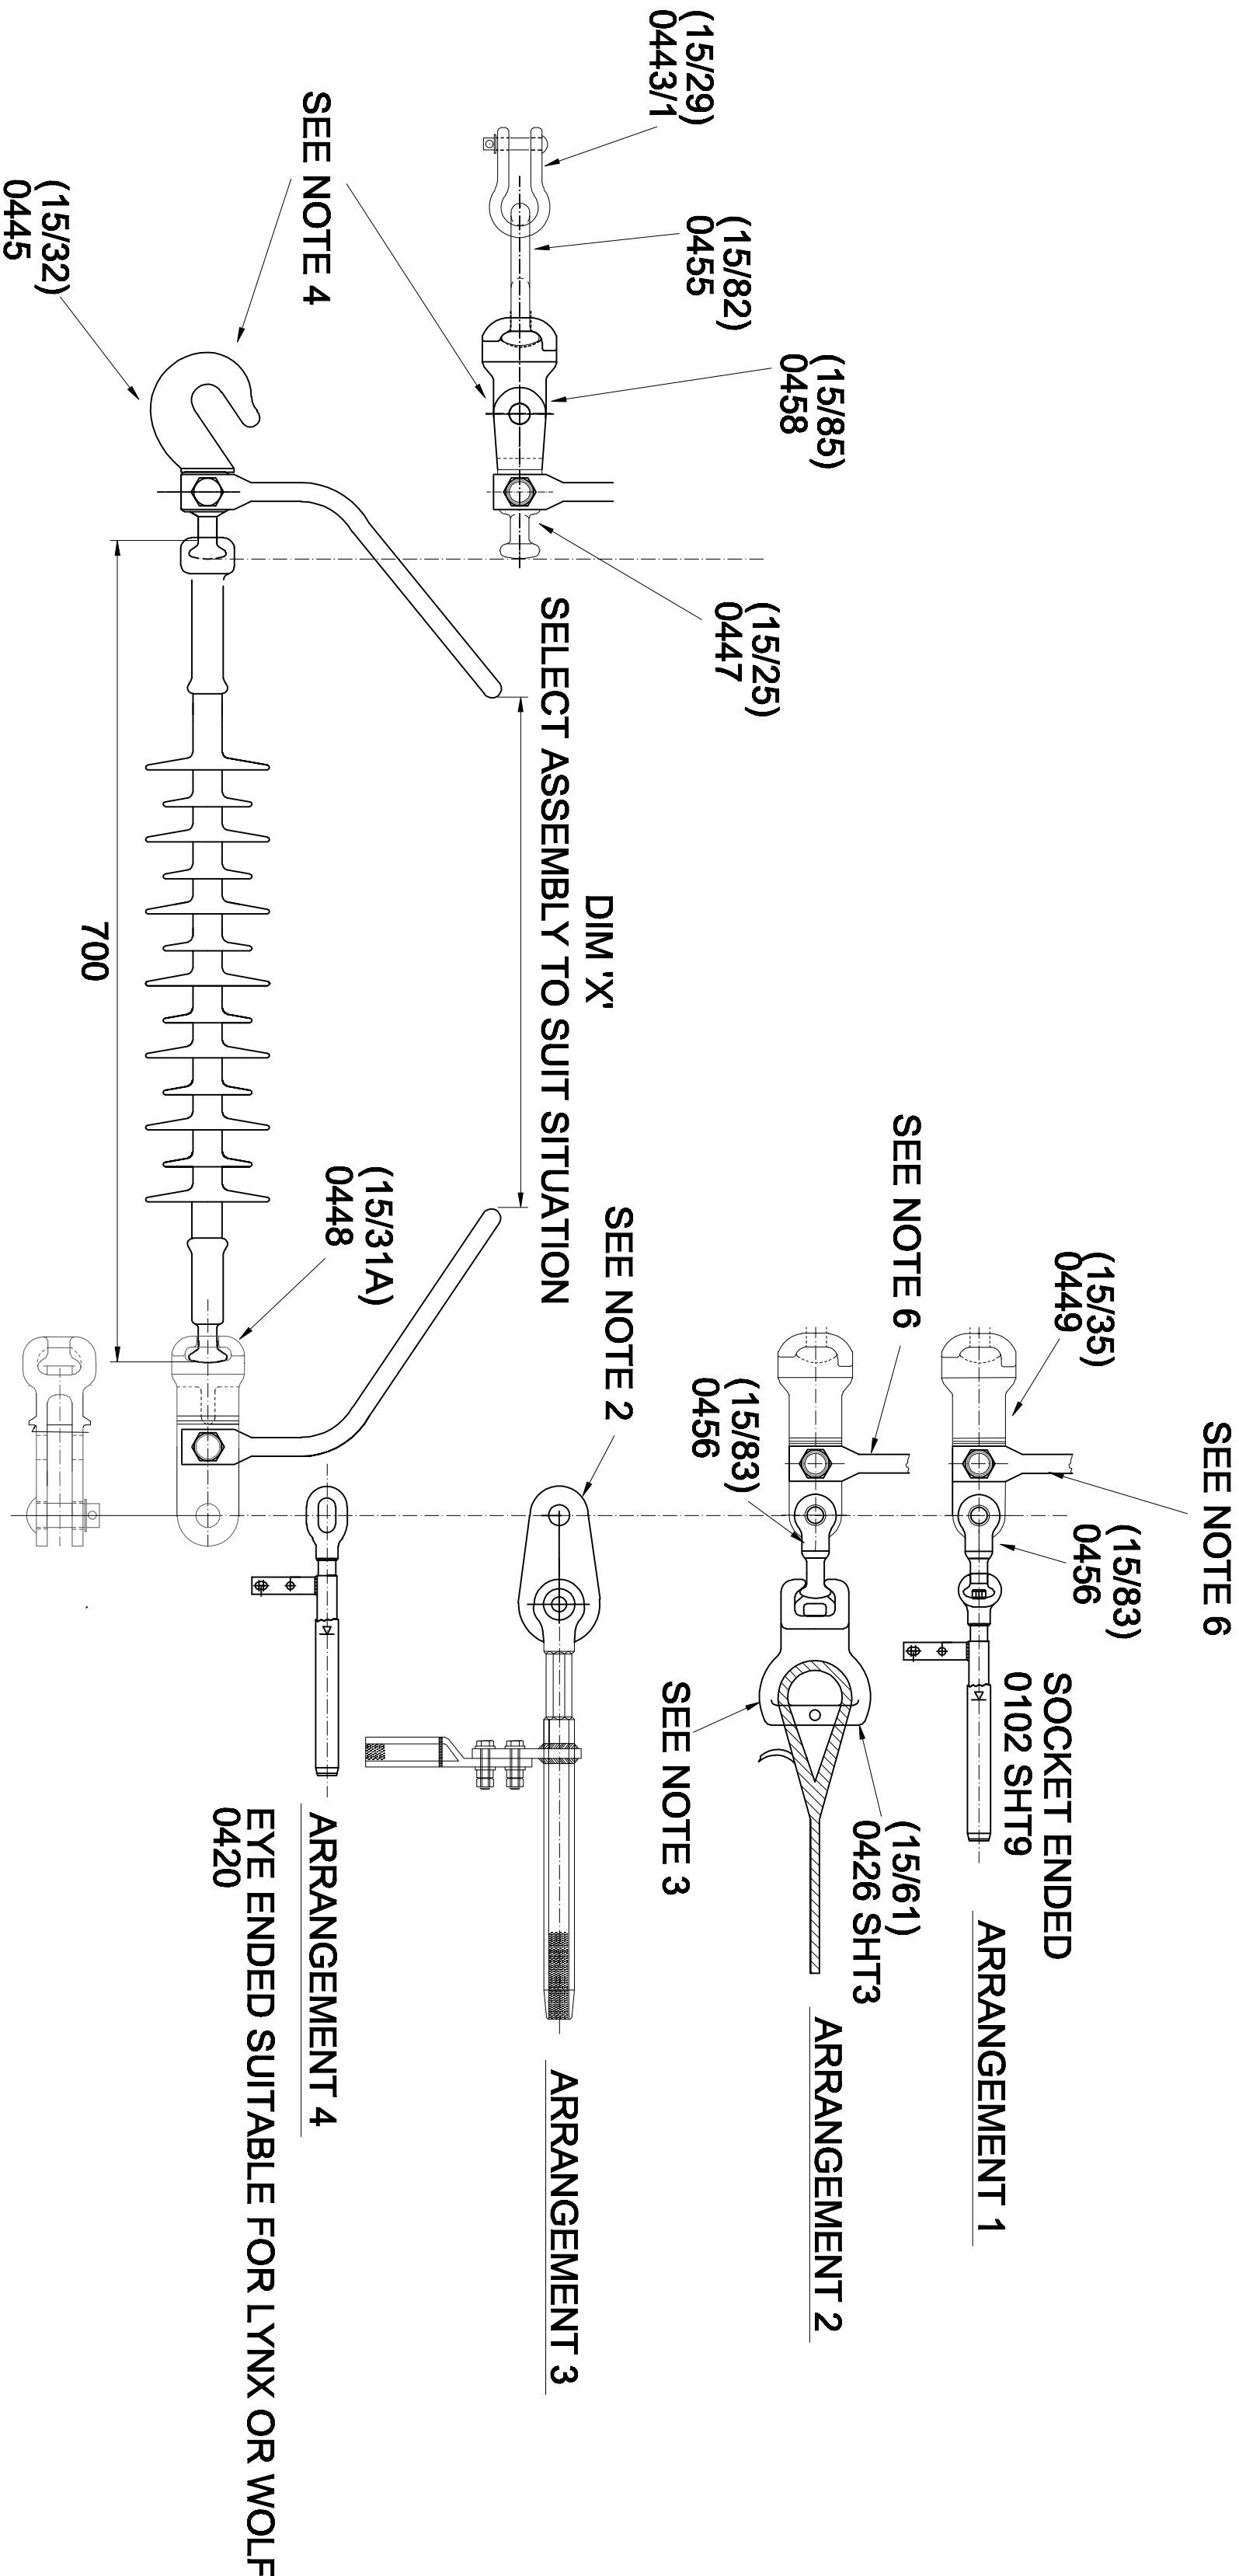

NOTES:-

1. ITEM Nos REFER TO 1 09 1 1 DRAWING SERIES FOR COMPONENTS.
2. USE CLAMP ADAPTOR FOR CLEVIS ENDED CLAMP
(eg. ALCANGRIP PATTERN 450 FOR 150mm sq (37/2.59) ASCR
175mm sq (37/2.79) ASCR)

NOT REQUIRED FOR TONGUE OR EYE ENDED ANCHOR CLAMPS
eg. CCL HEXPRESS DESIGN.

3. LARGE RADIUS SOCKET THIMBLES SHALL BE USED ON
AAAC CONDUCTORS 100mm & ABOVE
HDBC CONDUCTORS 70mm AND ABOVE.

4. THESE FITTINGS WILL BE REPLACED WITH HOOK TO REF15/32
ON THE FOLLOWING WOOD POLE STRUCTURES
1 09 123 1191
1 09 123 1192
1 09 123 1193

5. STANDARD INSULATOR ASSEMBLY COMPRISES 70KN
BALL/SOCKET

- INSULATOR C/W SOCKET CLEVIS AND BALL ENDED HOOK WHEN
ARRANGEMENTS 1 AND 2 ARE USED
6. REPLACE STANDARD SOCKET CLEVIS FITTING (0448) WITH A
SOCKET

- TONGUE FITTING (0449) RE-USING THE ARCING HORN PROVIDED
WITH THE ASSEMBLY.

VOLTAGE	DIM 'X'	DESCRIPTION	CAT. No.
66KV	440mm	APPROACH/EARTHED	251559
66KV	540mm	NORMAL/UNEARTHED	251560
33KV	NOT APP.	ALL SITUATIONS	216150

ALL DIMENSIONS ARE SHOWN IN MILLIMETERES UNLESS OTHERWISE STATED

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		66KV SINGLE CIRCUIT OVERHEAD LINES TENSION INSULATOR SETS M.F.L. 70KN COMPOSITE INSULATOR ASSEMBLY			
Sheet No. 8	Scale 1:5	Type OVERHEAD			
Prepared By Joan Oakley	Grid Reference		STANDARDS		
Revised 23/08/10	Ref No. C990199		Historic Drg.No.		1091010488
Date Issued 18/08/10	Checked By G HAMMEL		Revision Notes		