


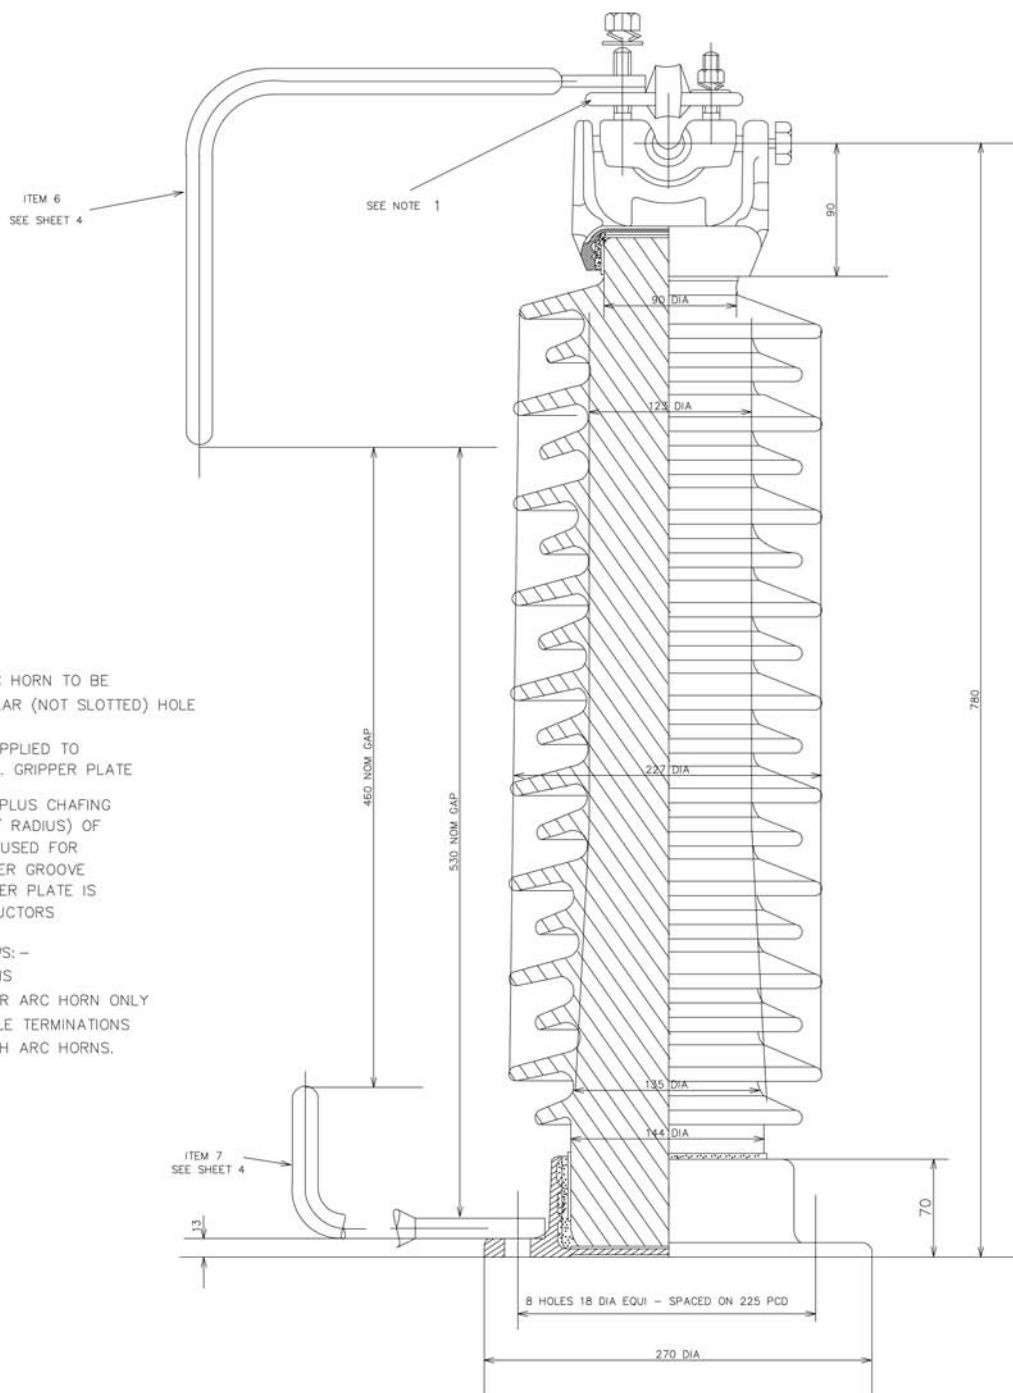

NOTES

- GRIPPER TO BE FITTED TO ALLOW ARC HORN TO BE FITTED TO 'U' BOLT THROUGH CIRCULAR (NOT SLOTTED) HOLE
- APPROPRIATE CHAFING TAPE TO BE APPLIED TO CONDUCTOR OVER LENGTH OF CLAMP. GRIPPER PLATE IS REVERSIBLE TO SUIT CONDUCTOR (PLUS CHAFING TAPE) DIAMETER. THE SMALLER (1/4" RADIUS) OF THE CONDUCTOR GROOVES IS TO BE USED FOR 0.1 IN / 70mm H.D. Cu; THE LARGER GROOVE FORMED BY REVERSAL OF THE GRIPPER PLATE IS TO BE USED FOR OTHER 66KV CONDUCTORS.
- ARC HORNS TO BE FITTED AS FOLLOWS:-
AT UNEARTHED POLES NO ARC HORNS
AT NORMAL EARTHED POLE FIT UPPER ARC HORN ONLY
AT SPECIAL EARTHED POLES ie. CABLE TERMINATIONS AND ADJACENT STRUCTURES FIT BOTH ARC HORNS.
- COLOUR - MUNSELL GREY

ITEM 4

INSULATOR VALUES		TEST VALUES	5 DISC SUSPENSION INSULATOR SET APPROX. EQUIVALENTS
ULTIMATE CANTILEVER LOAD	KN	12.5 kN (1275kg)	
SAFE WORKING LOAD	Kg	425kg (936 lbf)	
WEIGHT OF INSULATOR	Kg	39	
TOTAL CREEPAGE DISTANCE	mm	1850	1493
POWER FREQUENCY DRY FLASHOVER	KV	230	285
POWER FREQUENCY WET FLASHOVER	KV	215	230
POWER FREQUENCY WET TEST 1 MIN	KV	195	205
IMPULSE FLASHOVER POSITIVE	KV	400	465
IMPULSE FLASHOVER NEGATIVE	KV	580	440
IMPULSE WITHSTAND	KV	390	400

TAKEN FROM ALLIED INSULATOR DRG.No.FB2407 MOD.1 - 24.8.81

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

		NEDL, Manor House, Station Road, Houghton le Spring, DH4 7LA. 66kV NORMAL LINE POST INSULATOR EQUIPPED WITH FLANGE MOUNTING AND CLAMP TOP	
Prepared by CM Checked GTW Date Issued NOV 80	Drg No. 1 09 101 0589 Mod. G H	Sheet No. 2 Revised 12.12.95 Scale NTS	