


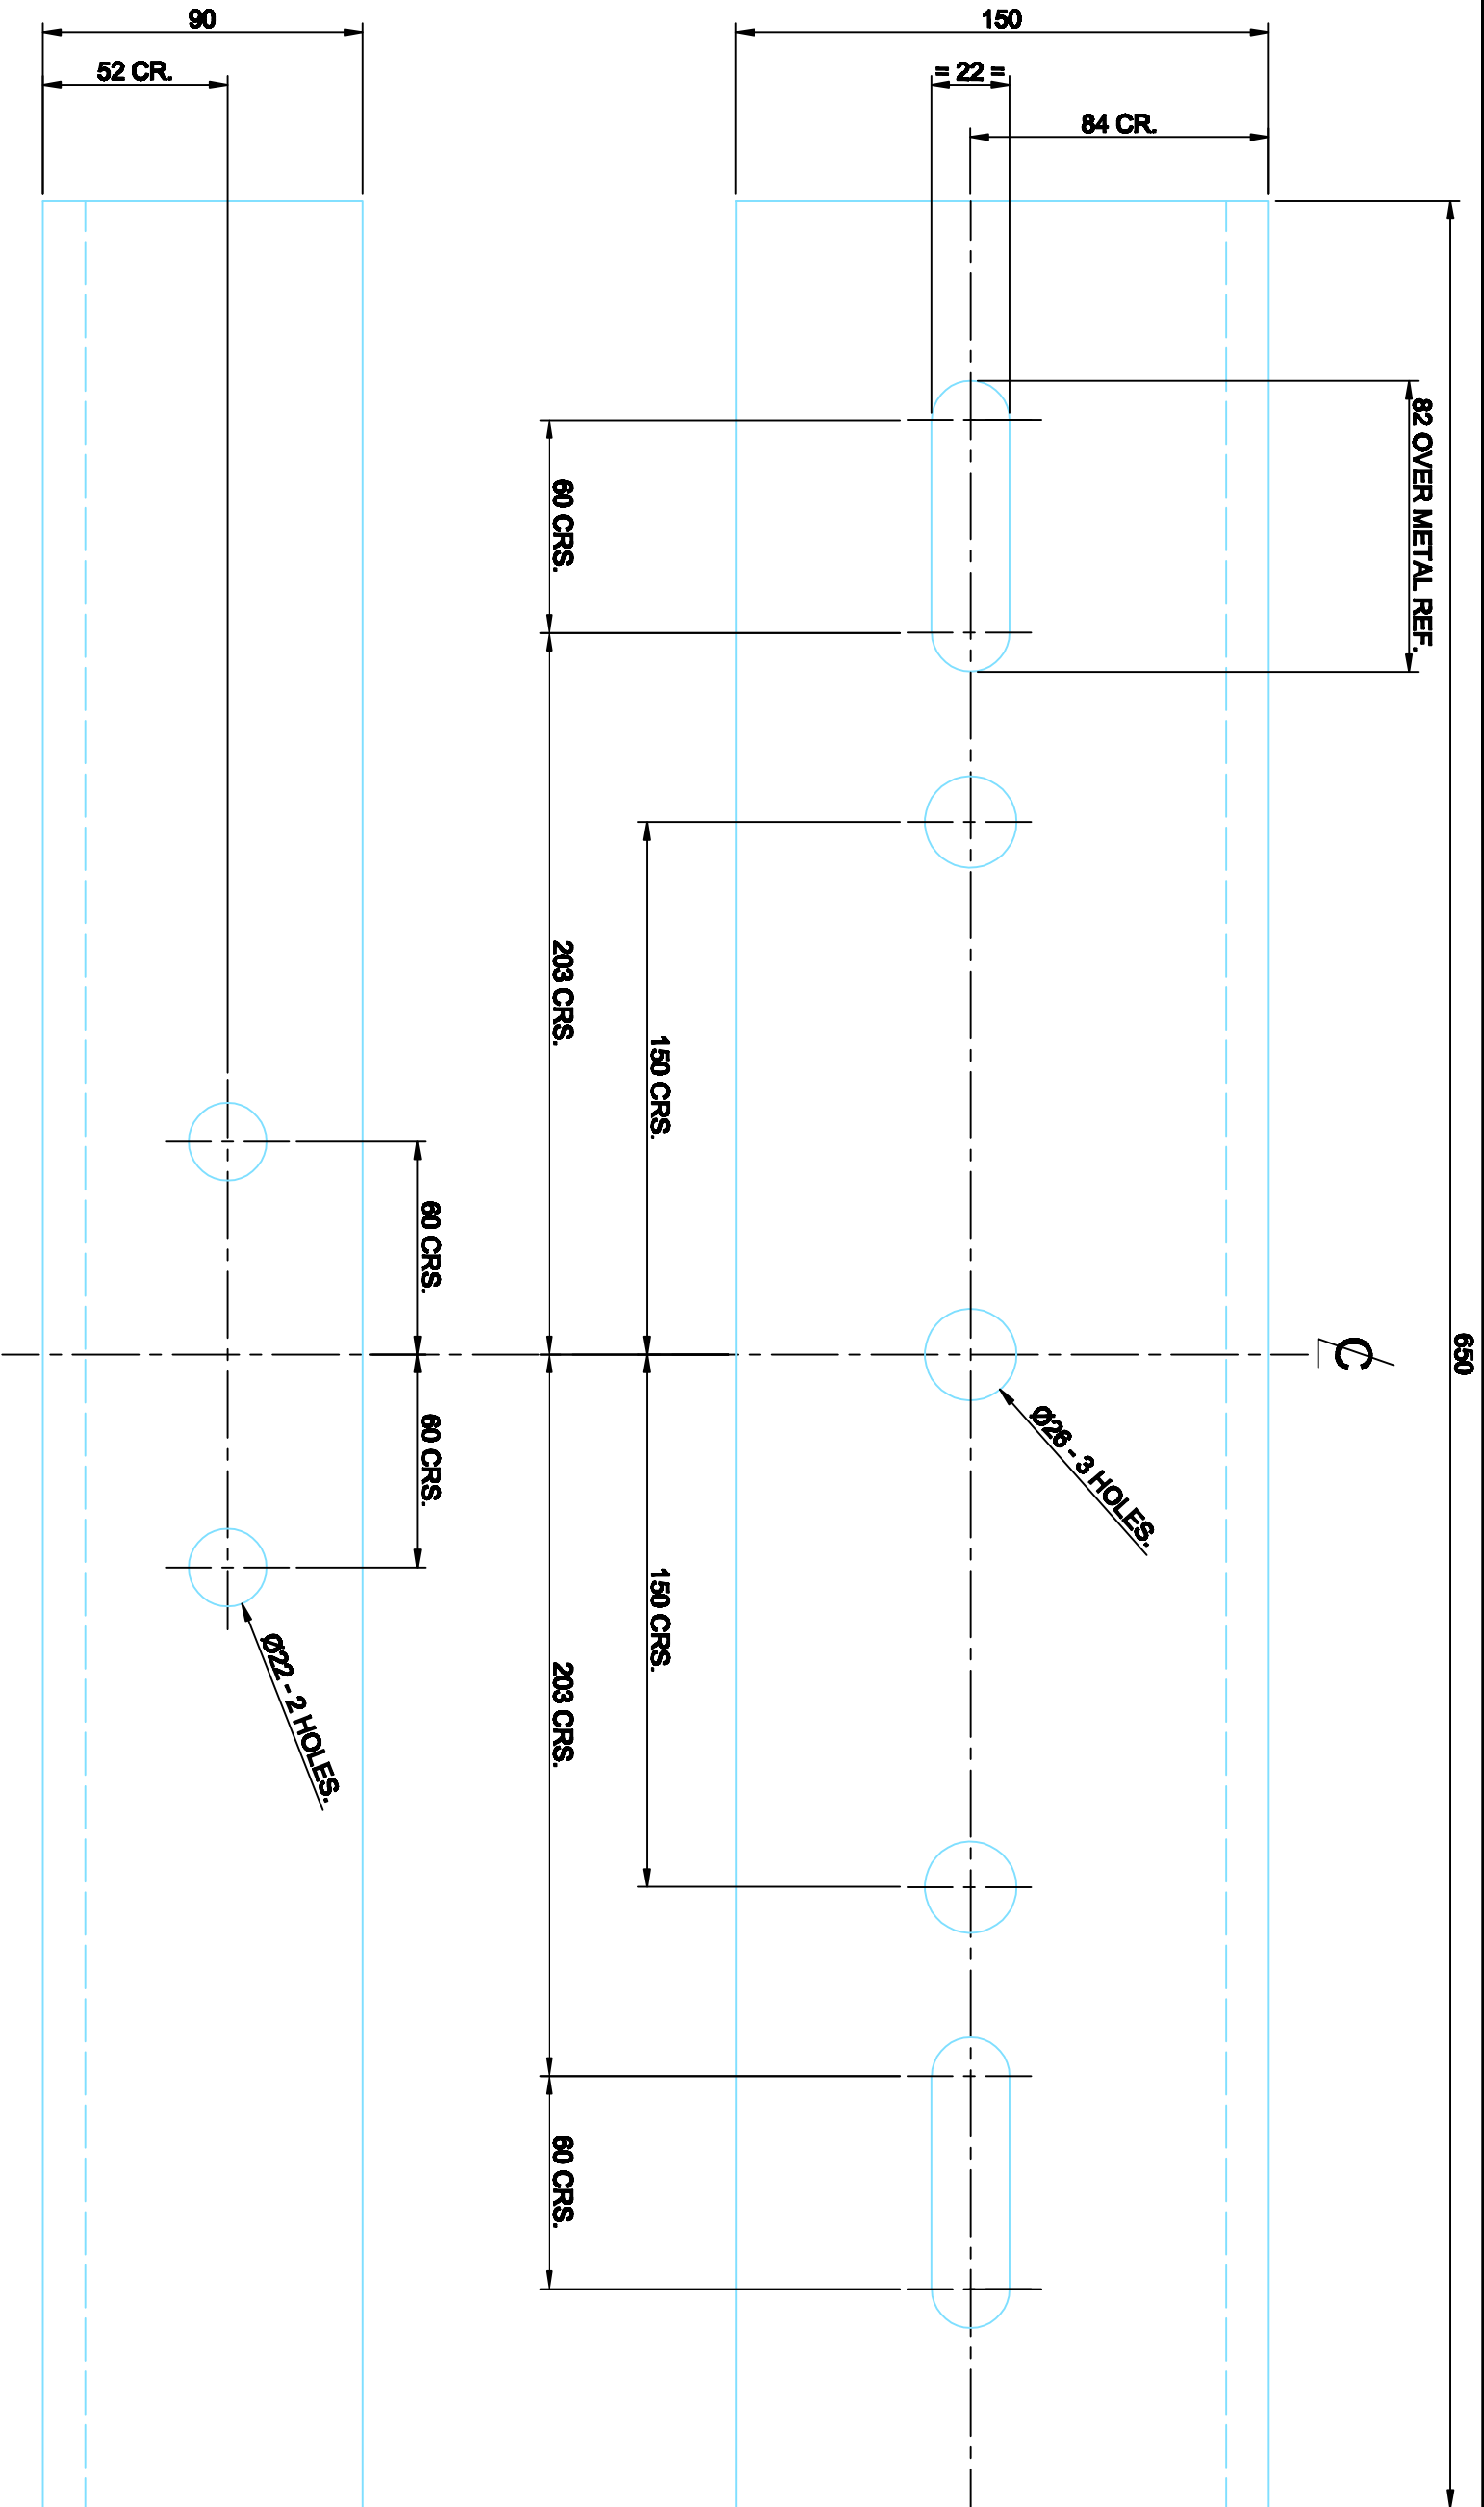

ITEM 7. 650 LONG x 150 x 90 x 12 THICK M.S. UNEQUAL ANGLE.

- NOTES:-
1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
 2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
 3. ALL BURRS TO BE REMOVED.
 4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		132KV OVERHEAD LINES SHORT CROSSARM FOR IN LINE POLES ITEM NO.7			
Sheet No. 7	Scale 1:2	Type OVERHEAD			
Prepared By Barbara Simpson		Grid Reference		DOCUMENT SUB CLASS	
Revised 19/06/07		Ref No. C949345	Historic Dwg.No.		1091010675
Date Issued 19/06/07	Checked By G HAMMEL	Revision A	Notes		