

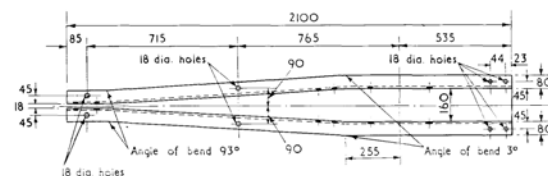



DETAIL 'A'—80 x 80 x 10 Angles.

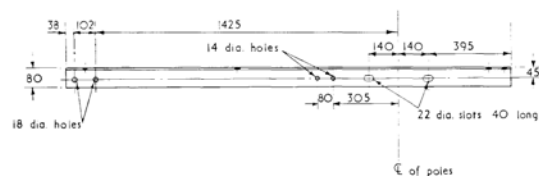


DETAIL B'-80 x 80 x 10 Angles.

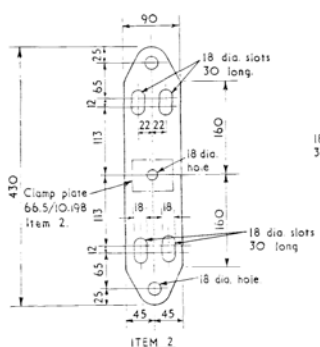


For use at earthwire section positions.
Material :- 90 x 15 Flat Bar.

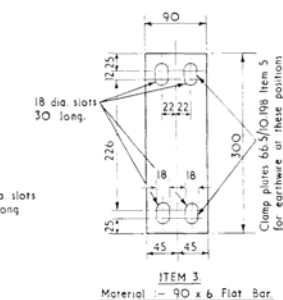

Material :- 90 x 6 Flat Bar.




ITEM 5.
Material :- 40 x 12 Flat Bar





ITEM 1.

NOTE :-
If 18mm. thick plate not available substitute one of the following alternatives :-
a) 3/4" thick plate.
b) 15mm. thick plate with M16 washers tack welded around each hole on one face.


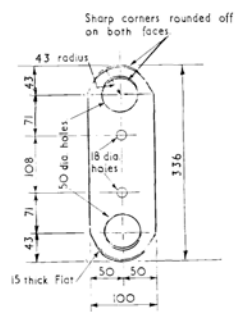


ITEM 4.


For use at section positions
Material :- 100 x 15 Flat Bar.

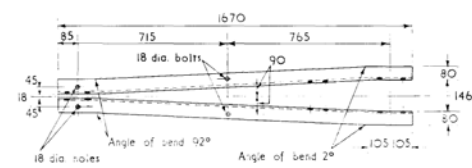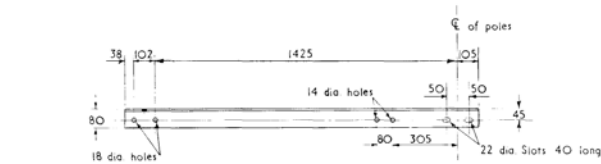

DETAIL 'C'-80 x 80 x 10 Angles

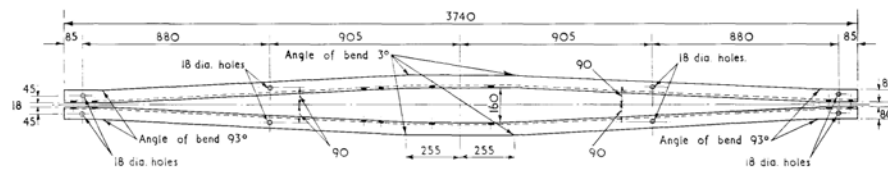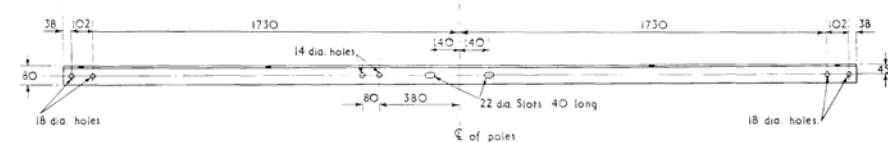


DETAIL 'D'-80 x 80 x 10 Angles.




ITEM 7 - 60 x 60 x 8 Angle.

ITEM 8 - As item 7 Sub. to
opposite hand



ITEM 9 - 60 x 60 x 8 Angle.

ITEM 10 - As Item 9 but to
opposite hand.




ITEM 11-60 x 60 x 8 Angle.

100

NOTES :-

1. Material to BS 4360 Grade 43A galvanised to requirements of BS 729 after fabrication
2. Angles to comply with BS 4848 Part 4.
3. Flats to comply with BS 4229 Part 2.
4. Items 7,8,9,10,11 & 12 to be drilled at backmark 35mm



ITEM 12 - 50 x 50 x 8 ANGLE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

THIS Drawg was SO O H3 74 1160 SM2 of 4 and is also referred to in Works Spec. Ref. No. O4/222

NEED Drawn by Traced Checked M.A.J. Date Issued A.N. 1972 METRIC	CHIEF ENGINEER'S DEPT. CARLISLE HOUSE, NEWCASTLE UPON TYNE NE99 9JH 60kV SINGLE CIRCUIT OVERHEAD LINES A POLE CONSTRUCTION ARRANGEMENT OF STRAIGHT LINE SUPPLY WITH AND WITHOUT PROVISION FOR EARTHWIRE	
	Drawn by	
	Traced	
	Checked	

Sheet No. 1	09	123	1160	Sheet No. 2
No. of Sheets				1
Title: N.T.S.				