


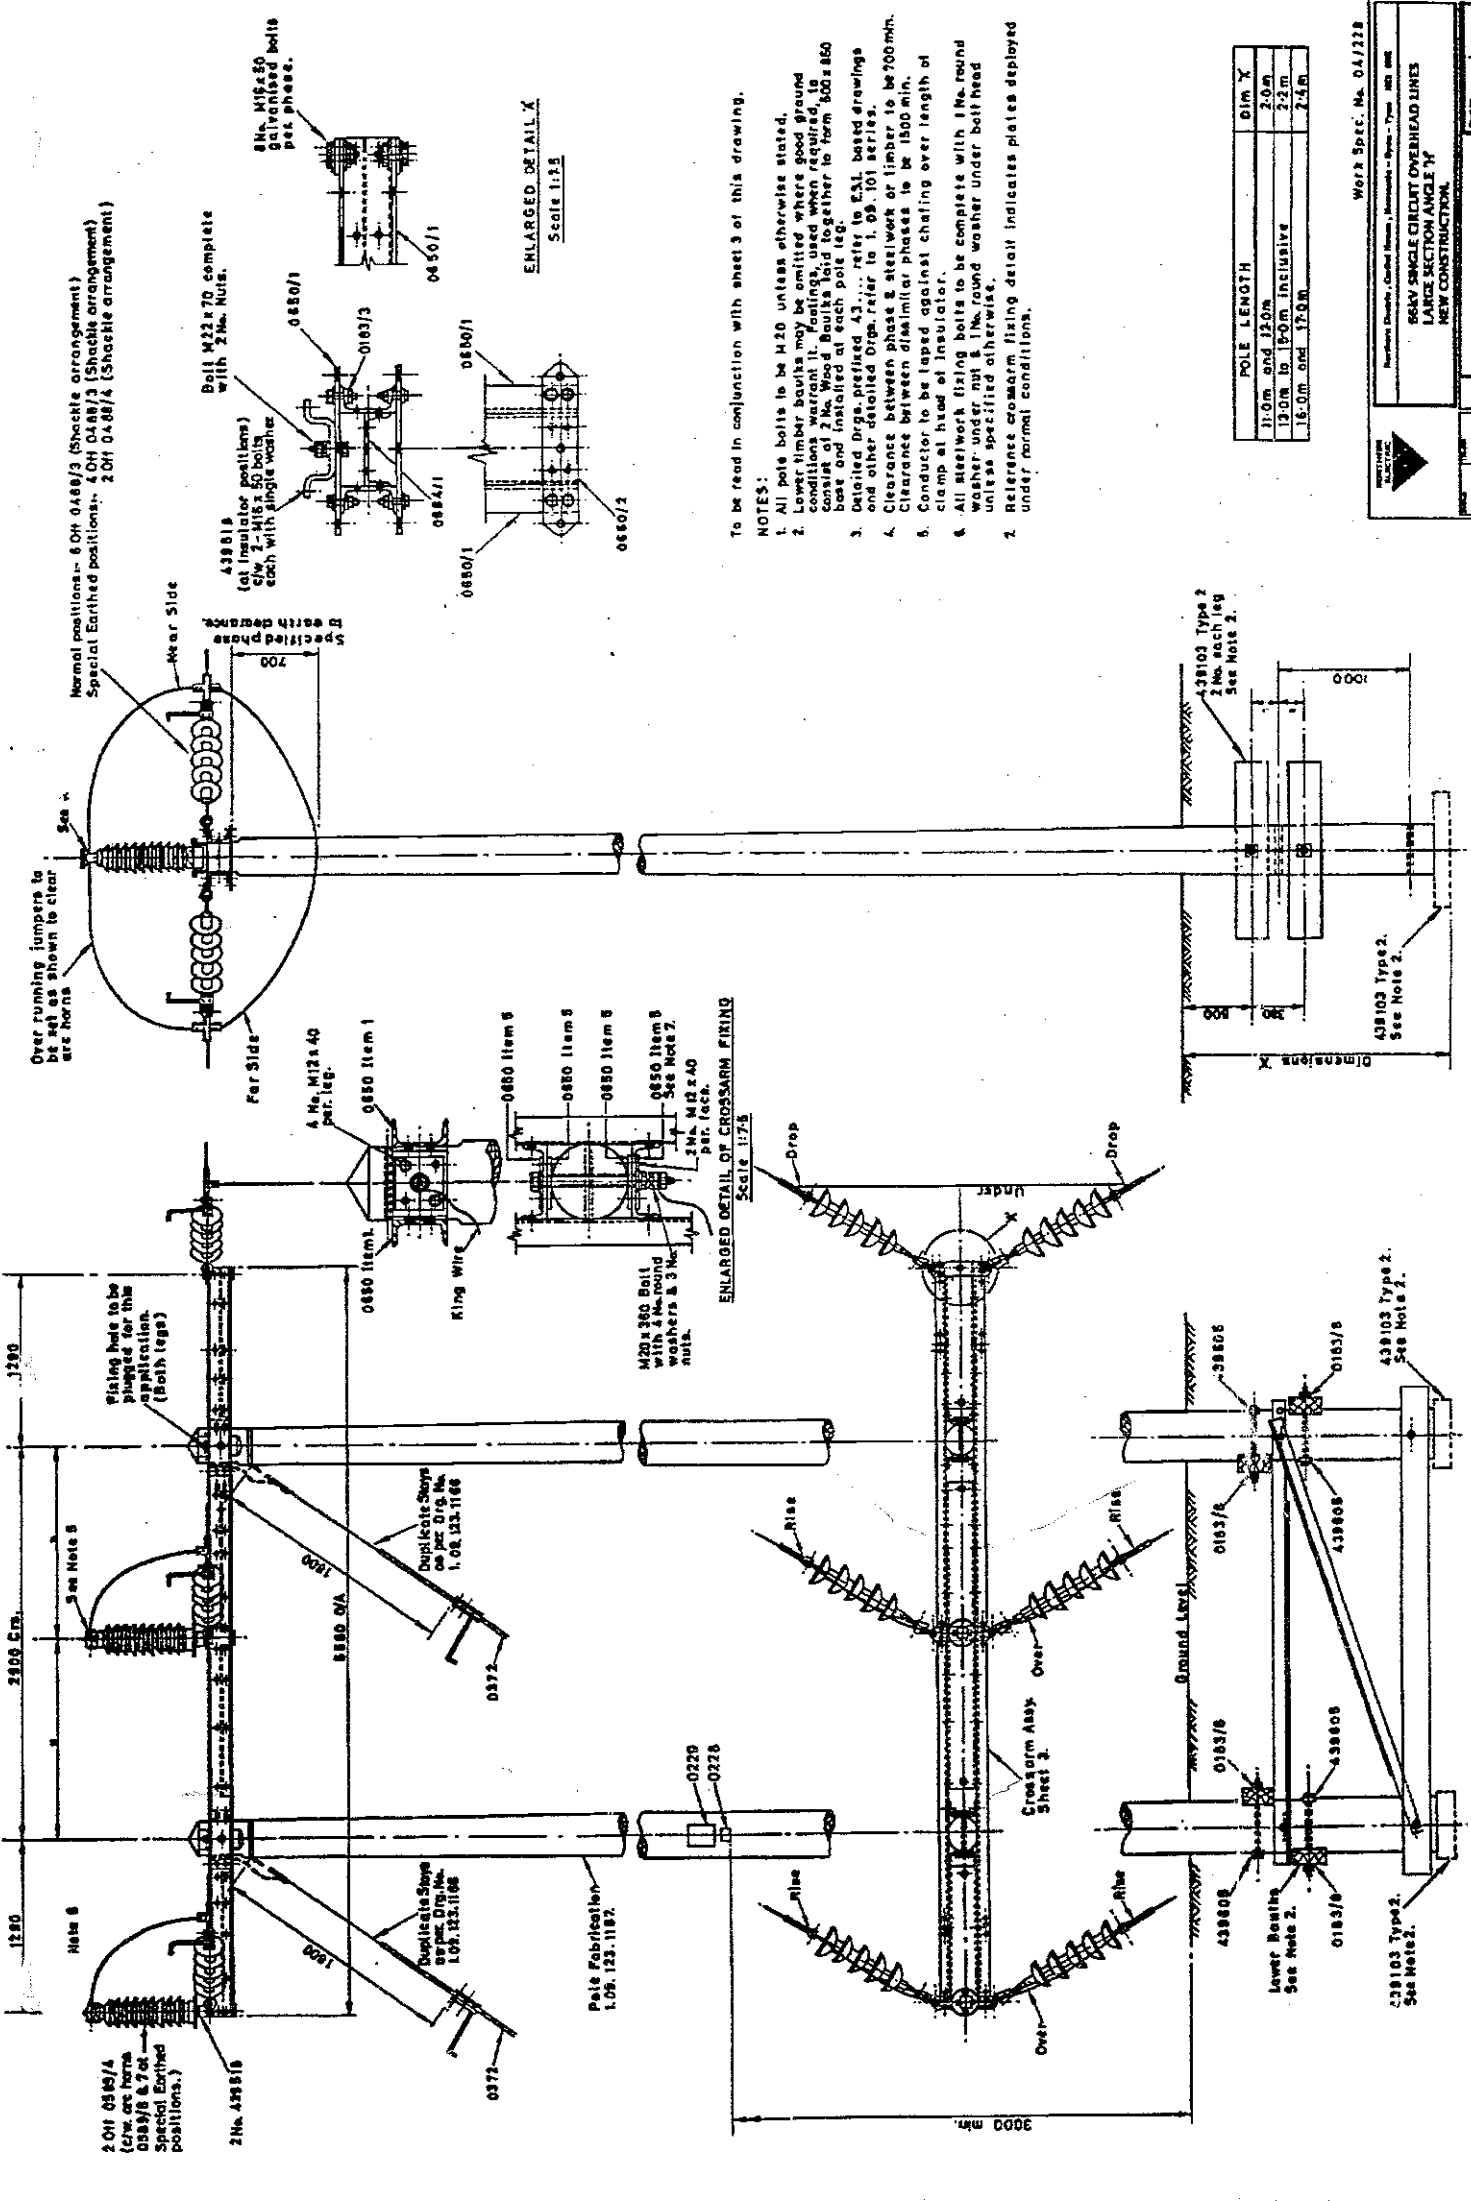

Notes:

1. All pole bolts to be M20 unless otherwise stated.
2. Lower timber bolts may be omitted where good ground conditions warrant it. Fastenings used when required to consist of 2 No. Wood Bolts laid together to form 600 x 850 base and installed at each pole leg.
3. Detailed Drgs. prefixed A3... refer to E31 based drawings and other detailed Drgs. refer to 1. 09. 101 series.
4. Clearance between phase & steelwork or timber to be 700mm.
5. Clearance between diameter phases to be 1500 min.
6. Conductor to be lapped against clamping head of insulator.
7. All steelwork fixing bolts to be complete with 1 No. round washer under nut & 1 No. round washer under bolt head unless specified otherwise.
8. Reference crossarm fixing detail indicates plates deployed under normal conditions.

POLE LENGTH	Dim. X
11.0m and 12.0m	2.0m
13.0m to 15.0m inclusive	2.2m
16.0m and 17.0m	2.4m

Work Spec. No. 04/228

66KV SINGLE CIRCUIT OVERHEAD LINES
LARGE SECTION ANGLE 'Y'
NEW CONSTRUCTION

1 09 123 1162

21/7/53

All dimensions shown are in metres unless otherwise stated.