

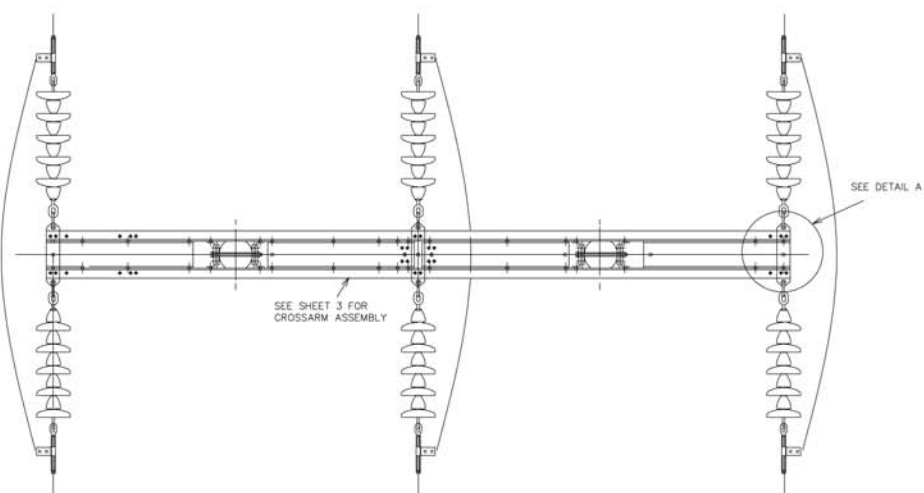
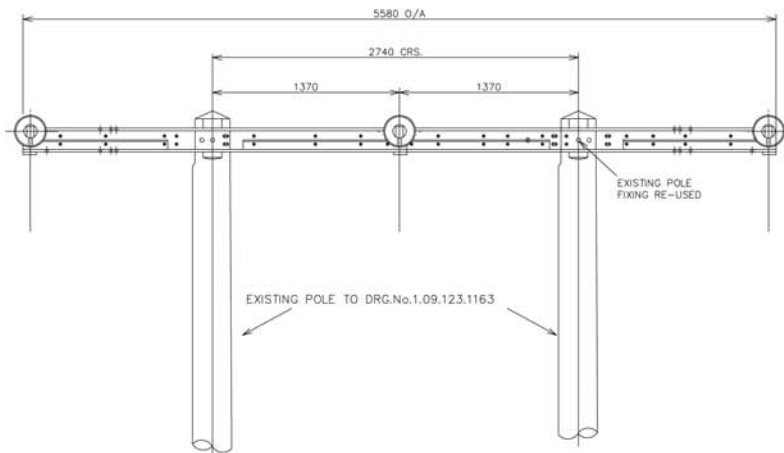


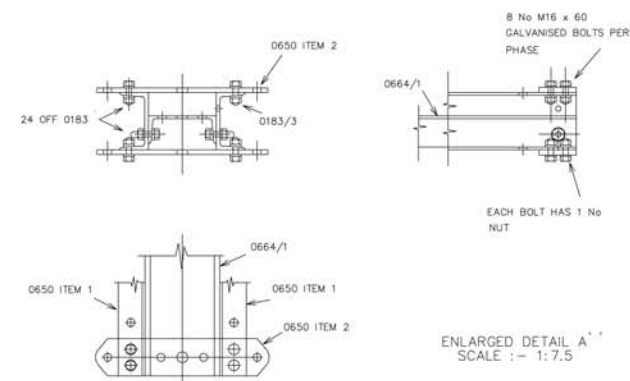

FOUNDATION DETAILS UNCHANGED

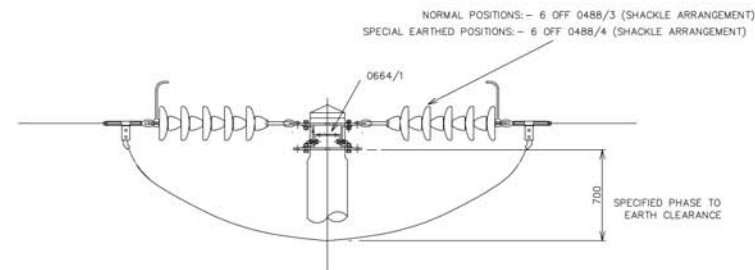

NOTES

1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
2. DETAILED DRGS PREFIXED 43..REFER TO ESI BASED DRAWINGS AND OTHER DETAILED DRGS REFER TO 1.09.101 SERIES.
3. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 700 MIN. CLEARANCE BETWEEN DISSIMILAR PHASES TO BE 1500 MIN.
4. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No. ROUND WASHER UNDER BOLT HEAD UNLESS SPECIFIED OTHERWISE.
5. THIS ARRANGEMENT IS SUITABLE FOR RENOVATION OF EXISTING STOUT GRADE POLES. EXISTING MEDIUM POLES SHOULD BE REPLACED (WHEN RENOVATION IS REQUIRED) TO DRG. 1.09.123.1163 SHEET 1.

TO BE READ IN CONJUNCTION WITH SHEET 3 OF THIS DRAWING.

		Northern Electric Distribution Limited, Coriol House, Newcastle Upon Tyne, NE1 6NE.	
66kV OVERHEAD LINES STRAIGHT LINE SECTION 'H'SUPPORT (APPLICATION OF STANDARD CROSSARM TO EXISTING 2740 9'-0") CENTRES 'H' POLE TO DRG.No.1.09.123.1163			
Prepared by S.B. Checked M.W.	Date Issued Date Issued	Drg No. 1 09 123 1163 Mod. 1/2 M	Sheet No. 2 Revised SEP'99(RC) Scale 1:20

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED