
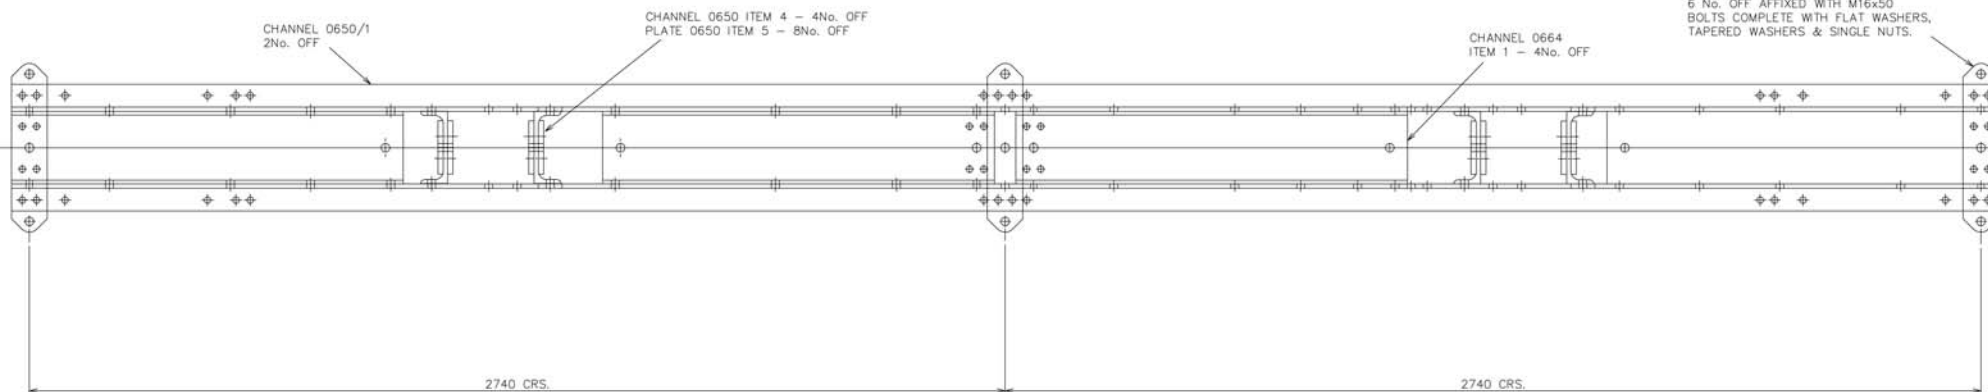


⊕ DENOTES 18 DIA. HOLES
 ⊕ DENOTES 22 DIA. HOLES
 ⊕ DENOTES 24 DIA. HOLES

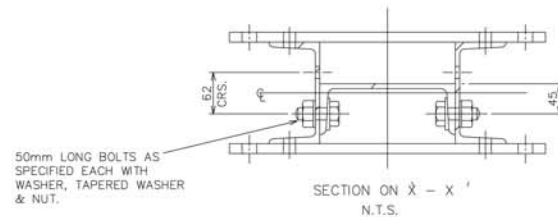

NOTES :-

1. OUTER STIFFENER CHANNELS 0664/1 EACH AFFIXED WITH 8No. M20 x 60 LONG BOLTS & 2No. M16 x 50 LONG BOLTS.
2. INNER STIFFENER CHANNELS 0664/1 EACH AFFIXED WITH 6No. M20 x 60 LONG BOLTS & 2No. M16 x 50 LONG BOLTS.

TO BE READ IN CONJUNCTION WITH SHEET 1
 OF THIS DRAWING.

		Northern Electric Distribution Limited, Coriol House, Newcastle Upon Tyne, NE1 6NE.	
66kV OVERHEAD LINES - NEW CONSTRUCTION STRAIGHT LINE SECTION 'H' SUPPORT CROSSARM ASSEMBLY			
Prepared by S.B. Checked M.W. Date Issued FEB'87	Drg No. 1 09 123 1163 Mods. 1/2 K	Sheet No. 3 Revised SEP'99(RC) Scale 1:7.5	

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED