



- ⊕ DENOTES 18 DIA. HOLES.
- ⊕ DENOTES 24 DIA. HOLES.
- ⊕ DENOTES 22 DIA. HOLES.

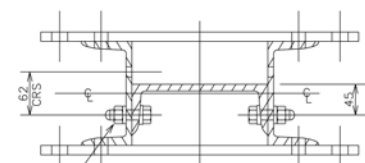

50mm LONG BOLTS AS  
SPECIFIED EACH WITH  
WASHER, TAPERED  
WASHER & NUT.

SECTION X - X

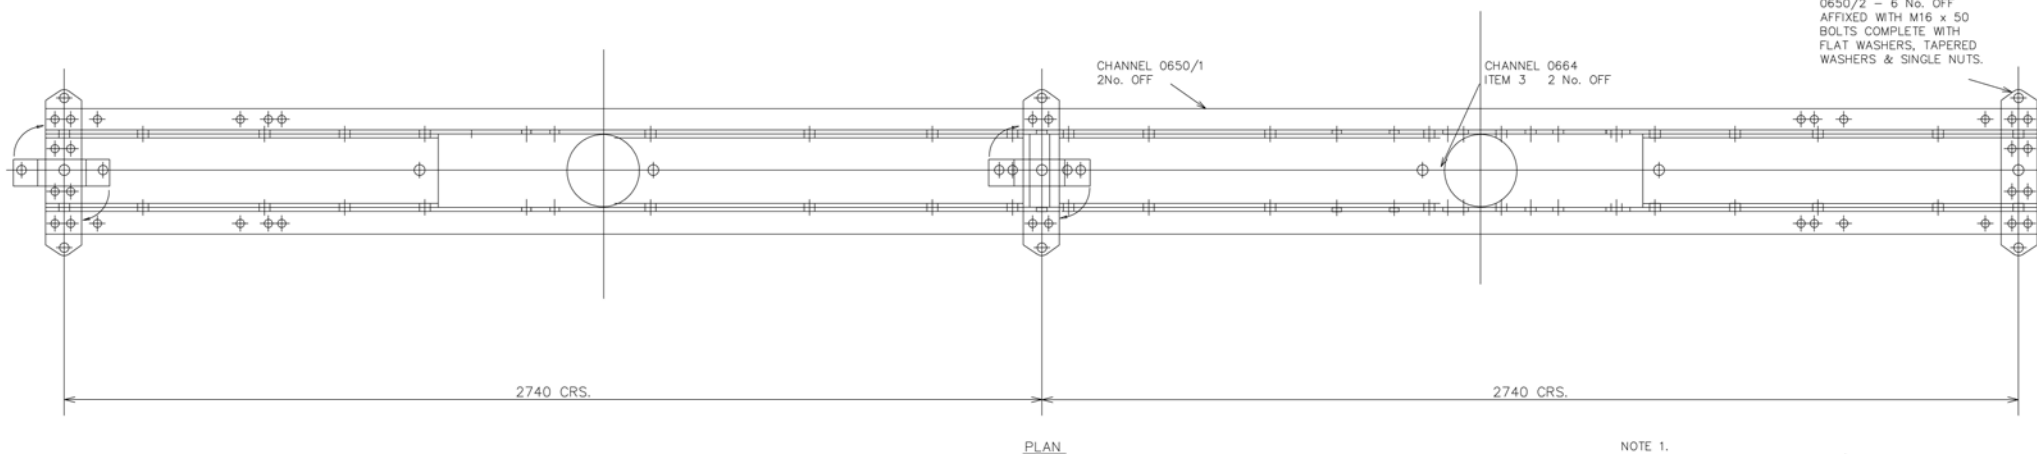

NOTE 1.  
OUTER STIFFENER CHANNELS 0664/1 EACH AFFIXED WITH  
8 No. M20 x 50 LONG BOLTS & 2 No. M16 x 50 LONG BOLTS.

NOTE 2.  
INNER STIFFENER CHANNELS 0664/1 EACH AFFIXED WITH  
6 No. M20 x 50 LONG BOLTS & 2 No. M16 x 50 LONG BOLTS.

TO BE READ IN CONJUNCTION WITH SHEETS  
1 & 2 OF THIS DRAWING AS REQUIRED.

|                              |                       |                                                                                           |               |           |         |
|------------------------------|-----------------------|-------------------------------------------------------------------------------------------|---------------|-----------|---------|
| <b>NORTHERN ELECTRIC</b><br> |                       | Northern Electric, Carrial House, Newcastle upon Tyne NE1 6NE                             |               |           |         |
|                              |                       | 66kV OVERHEAD LINES - LARGE SECTION<br>*H* POLES CROSSARM ASSEMBLY FOR 8'-0" 2440 CENTRES |               |           |         |
| Drawn<br>J.L.W.              | Traced                | Dwg No.                                                                                   | 1 09 123 1163 | Sheet No. | 5       |
| Checked<br>M.W.              | Date Issued<br>FEB 96 | Revised                                                                                   |               | Scale     | 1 : 7.5 |