


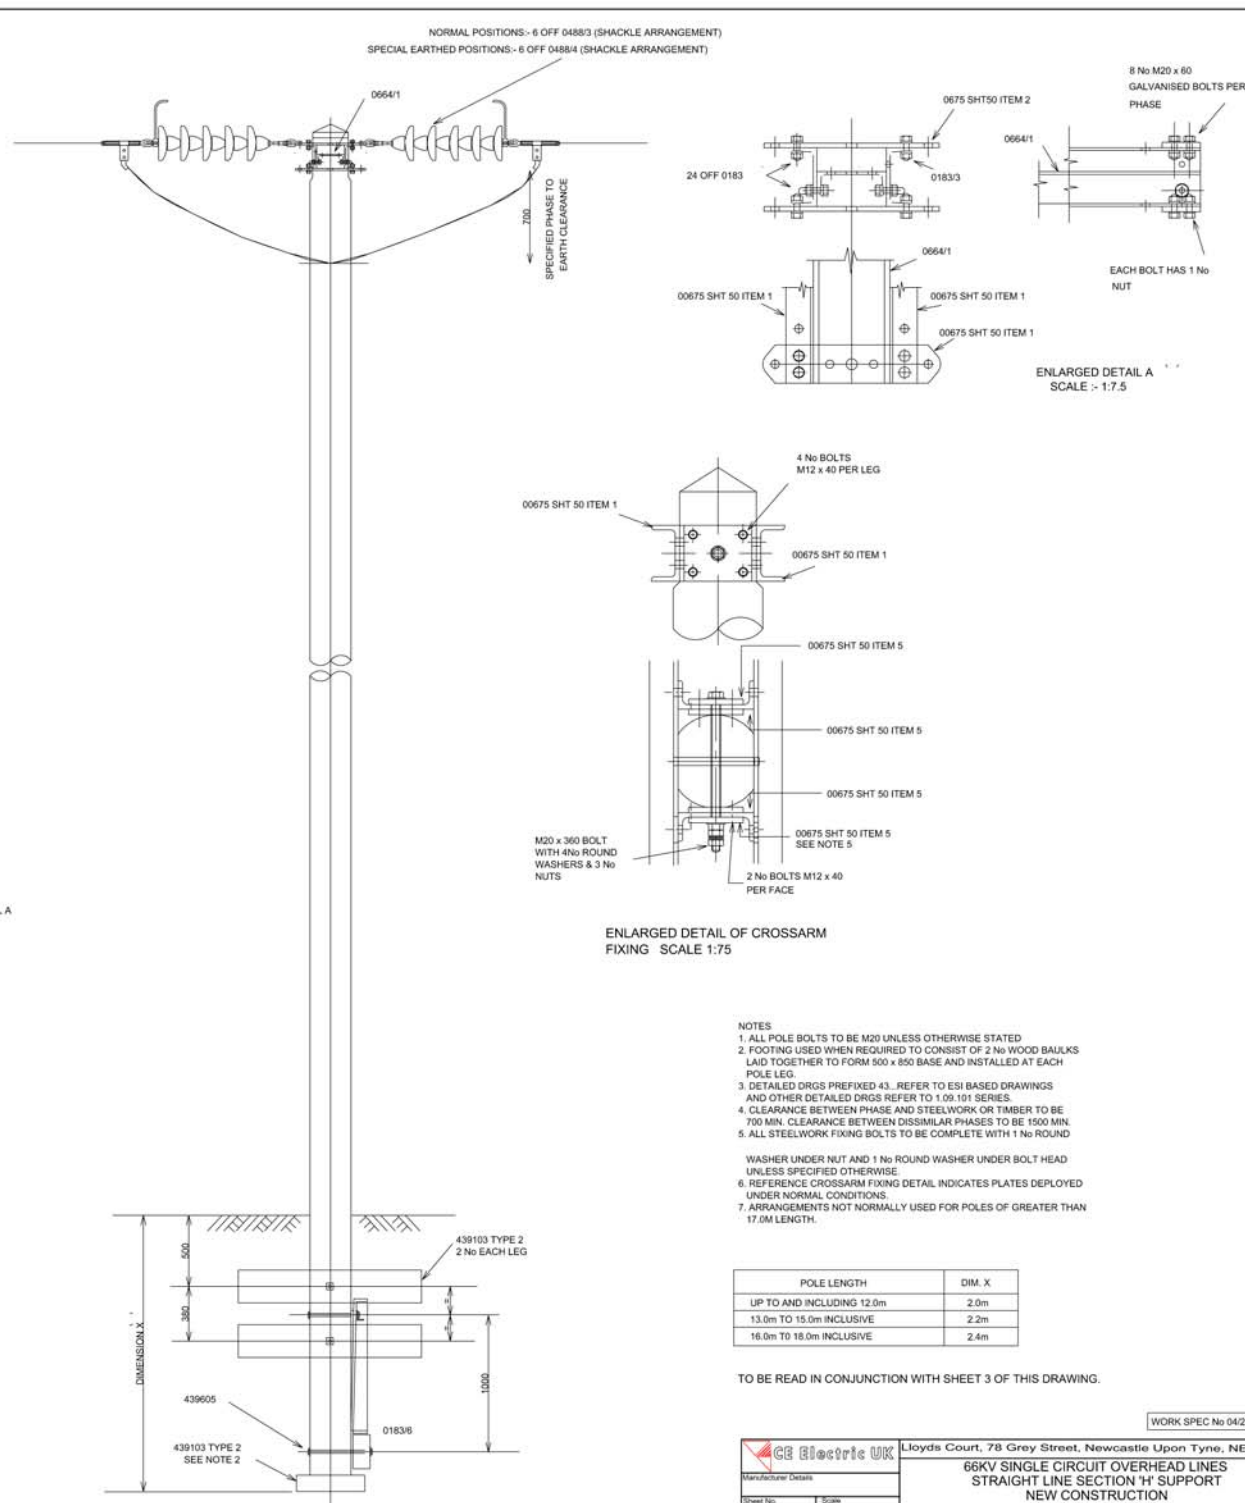

NOTES

1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
2. FOOTING USED WHEN REQUIRED TO CONSIST OF 2 NO WOOD BALKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE
3. DETAILED DROGS PREFIXED 4/3. REFER TO ESI BASED DRAWINGS AND OTHER DETAILED DROGS REFER TO 1.09.101 SERIES.
4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 700 MM. CLEARANCE BETWEEN DISSIMILAR PHASES TO BE 1500 MM
5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 NO ROUND WASHER UNDER NUT AND 1 NO ROUND WASHER UNDER BOLT HEAD UNLESS SPECIFIED OTHERWISE
6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPENDENT UNDER NORMAL CONDITIONS
7. ARRANGEMENTS NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0M LENGTH.

POLE LENGTH	DIM. X
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

TO BE READ IN CONJUNCTION WITH SHEET 3 OF THIS DRAWING.

 GE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		WORK SPEC No 04/228
Manufacturer Details		66KV SINGLE CIRCUIT OVERHEAD LINES STRAIGHT LINE SECTION H' SUPPORT NEW CONSTRUCTION		
Street No.	Scale 1:20	Type OVERHEAD	POLES	
Prepared By Joan Oakley	Grid Reference	Ref No C067052	Historic Dwg No	1091231163
Received 13/05/10	Date Issued 13/05/10	Checked By G HAMMILL	Revision	Notes