
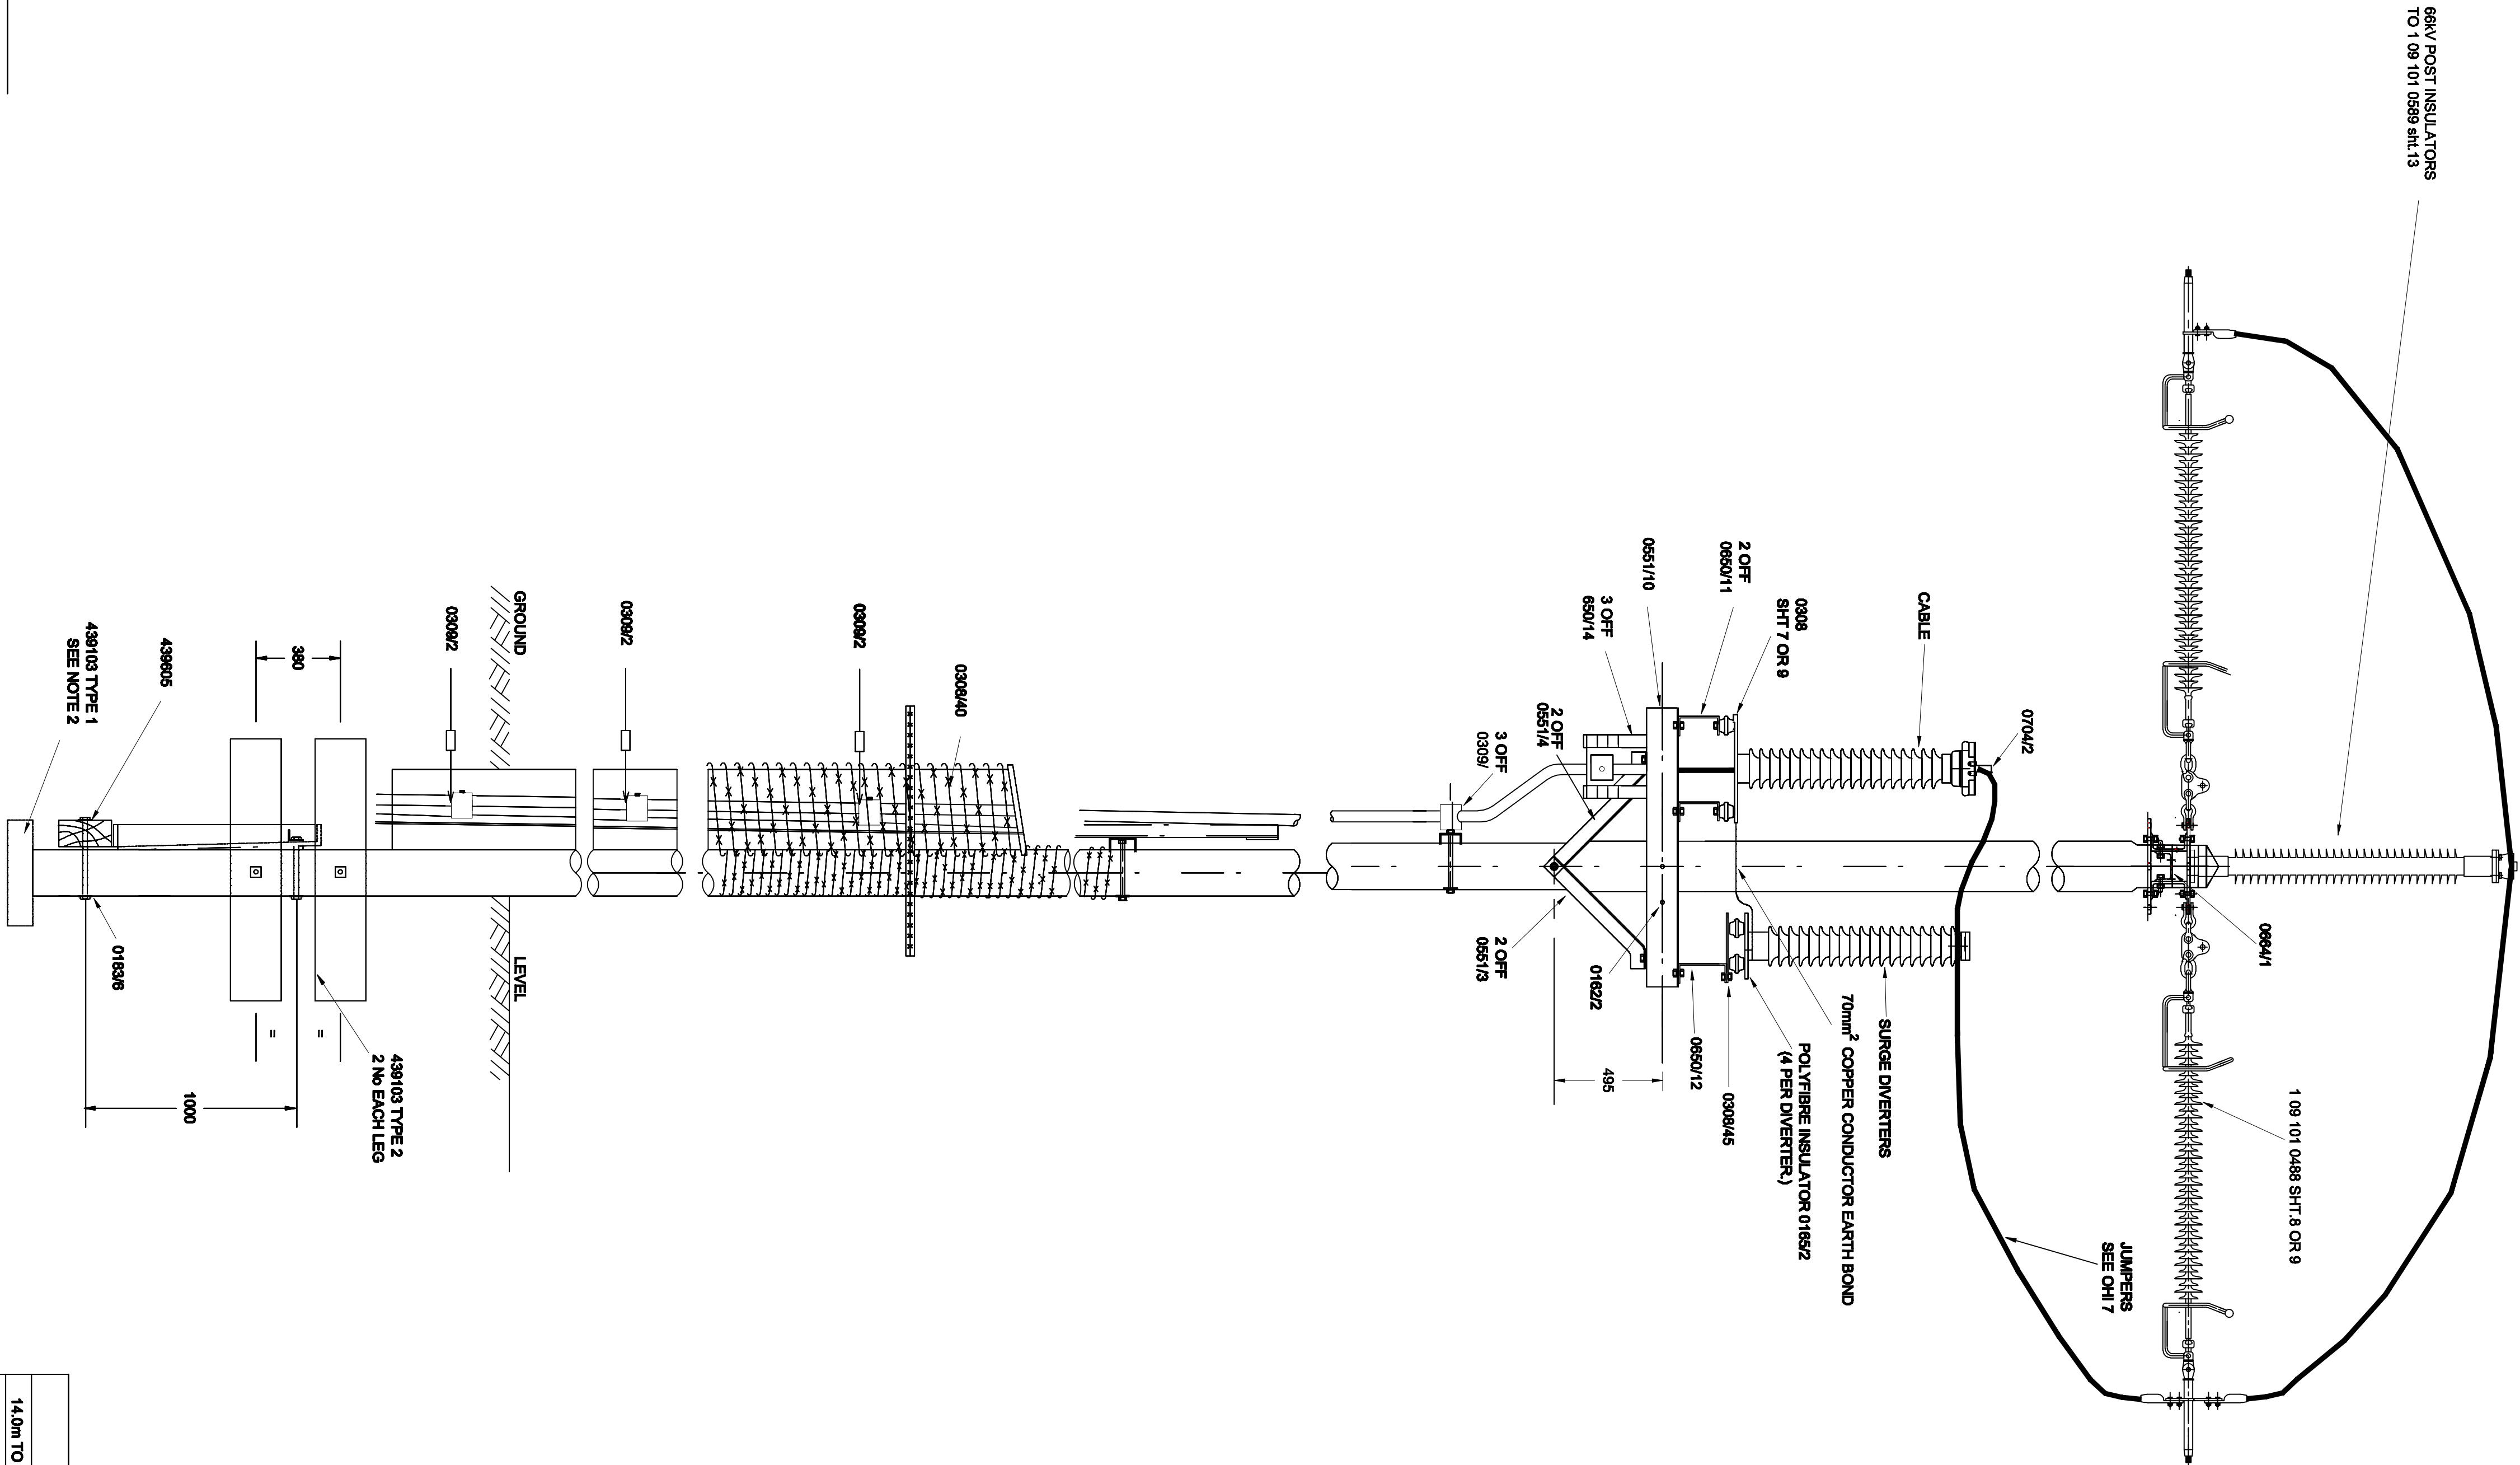


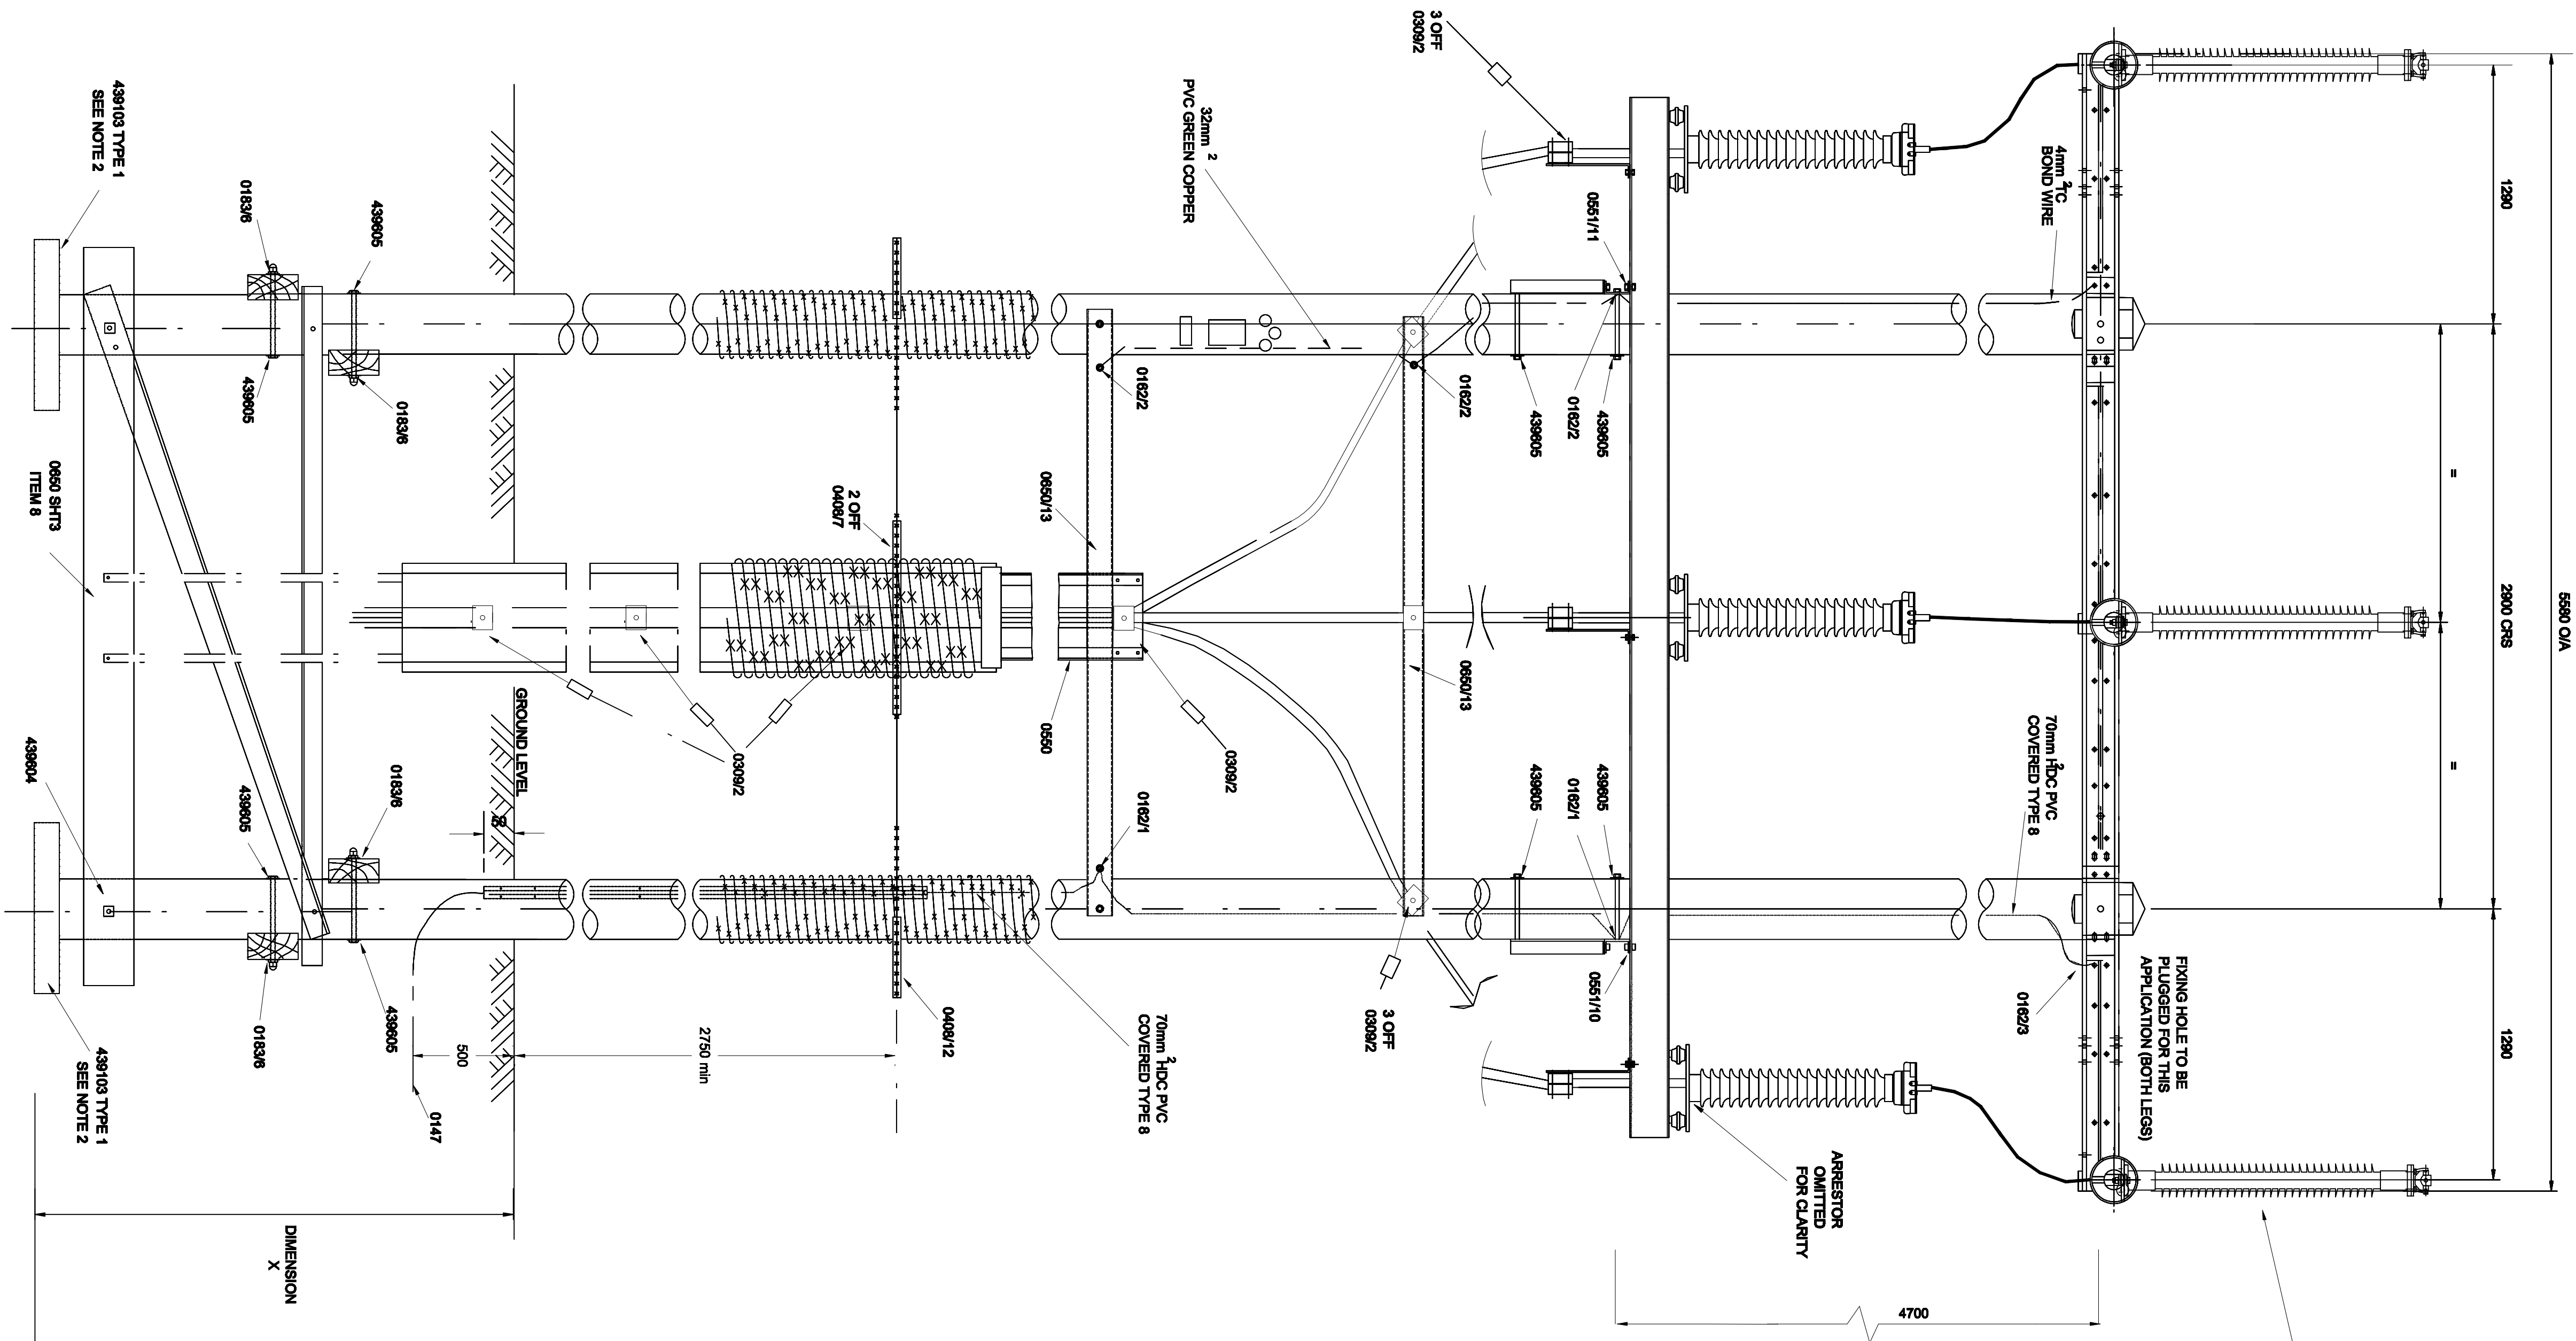


- NOTES
1. ALL POLE BOLTS TO BE 1600 UNLESS OTHERWISE STATED
 2. FOOTING USED WHEN REQUIRED TO CONSIST OF 2 IN. WOOD BALKS LAD TOGETHER TO FORM A 500 X 800 BASE
 3. DETAIL DRAWINGS ARE REFERRED TO 100.101 REFER TO ES BASED DRAWINGS
 4. ANY OTHER DETAIL DRAWINGS REFER TO 100.101 SERIES MAY VARY, CL EXCHANGE BETWEEN CABLES AS PHASES TO BE KNOWN
 5. ALL STEELWORK TO BE COMPLETED WITH 1 IN. ROUND WASHER UNDER NUT AND 1 IN. ROUND WASHER UNDER BOLT HEAD
 6. UNLESS SPECIFIED OTHERWISE
 7. ARRANGEMENTS NOT NORMALLY USED FOR POLES OF GREATER THAN 170mm LENGTH
 8. MINIMUM POLE LENGTH TO BE 12m
 9. ITEMS TO BE SUPPLIED BY CABLE CONTRACTOR

TO BE READ IN CONJUNCTION WITH SHEET 3 OF THIS DRAWING.

POLE LENGTH	DM, X
1400 TO 1600 INCLUSIVE	2.2m
1600 TO 1800 INCLUSIVE	2.4m

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

ENLARGED DETAIL OF CROSS-ARM
FIXING SCALE 1/7.5

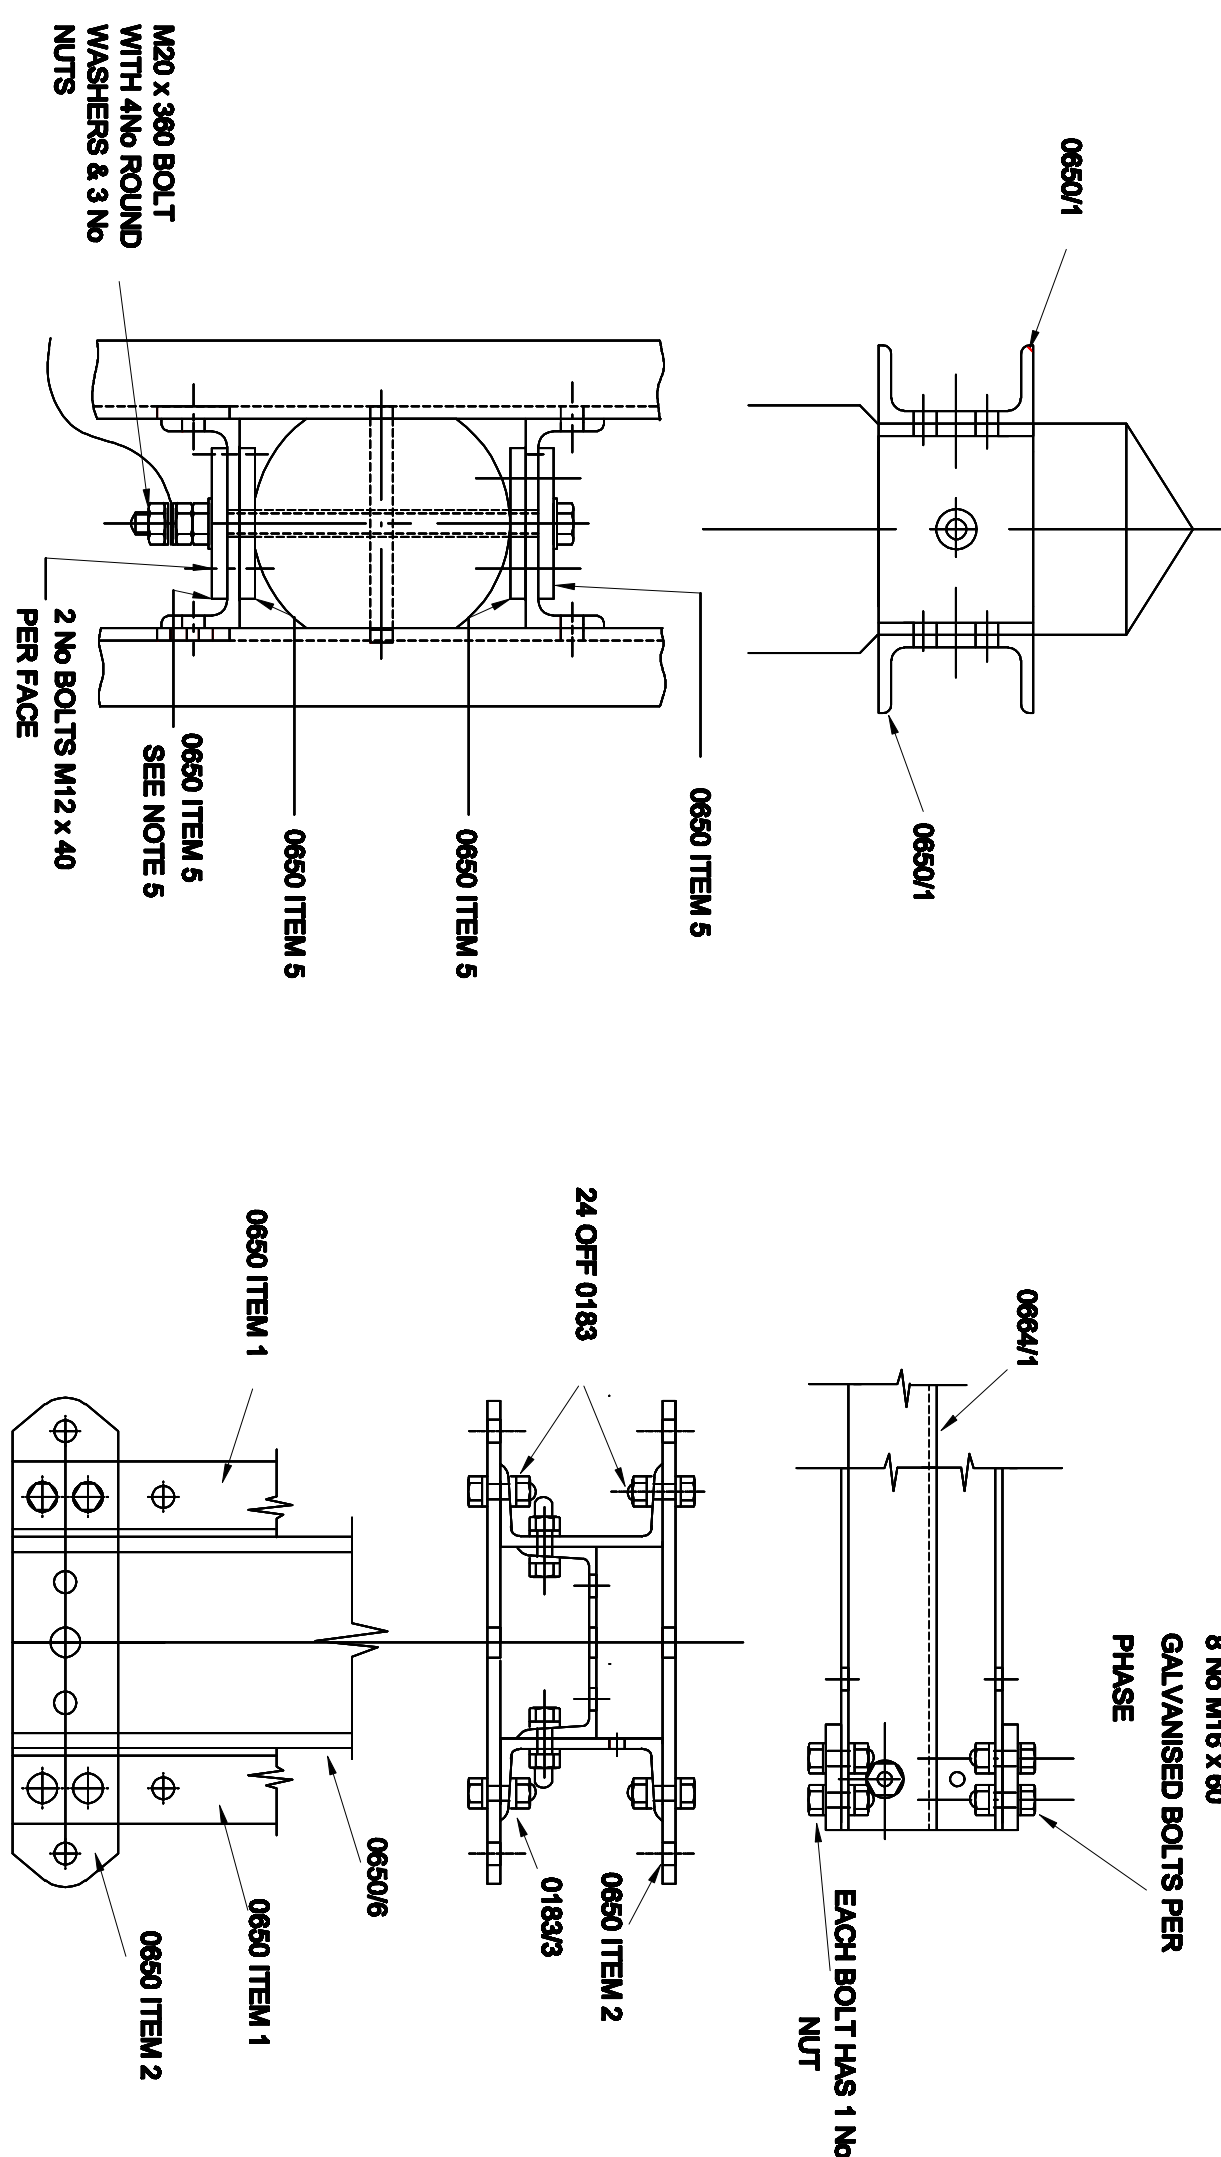

ENLARGED DETAIL A'
SCALE 1/7.5