



THESE HOLES TO BE
DRILLED TO TEMPLATE
FROM THIS SIDE
OF POLE

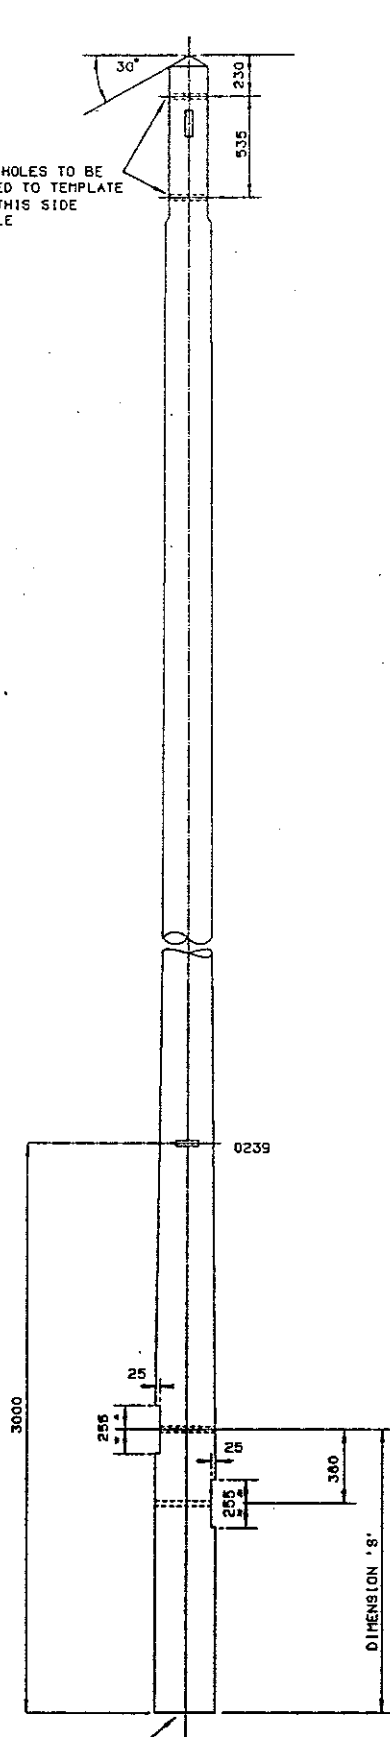

THIS VIEW SHOWS THE POLE FACE
(NATURAL LIE OF POLE.)

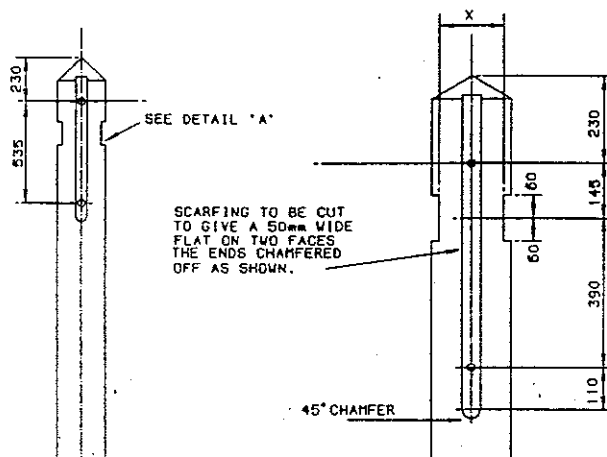

DETAIL 'A'

BACK TO BACK DIMENSION 'X'

STOUT	190
EXTRA STOUT	230

NOTES

1. CLASS OF POLE TO BE 'STOUT' OR EXTRA STOUT IN ACCORDANCE WITH 1.09.101.0238
2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE
3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING
4. POLE TO BE NOTCHED AND DRILLED FOR 250 x 125 x 1300 LONG BAULKS
5. STOUT POLES TO BE NORMALLY FITTED WITH DOUBLE BAULKS. LOWER BAULKS MAY BE OMITTED WHERE GOOD GROUND CONDITIONS PERTAIN. (eg K=4000lb ft/ft²)
6. EXTRA STOUT POLES TO BE NORMALLY FITTED WITH DOUBLE BAULKS. EXTRA STOUT POLES DESIGNED TO INCREASE WIND SPANS MAY BE UNSUITABLE FOR POOR GROUND CONDITIONS. SEE SPECIFICATION.

POLE LENGTH	DIM. 'S'
8.5m - 12m INCLUSIVE	1.5
13.0m - 15.0m INCLUSIVE	1.7
16.0m - 18.0m INCLUSIVE	1.9
20.0m - 24m INCLUSIVE	2.5

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

NORTHERN ELECTRIC 		Northern Electric, Central House, Newcastle upon Tyne NE1 0NE	
		66kV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKINGS FOR SINGLE POLE ARRANGEMENT	
Drawn JUR	Issued AB	Org. No.	1 09 123 1186
Checked GH	Date Issued JUL 85	Scale	1:20 & 1:10