


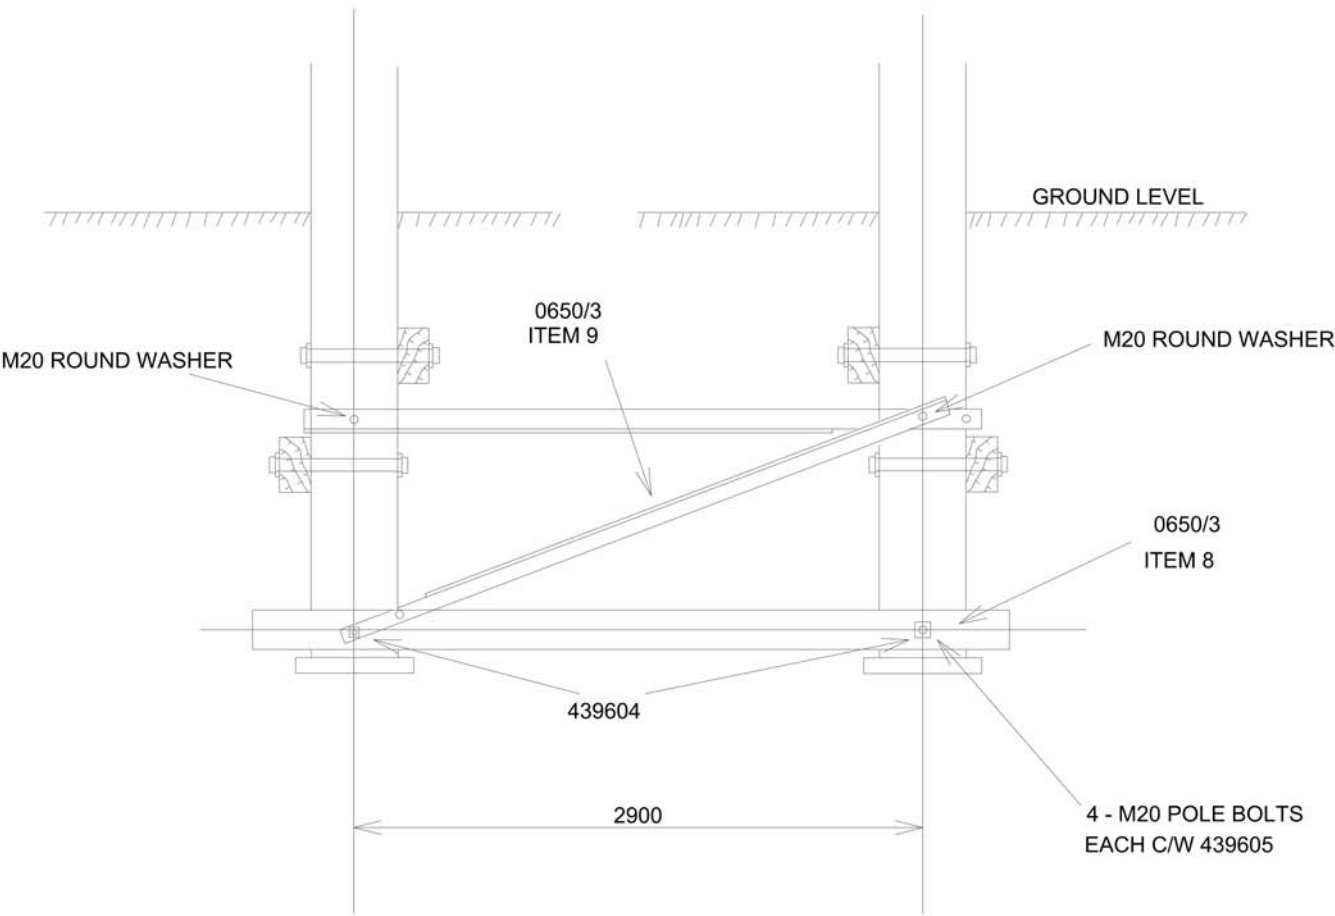

NOTE:
ONLY THOSE MATERIALS IDENTIFIED SEPERATELY
INCLUDED IN THE SUB ASSEMBLY

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

		NEDL, Manor House, Station Road, Houghton le Spring, DH4 7LA.											
		66kV SINGLE CIRCUIT OVERHEAD LINES CROSS BRACED FOUNDATION AUGMENTATION FOR PORTAL TYPE POLE TO SPECIFICATION O.H.L.4/84											
Prepared By C.M.		Drg.No.		1 09 123 1187								Sheet No. 2	
Checked R.M.D.		Date Issued AUG'85										Revised. JUNE'03	
Mods.		A B C D E										Scale N.T.S.	