
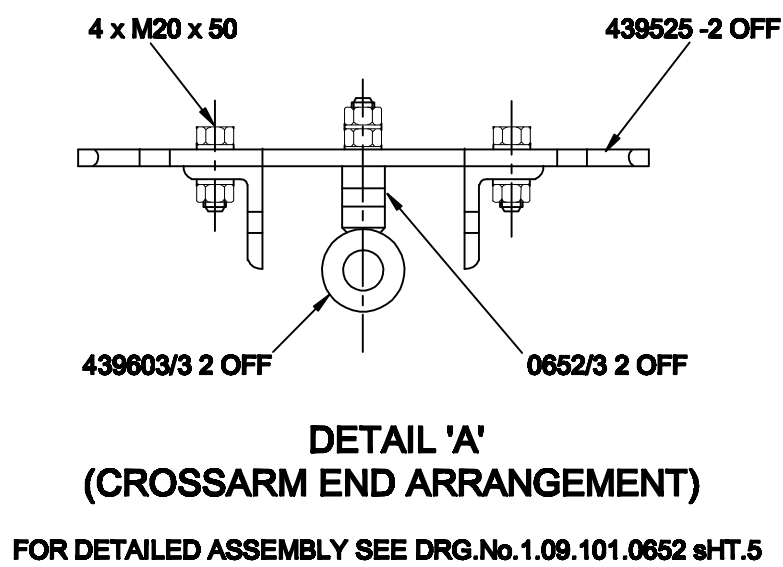
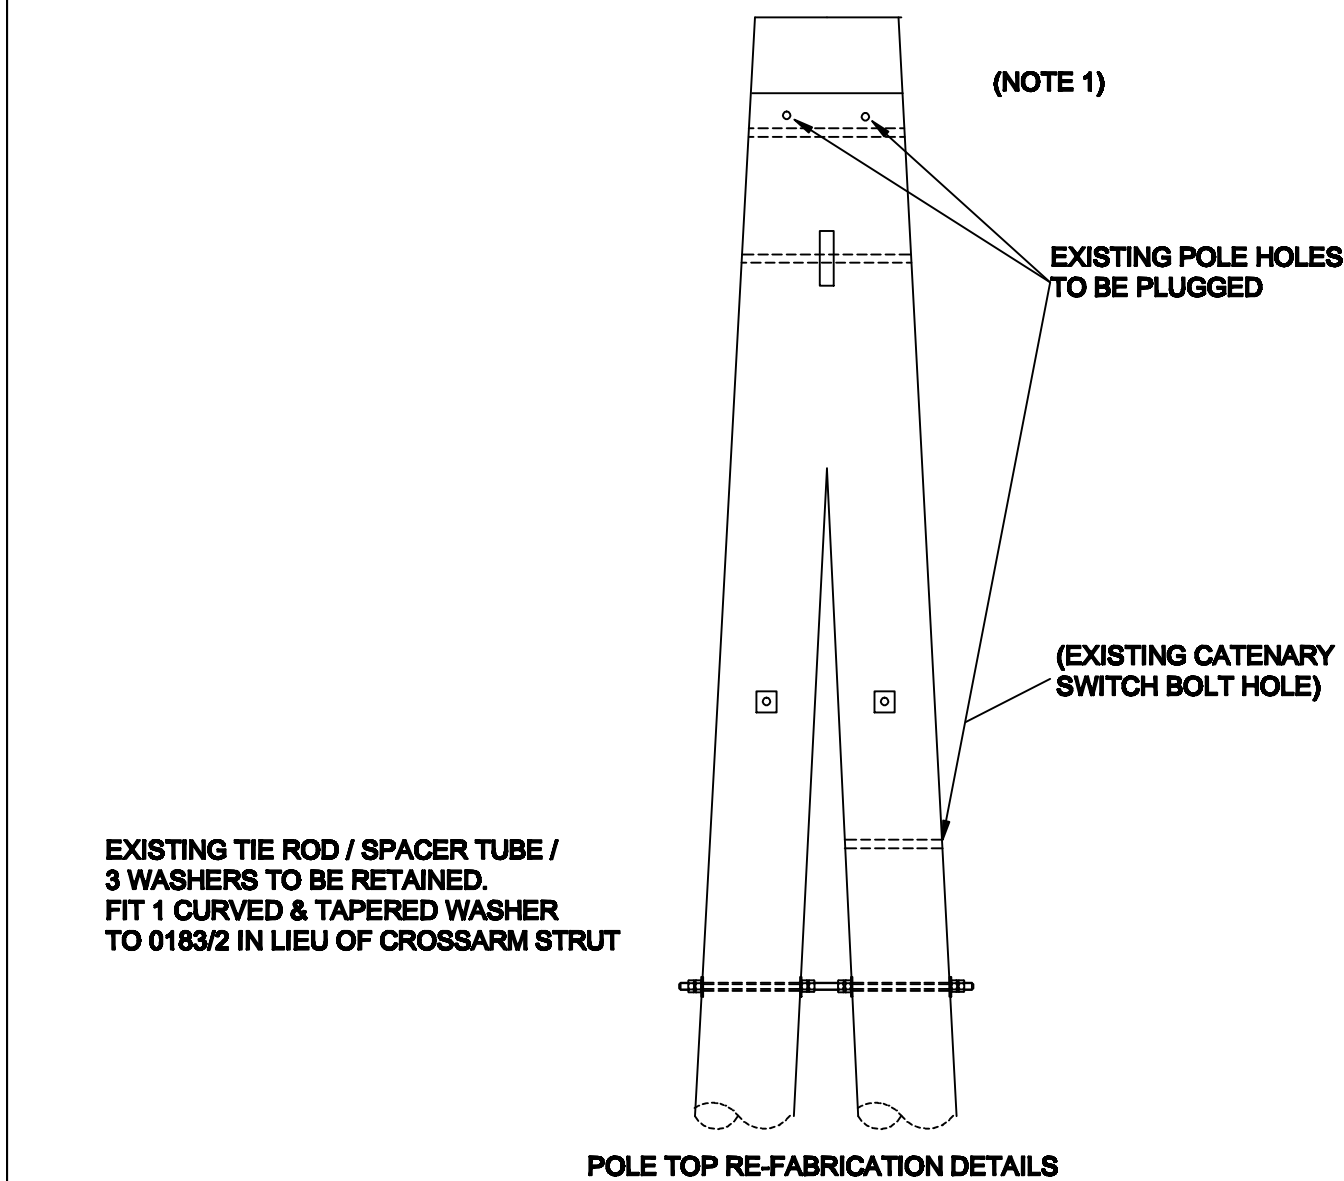


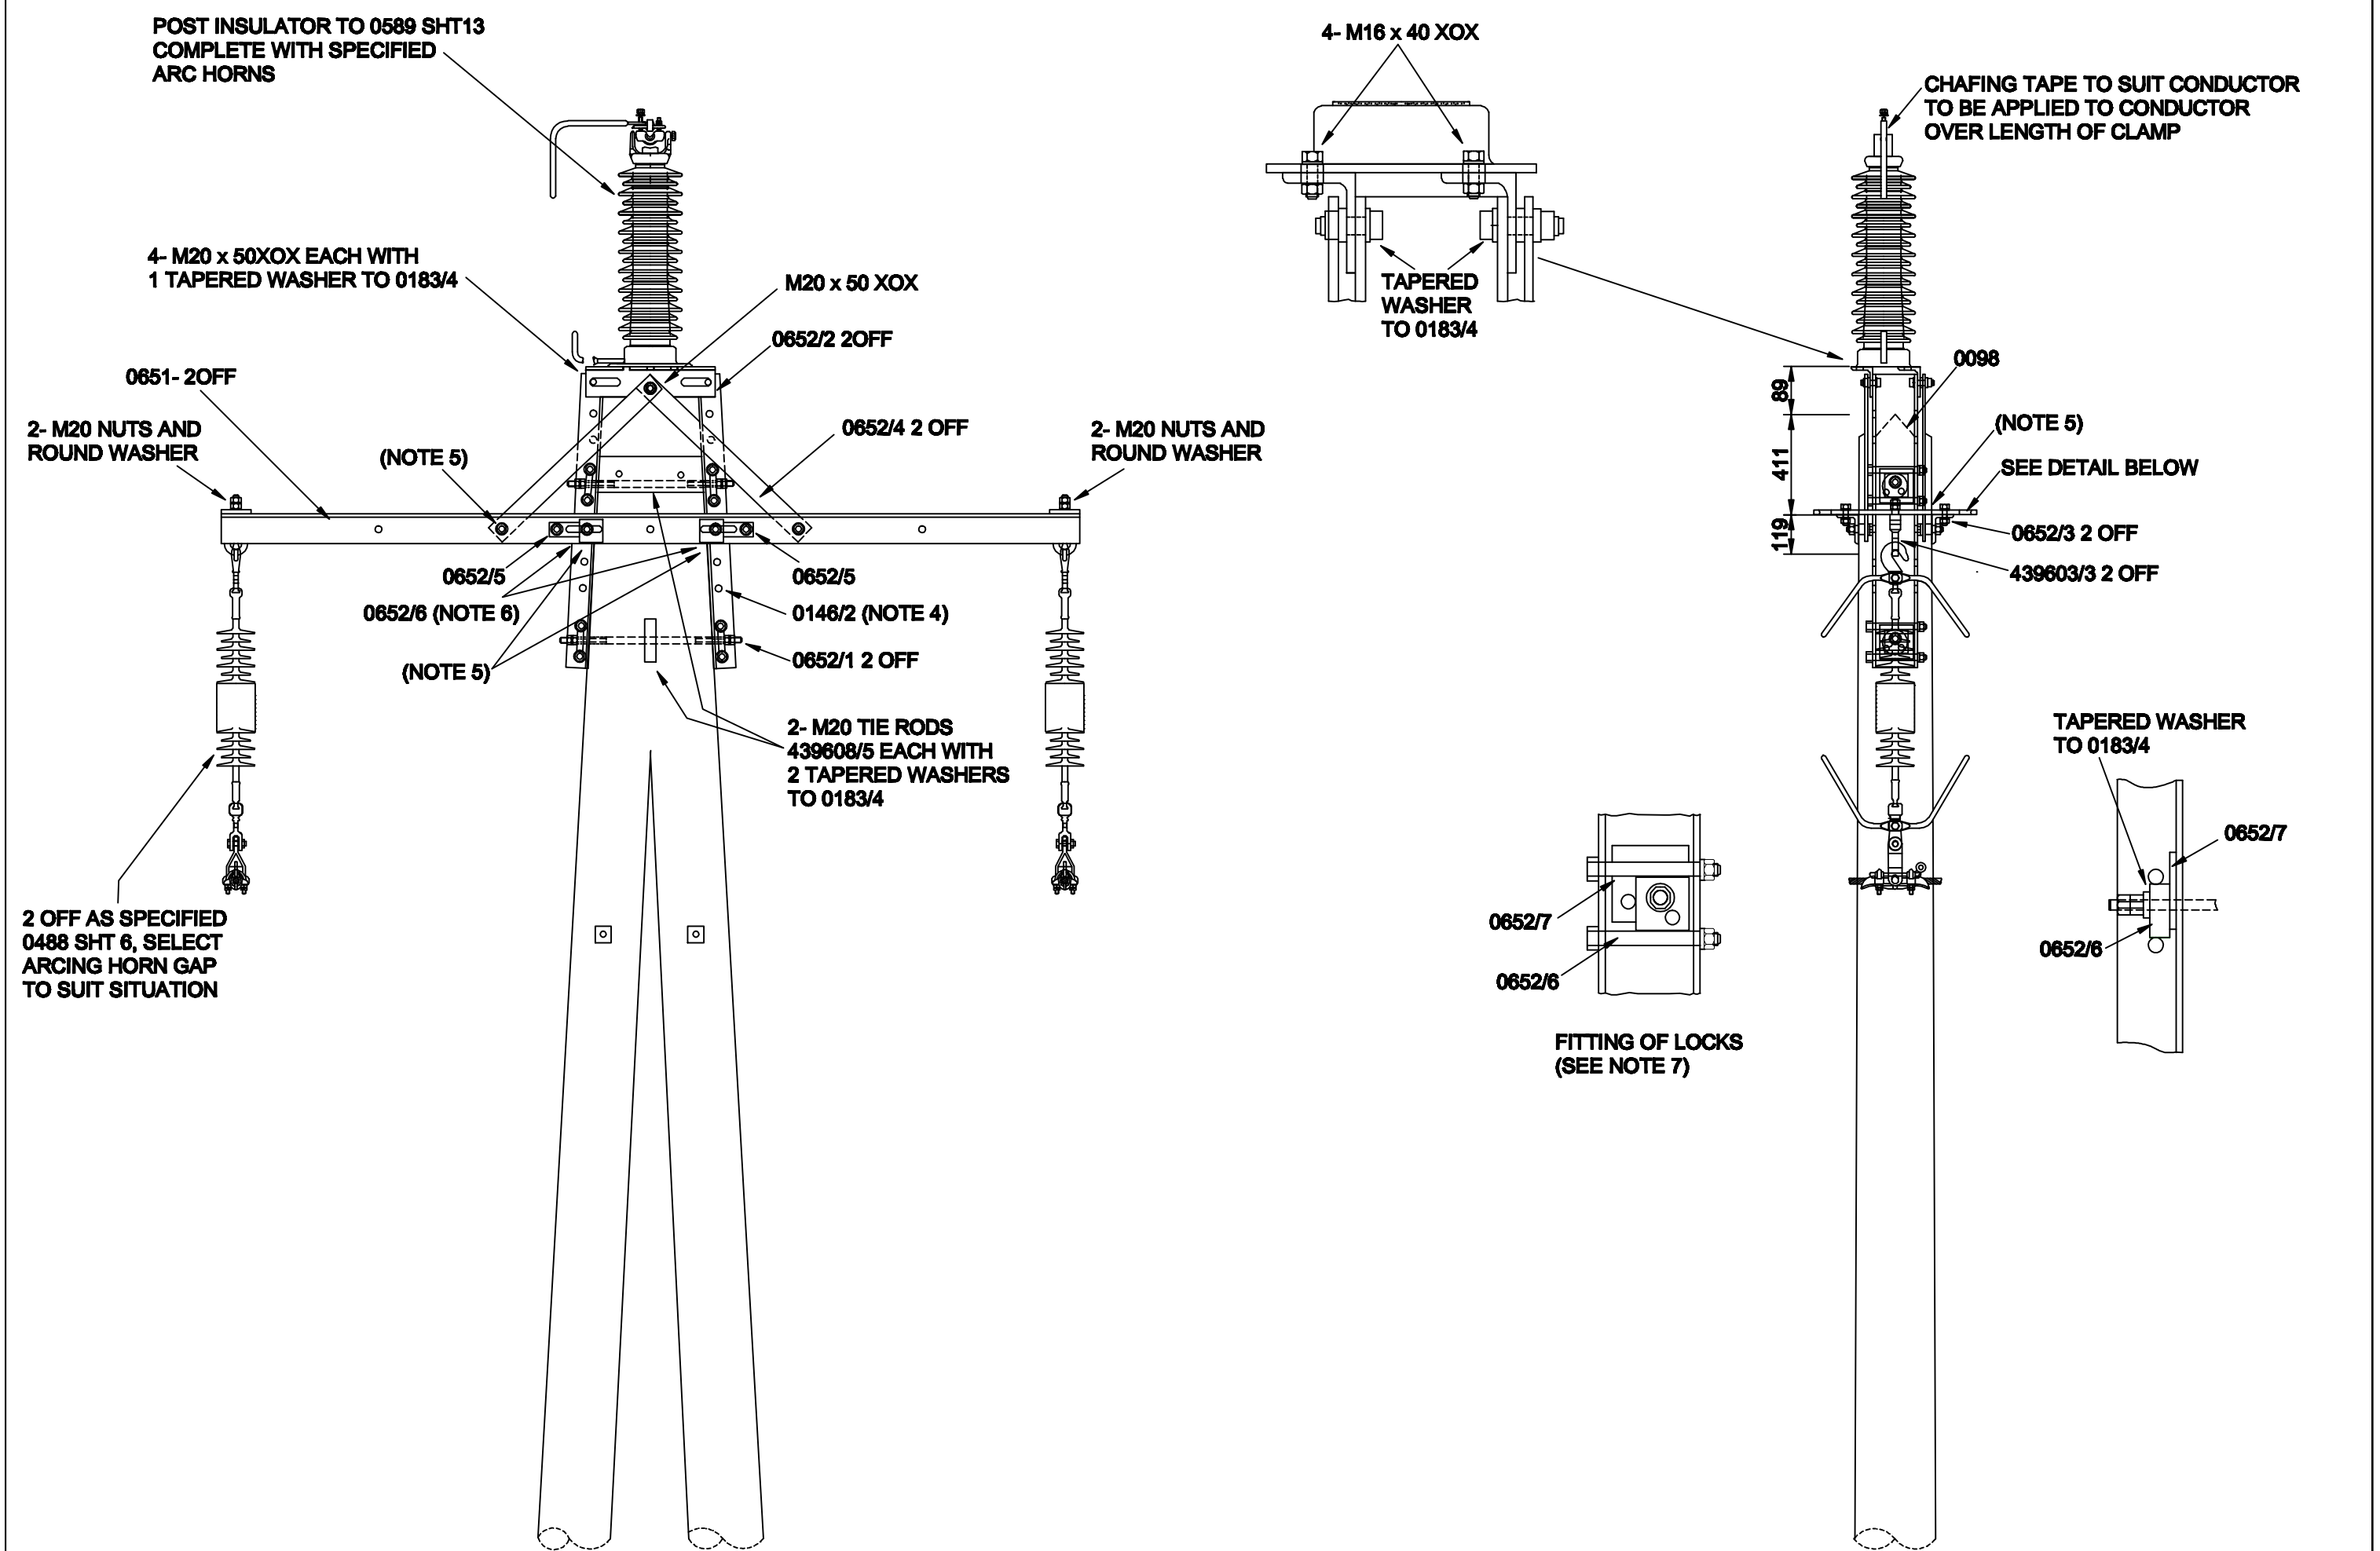

NOTES

- ON LARGER DIAMETER POLES EXISTING POLE SCARFING TO BE MODIFIED. ONLY IF NECESSARY TO PROVIDE FIRM BEARING ON VERTICAL CHANNELS
- DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS, OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES
- ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER NUT, 1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
- WHERE IT IS NECESSARY TO PROVIDE EARTHED STEELWORK, THE REQUIRED COMPRESSION LUG TO BOLTED THROUGH 22mm DIA. HOLE IN VERTICAL CHANNEL COMPRESSION LUG TO BE VPCL 1.4 (22)
- CROSSARM PACKS AS FOLLOWS :-
0652/5 ON CHANNEL FIXING IMMEDIATELY BEHIND CROSSARM
0652/3 ON TIE STRAP AND CHANNEL FIXING
A-IN FRONT OF CROSSARM AND 0652/6 RESPECTIVELY ON STOUT POLES
B-BEHIND CROSSARM AND 0652/5 RESPECTIVELY ON EXTRA STOUT POLES
- LOCKS TO BE ROTATED/FITTED TO ENSURE CONTACT BETWEEN OUTER FACE AND 0652 ITEM 5
- LOCK 0652 ITEM 7 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL POLE FACE.
LOCK 0652 ITEM 6 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN 2-M20 BOLTS WHILST PROVIDING LEVEL MOUNTING FOR POST ANGLES

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM. 'Y'
8.5m - 12.0m INCLUSIVE	2.0m
13.0m - 15.0m INCLUSIVE	2.2m
16.0m - 18.0m INCLUSIVE	2.4m
20.0m - 24.0m INCLUSIVE	3.0m

WORK SPEC. 04/240

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		66KV SINGLE CIRCUIT LINES 'A' POLE ARRANGEMENT FOR HEAVY DUTY STRAIGHT LINE APPLICATION	
Manufacturer Details		Type	POLES
Sheet No. 4	Scale 1:20	Ref No.	C989897
Prepared By Joan.Oakley	Grid Reference	Historic Drg.No.	1091231190
Revised 16/08/10	Checked By G HAMMEL	Revision	Notes
Date Issued 06/08/10			