


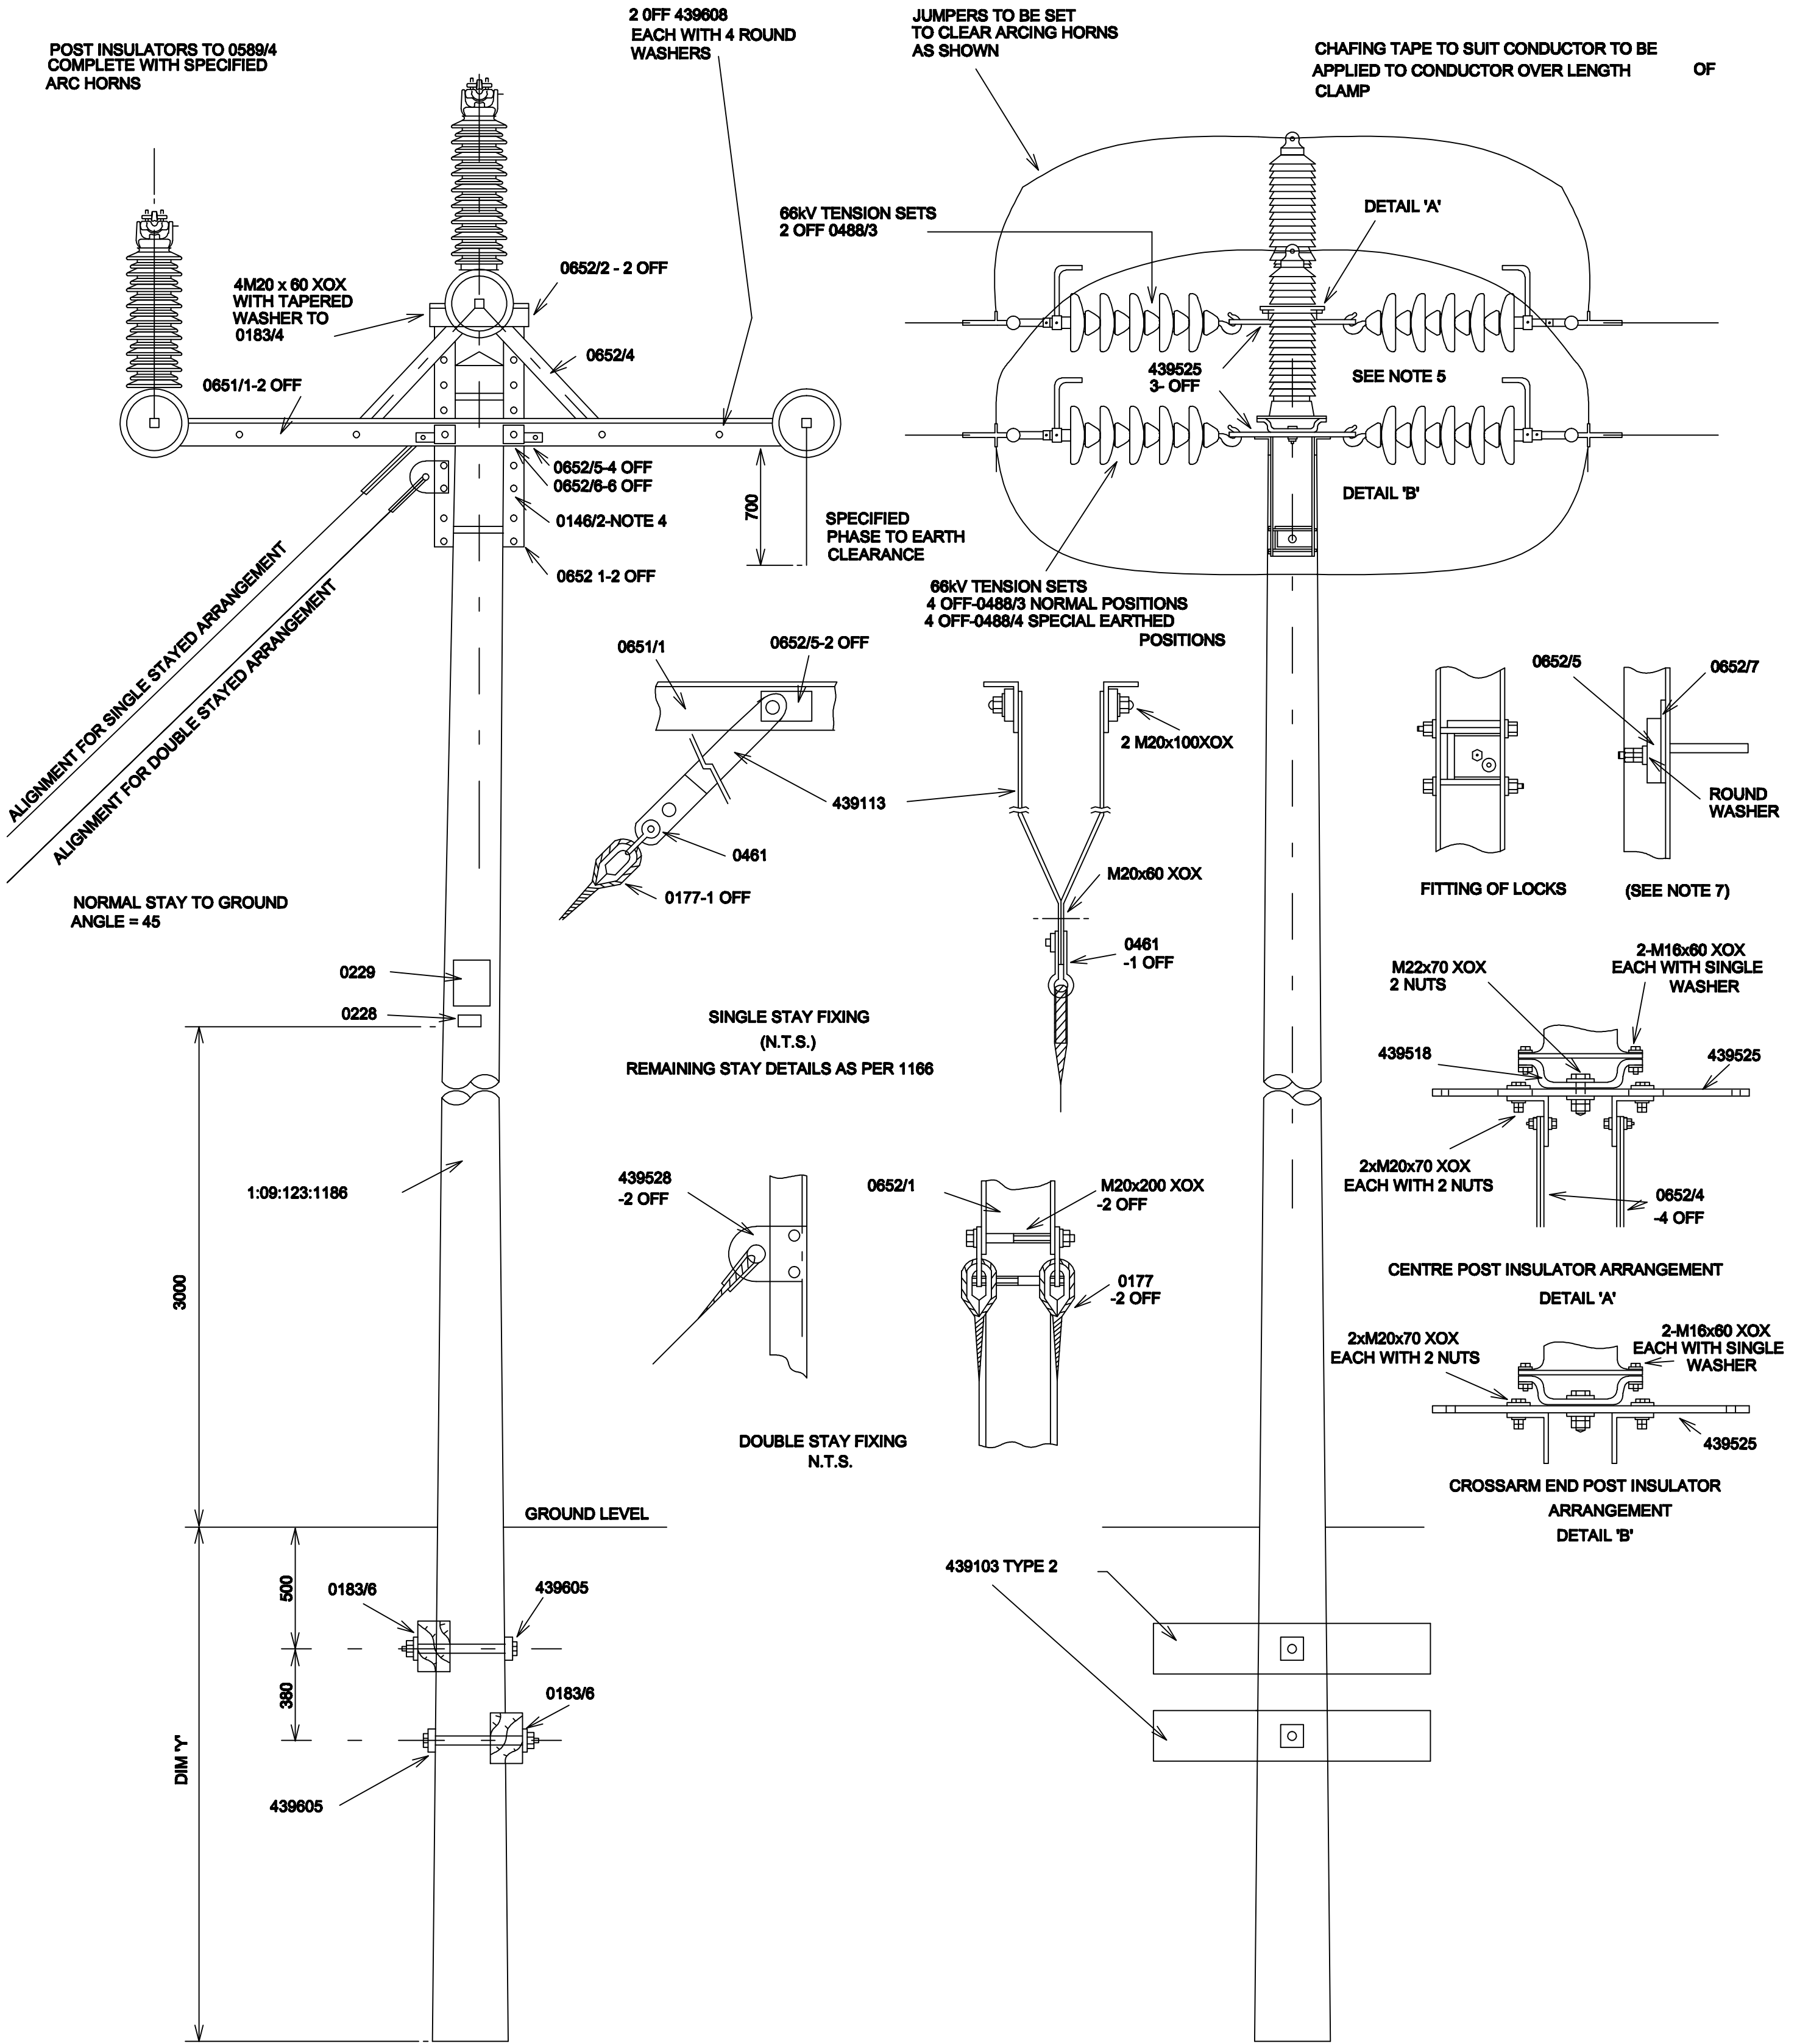

NOTES

1. TIE RODS TO BE 439608/2 FOR SINGLE STOUT POLES AND FOR SINGLE EXTRA STOUT.
2. DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS, OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES
3. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER NUT, 1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
4. WHERE IT IS NECESSARY TO PROVIDE EARTHED STEELWORK, THE REQUIRED COMPRESSION LUG TO BOLTED THROUGH 22mm DIA. HOLE IN VERTICAL CHANNEL COMPRESSION LUG TO BE VPCL 1.4 (22)
5. CROSSARM PACKS AS FOLLOWS :-
 - 0652/5 ON CHANNEL FIXING IMMEDIATELY BEHIND CROSSARM
 - 0652/3 ON TIE STRAP AND CHANNEL FIXING
 - A-IN FRONT OF CROSSARM AND 0652/6 RESPECTIVELY ON STOUT POLES
 - B-BEHIND CROSSARM AND 0652/5 RESPECTIVELY ON EXTRA STOUT POLES
6. LOCKS TO BE ROTATED/FITTED TO ENSURE CONTACT BETWEEN OUTER FACE AND 0652 ITEM 5
7. LOCK 0652 ITEM 7 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL POLE FACE.
LOCK 0652 ITEM 6 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN 2-M20 BOLTS WHILST PROVIDING LEVEL MOUNTING FOR

POST ANGLES

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM. 'Y'
8.5m - 12.0m INCLUSIVE	2.0m
13.0m - 15.0m INCLUSIVE	2.2m
16.0m - 18.0m INCLUSIVE	2.4m
20.0m - 24.0m INCLUSIVE	3.0m

WORK SPEC. 04/242

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV SINGLE CIRCUIT LINE SINGLE POLE ARRANGEMENT, NORMAL SPAN MEDIUM ANGLE APPLICATION	
Sheet No. 1	Scale 1:20	Type OVERHEAD LINES	
Prepared By Joan.Oakley	Grid Reference	Ref No. C989807	Historic Drg.No. 1091231192
Revised 03/08/10	Date Issued 03/08/10	Checked By G HAMMEL	Revision Notes