


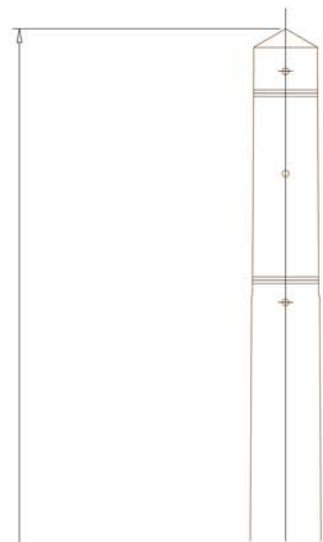


SEE POLE HEIGHT IN TABLE.

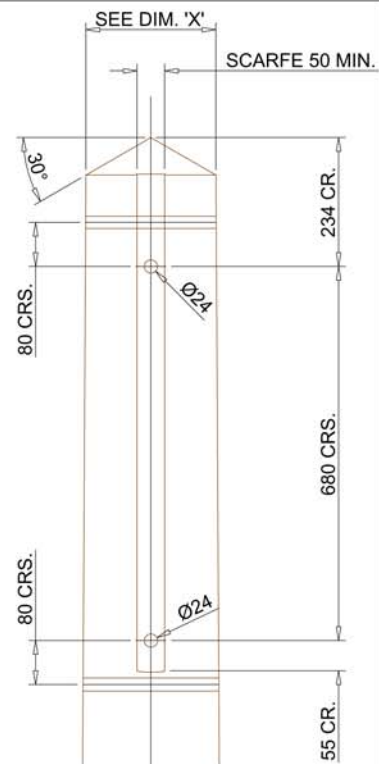

HOLES FOR LADDER
SYSTEM TO BE
DRILLED IN THIS FACE

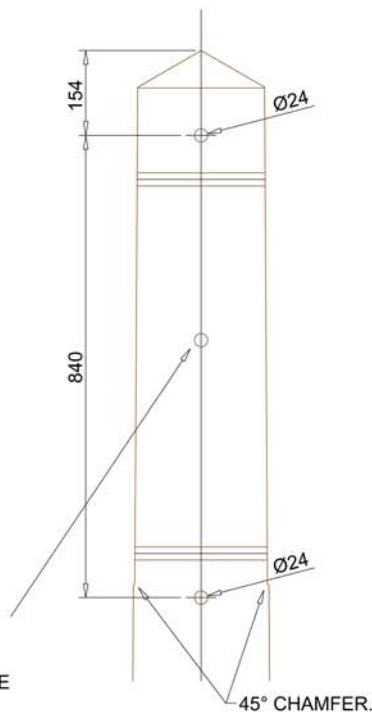

NOTE HOLE FOR ENHANCED ANTI CLIMBING DEVICE.

2750 MIN.

POLE PLANTING DEPTH 2400

GROUND
LEVEL

SEE DIM. 'Y'

1500 TO DIMENSION 'Y'

SCALE:- 1:20

POLE LENGTH/ CLASS TO BE
IMRESSED ON POLE BUTT.

THIS VIEW SHOWS
THE POLE FACE
(NATURAL LIE OF POLE).

ENLARGED VIEWS OF POLE APEX SCALE 1:10

IMPORTANT NOTE

THE SCARFE IS PARALLEL TO THE POLE EDGE
& NOT THE POLE CENTRELINE.

SCARFING TO BE CUT TO GIVE A
50mm WIDE FLAT ON TWO DIAMETRICALLY
OPPOSITE FACES WITH ENDS CHAMFERED
AS SHOWN.

NOTES

1. CLASS OF POLE TO BE EXTRA STOUT
IN ACCORDANCE WITH 1.09.101.0238
2. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS
OF POLE.
3. ALL HOLES EXCEPT WHERE STATED OTHERWISE
TO BE 24mm DIA. DRILLED AT RIGHT ANGLES
TO VERTICAL CENTRELINE OF POLE. ALL DRILLING
& CUTTING TO BE DONE STRICTLY TO TEMPLATE
PRIOR TO CREOSOTING.
4. BS 1990 TABULATED MIN VALUES HAVE BEEN
AMENDED TO REFLECT CALCULATED MEAN VALUES

ITEM	POLE HEIGHT	DIMENSION 'X' (Min/ Max)	DIMENSION 'Y' (Min/ Max)
A	12000 mm	Ø242 mm - Ø260 mm	Ø333 mm - Ø370 mm
B	13000 mm	Ø247 mm - Ø265 mm	Ø371 mm - Ø390 mm
C	14000 mm	Ø247 mm - Ø265 mm	Ø384 mm - Ø400 mm
D	15000 mm	Ø247 mm - Ø265 mm	Ø394 mm - Ø420 mm
E	16000 mm	Ø253 mm - Ø270 mm	Ø418 mm - Ø435 mm
F	17000 mm	Ø253 mm - Ø270 mm	Ø431 mm - Ø450 mm



Manufacturer Details

Sheet No. 2 Scale AS SHOWN

Prepared By Janis.Webb

Revised 14/08/07 Grid Reference

Date Issued 02/07/07 Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

132KV OVERHEAD LINES DRILLING, SCARFING AND MARKINGS FOR SINGLE ANGLE POLE ARRANGEMENT

Type OVERHEAD DOCUMENT_SUB_CLASS

Ref No. C949737 Historic Drg.No. 1091390003

Revision D Notes