


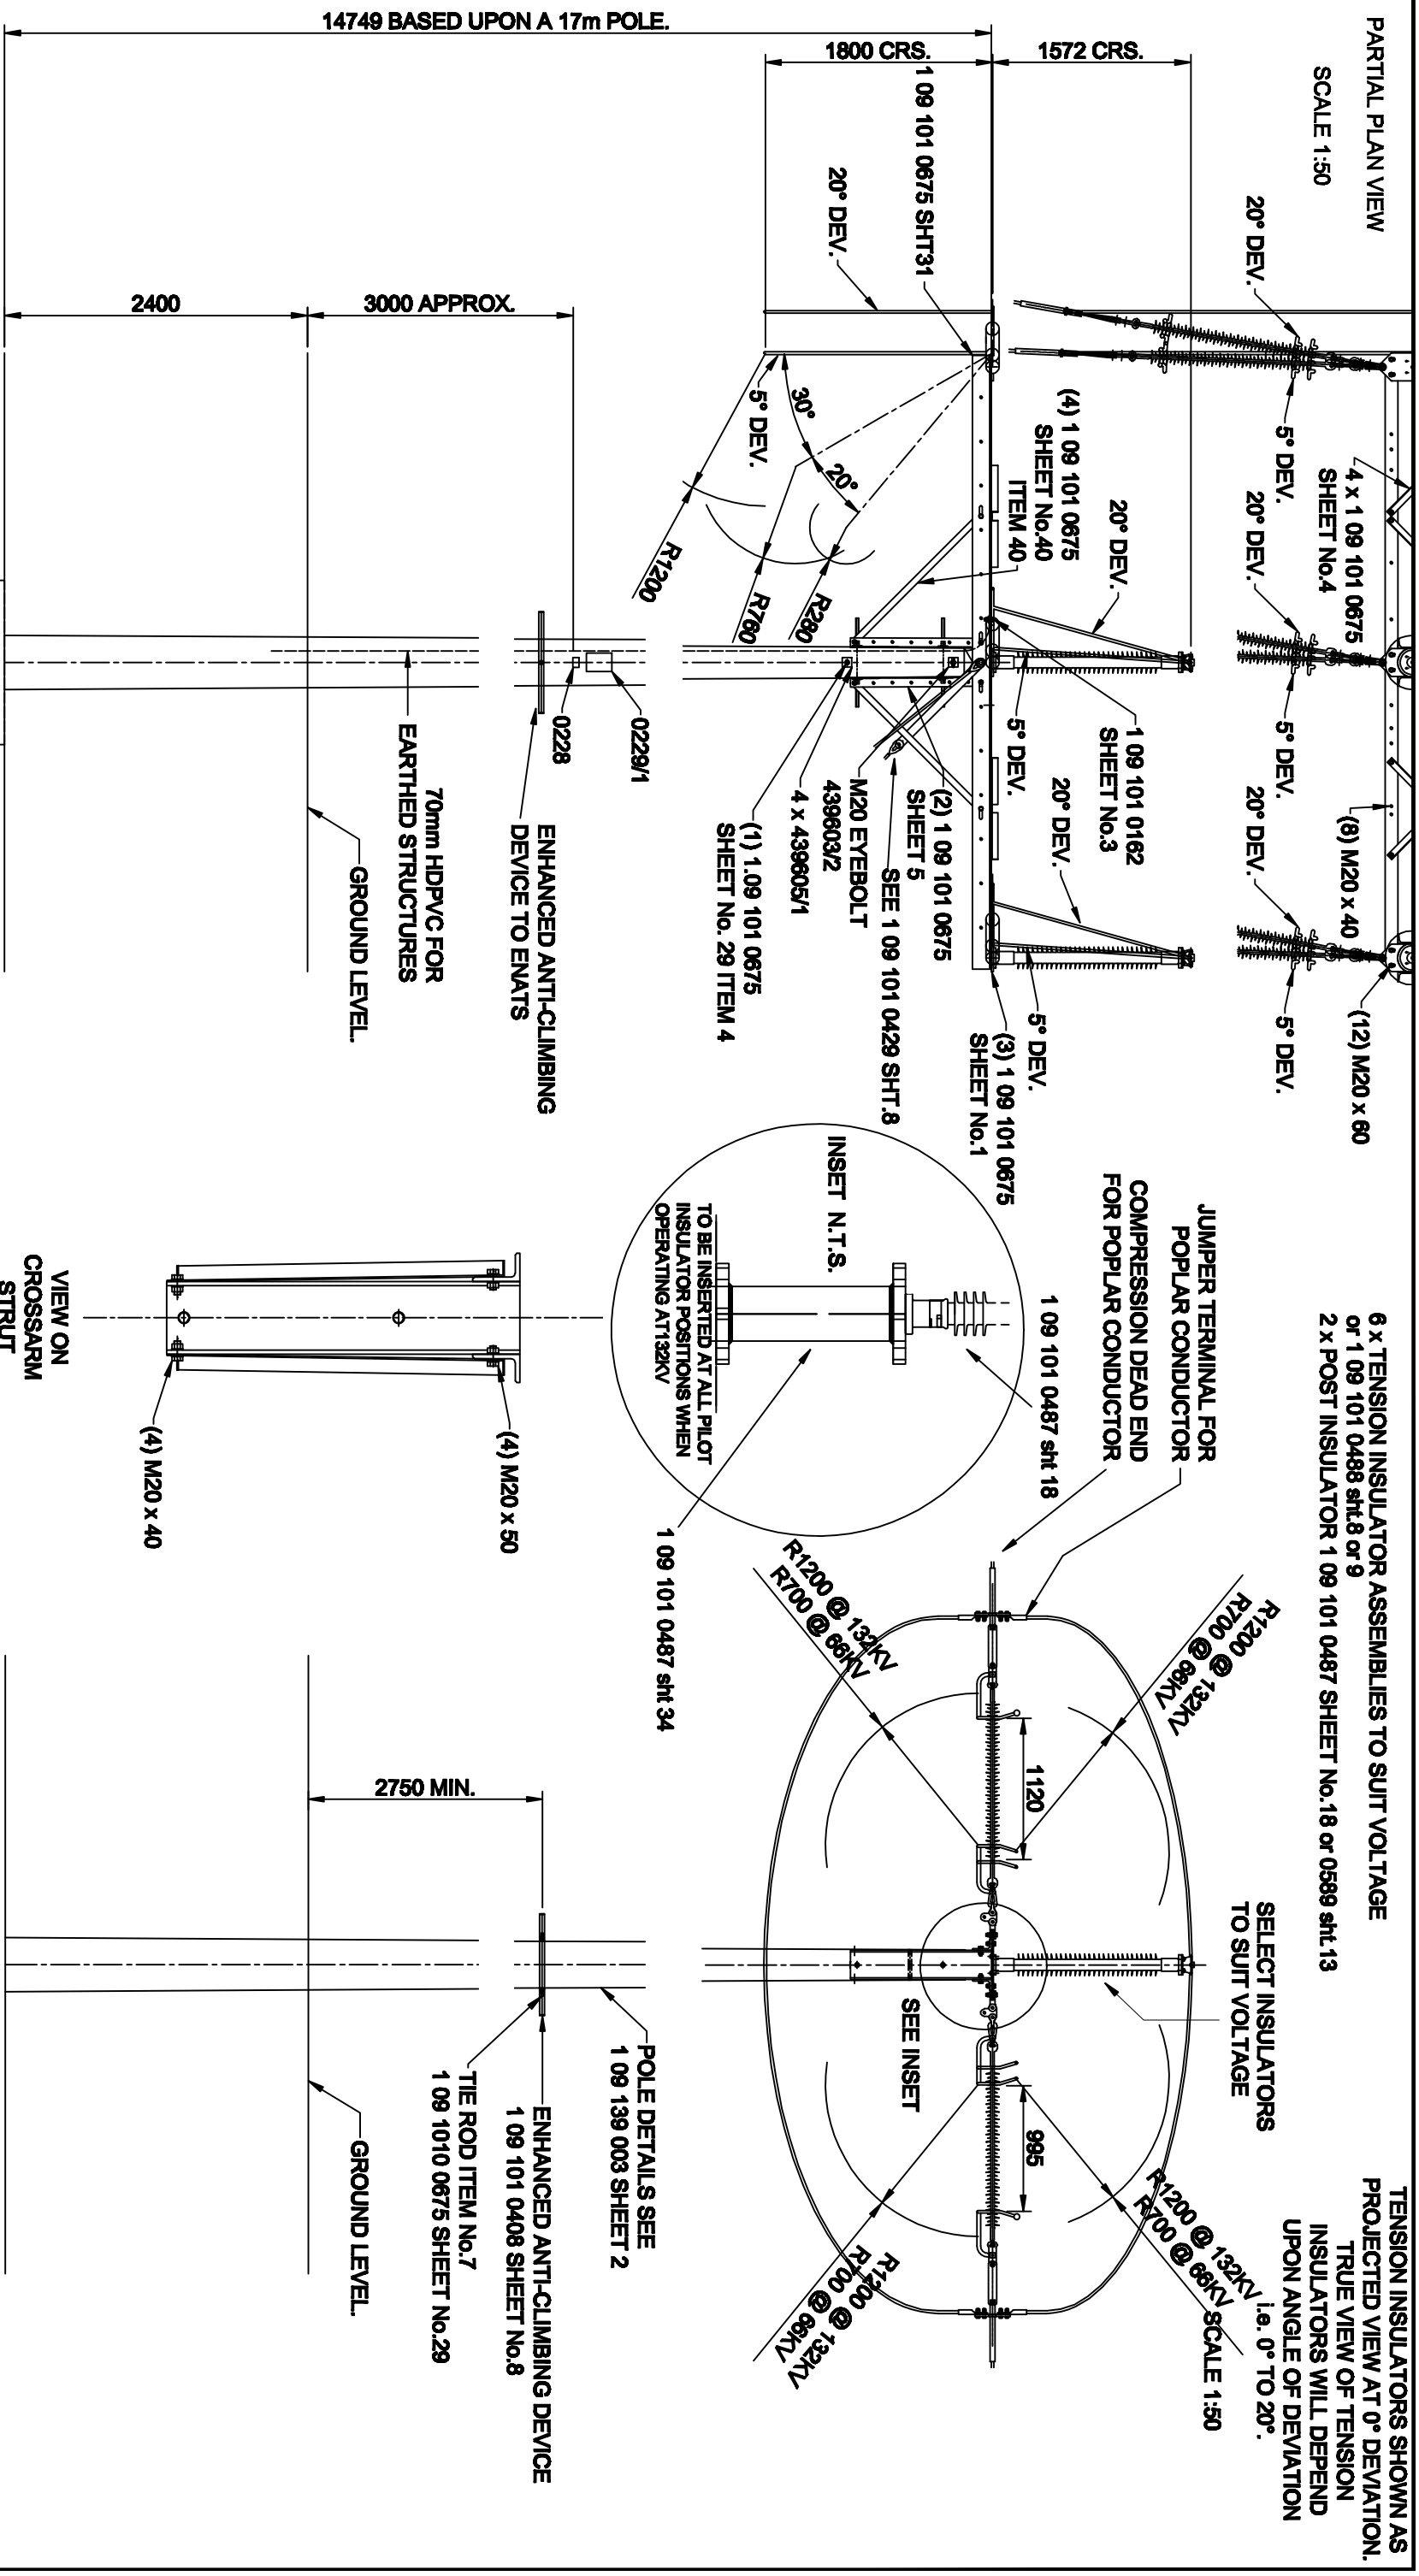

- NOTES:**
1. ALL STEELWORK FIXINGS BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER BOLT HEAD & 1 ROUND WASHER UNDER NUT, UNLESS STATED OTHERWISE. WHERE A CHANNEL IS USED A 5" TAPER WASHER SHOULD BE FITTED TO LEGS ONLY.
 2. FOR DETAIL DRAWINGS PREFIXED 43 REFER TO E.S.I. DRAWINGS FOR OTHER DETAIL DRAWINGS REFER TO 1.09.101.0675 SERIES.
 3. ARcing HORN GAPS TO BE SET 1000 FOR APPROACH & 1175 FOR NORMAL CONDITIONS ie 132kV THE ALTERNATIVE VALUES ARE SHOWN FOR 66kV OPERATION..

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF 66/132KV OVERHEAD LINES ASSEMBLY OF SINGLE POLE DEVIATION 2 DEGREES - 20 DEGREES USING COMPRESSION TERMINALS	
Manufacturer Details			
Sheet No. 1	Scale 1:50		
Prepared By Caralyn Palmer			
Reviewed 27/08/10	Grid Reference	Ref No. C949727	Historic Drg.No. 1091390013
Date Issued 02/07/07	Checked By G HAMMEL	Revision E	Notes