


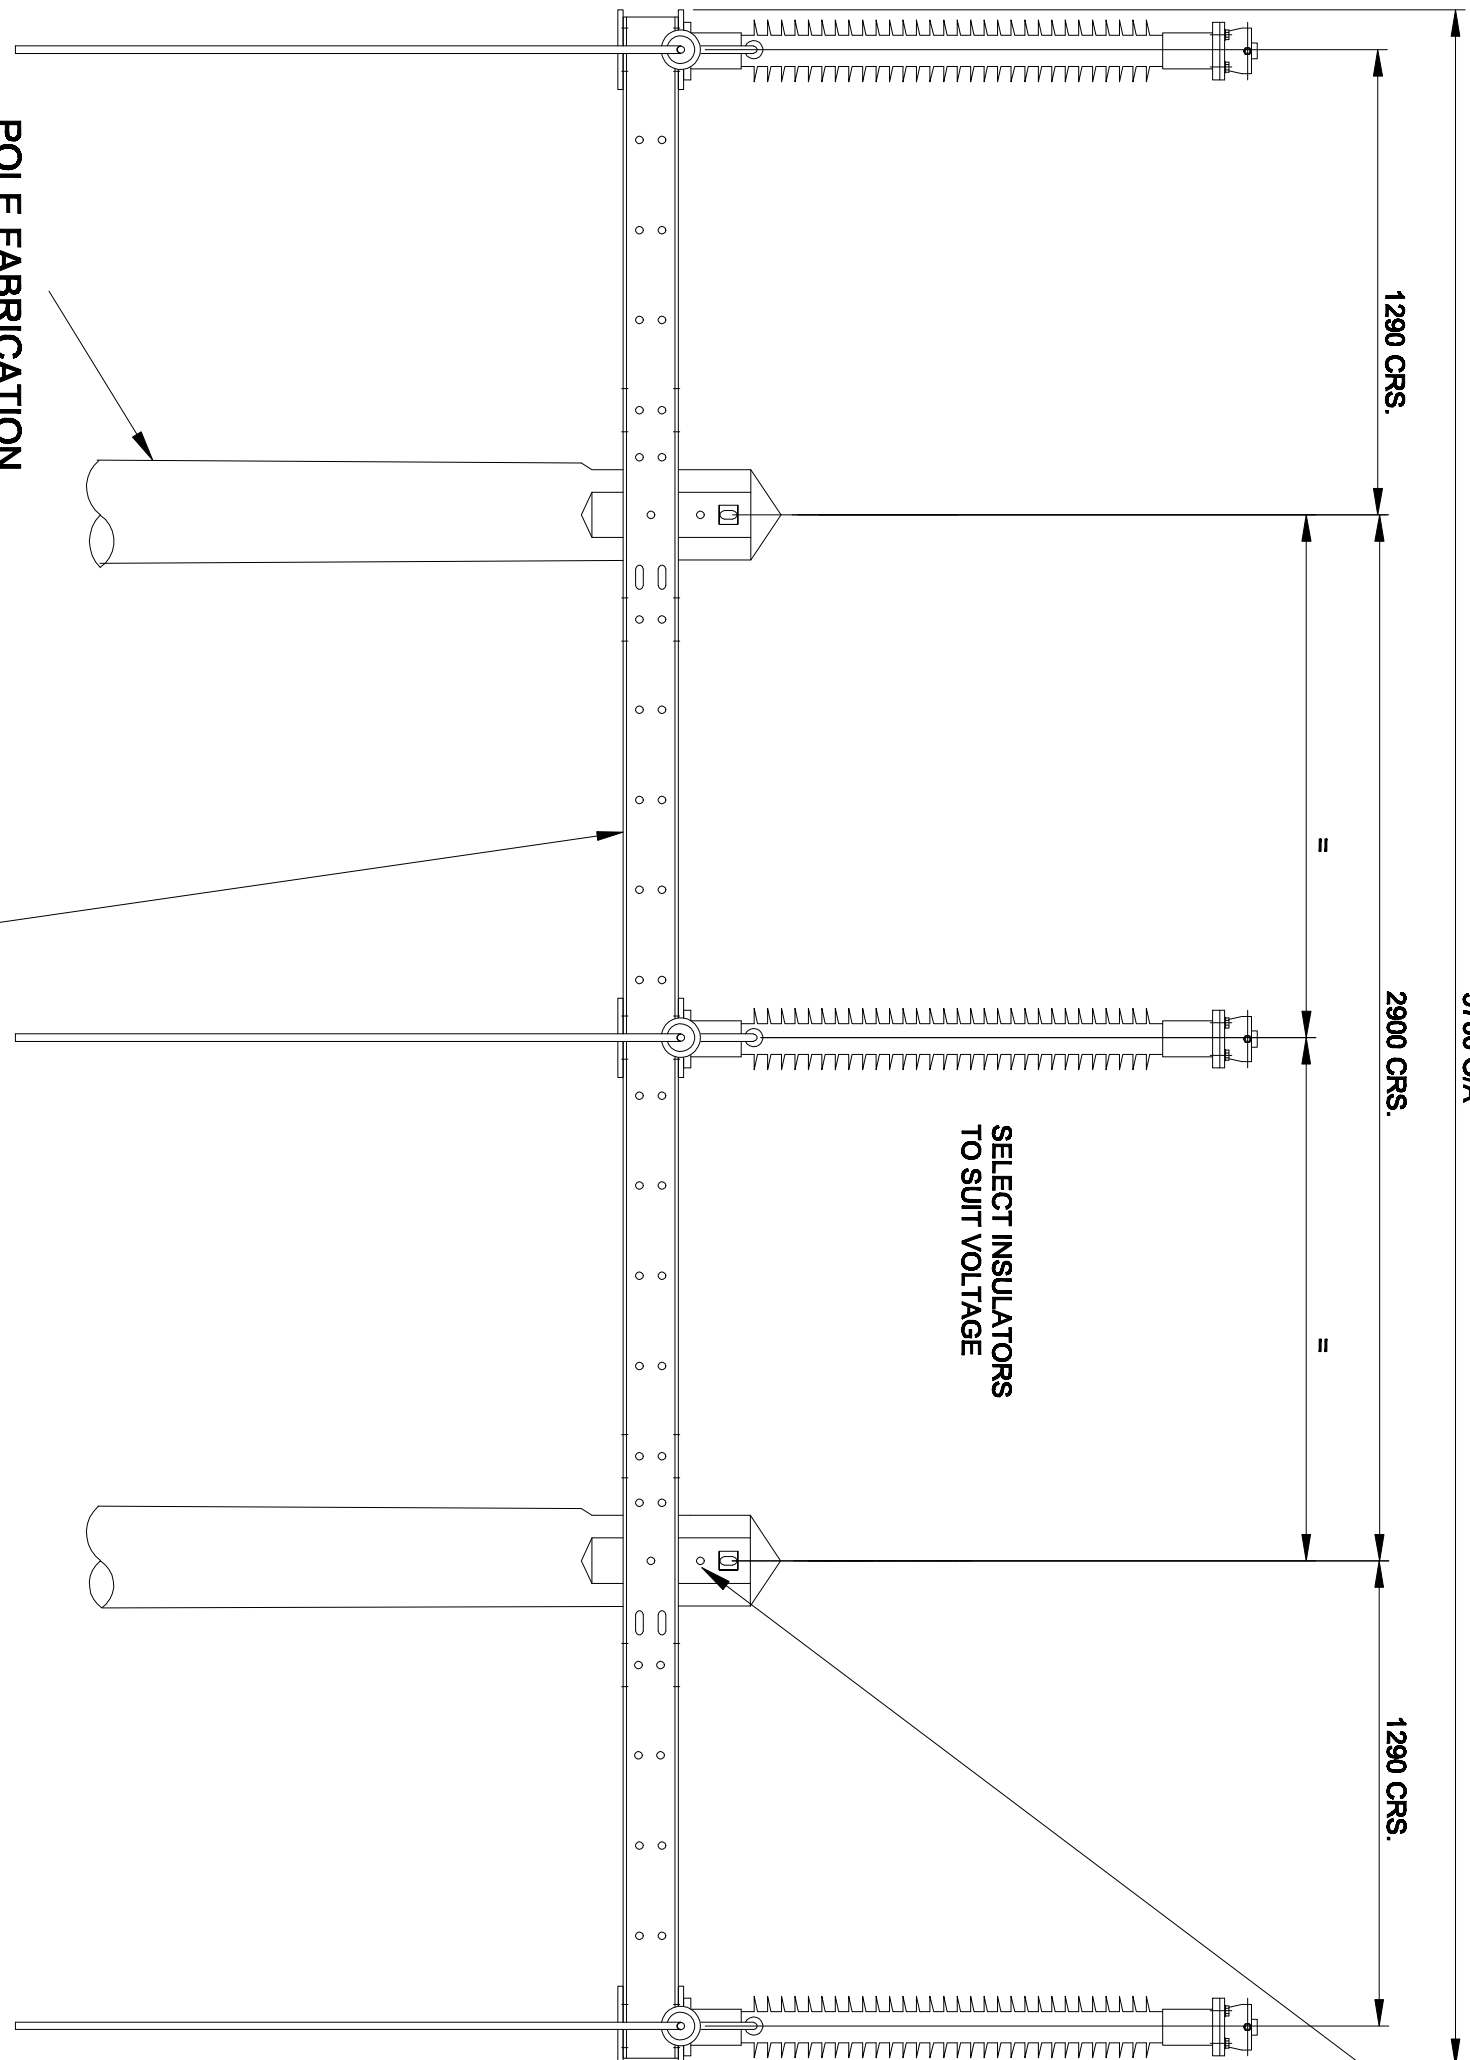

POLE FABRICATION
1 09 139 0019 SHEET 2

SEE DRAWING 1 09 101 0675
SHEET 50 FOR CROSSARM
COMPONENTS.

4 x SQ. WASHER 1 09 101 0103 SHEET No.3

2 x EYEBOLT 1 00 043 3903
TYPE 2 CAT No.38 9009

**FIXING HOLE TO BE PLUGGED
FOR THIS APPLICATION
(BOTH LEGS)**

POST INSULATOR REQUIRED
FOR 132kV DRAWING 1 09 101 0487 SHT 18
OR 1091011589 SHT13


INSULATORS TO SUIT VOLTAGE
1091010487 SHT 18 OR
1091010488 SHT 8 OR 9

JUMPERS UNDER SLUNG
R1200 for 132kV
Supported JUMPERS

JUMPERS UNDER SLUNG
R1200 for 132kV
Supported JUMPERS

(24) BOLT M20 x 80LG
EACH WITH NUT,
TAPER WASHER
& PLN. WASHER


CROSSARM
1 09 101 0675
SHEET 50 ITEM 1

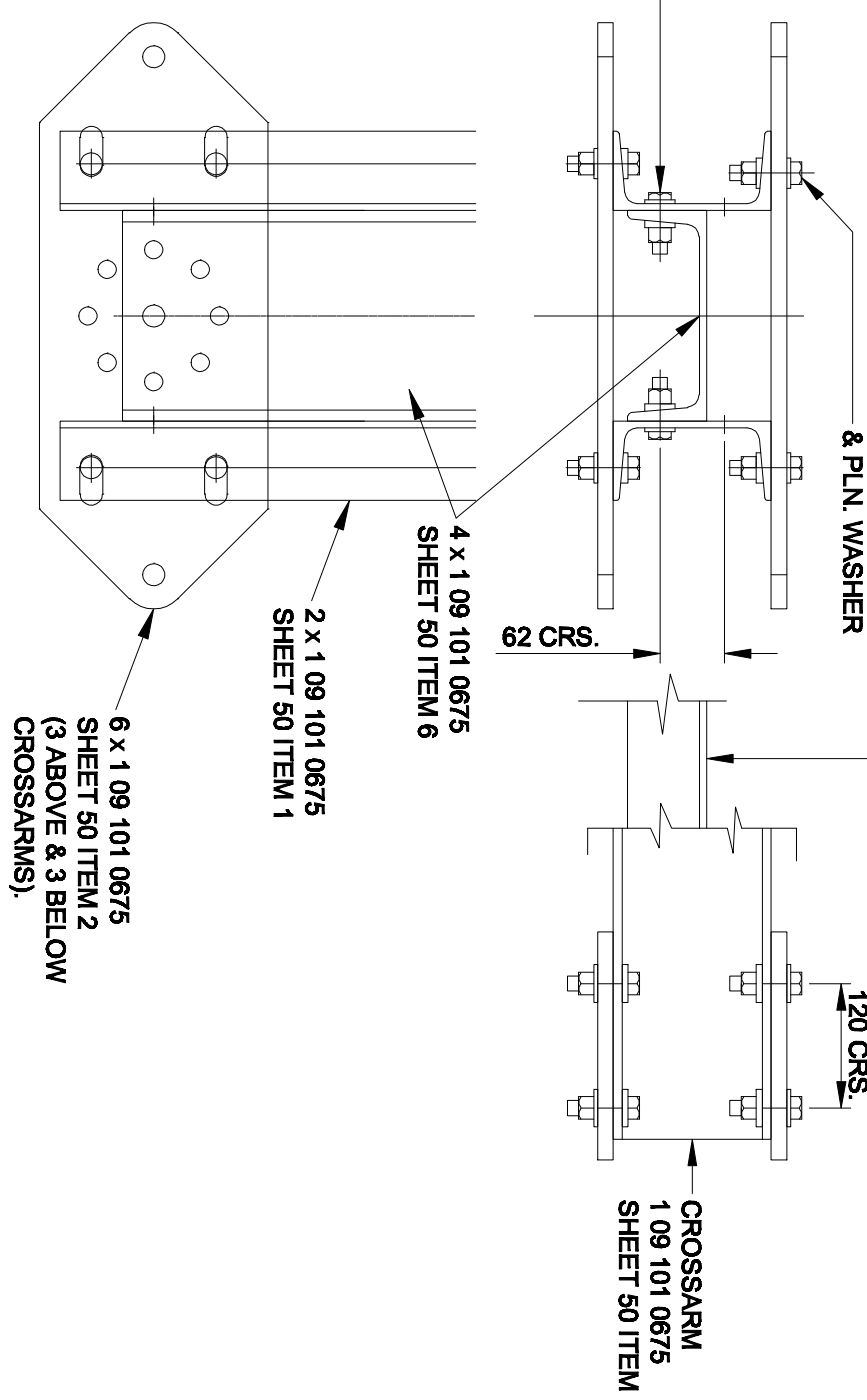


ENLARGED SCALE DETAIL 'A'

SEE 1 09 101 0675 SHEET 50
FOR CROSSARM DETAILS

DETAIL 'A'

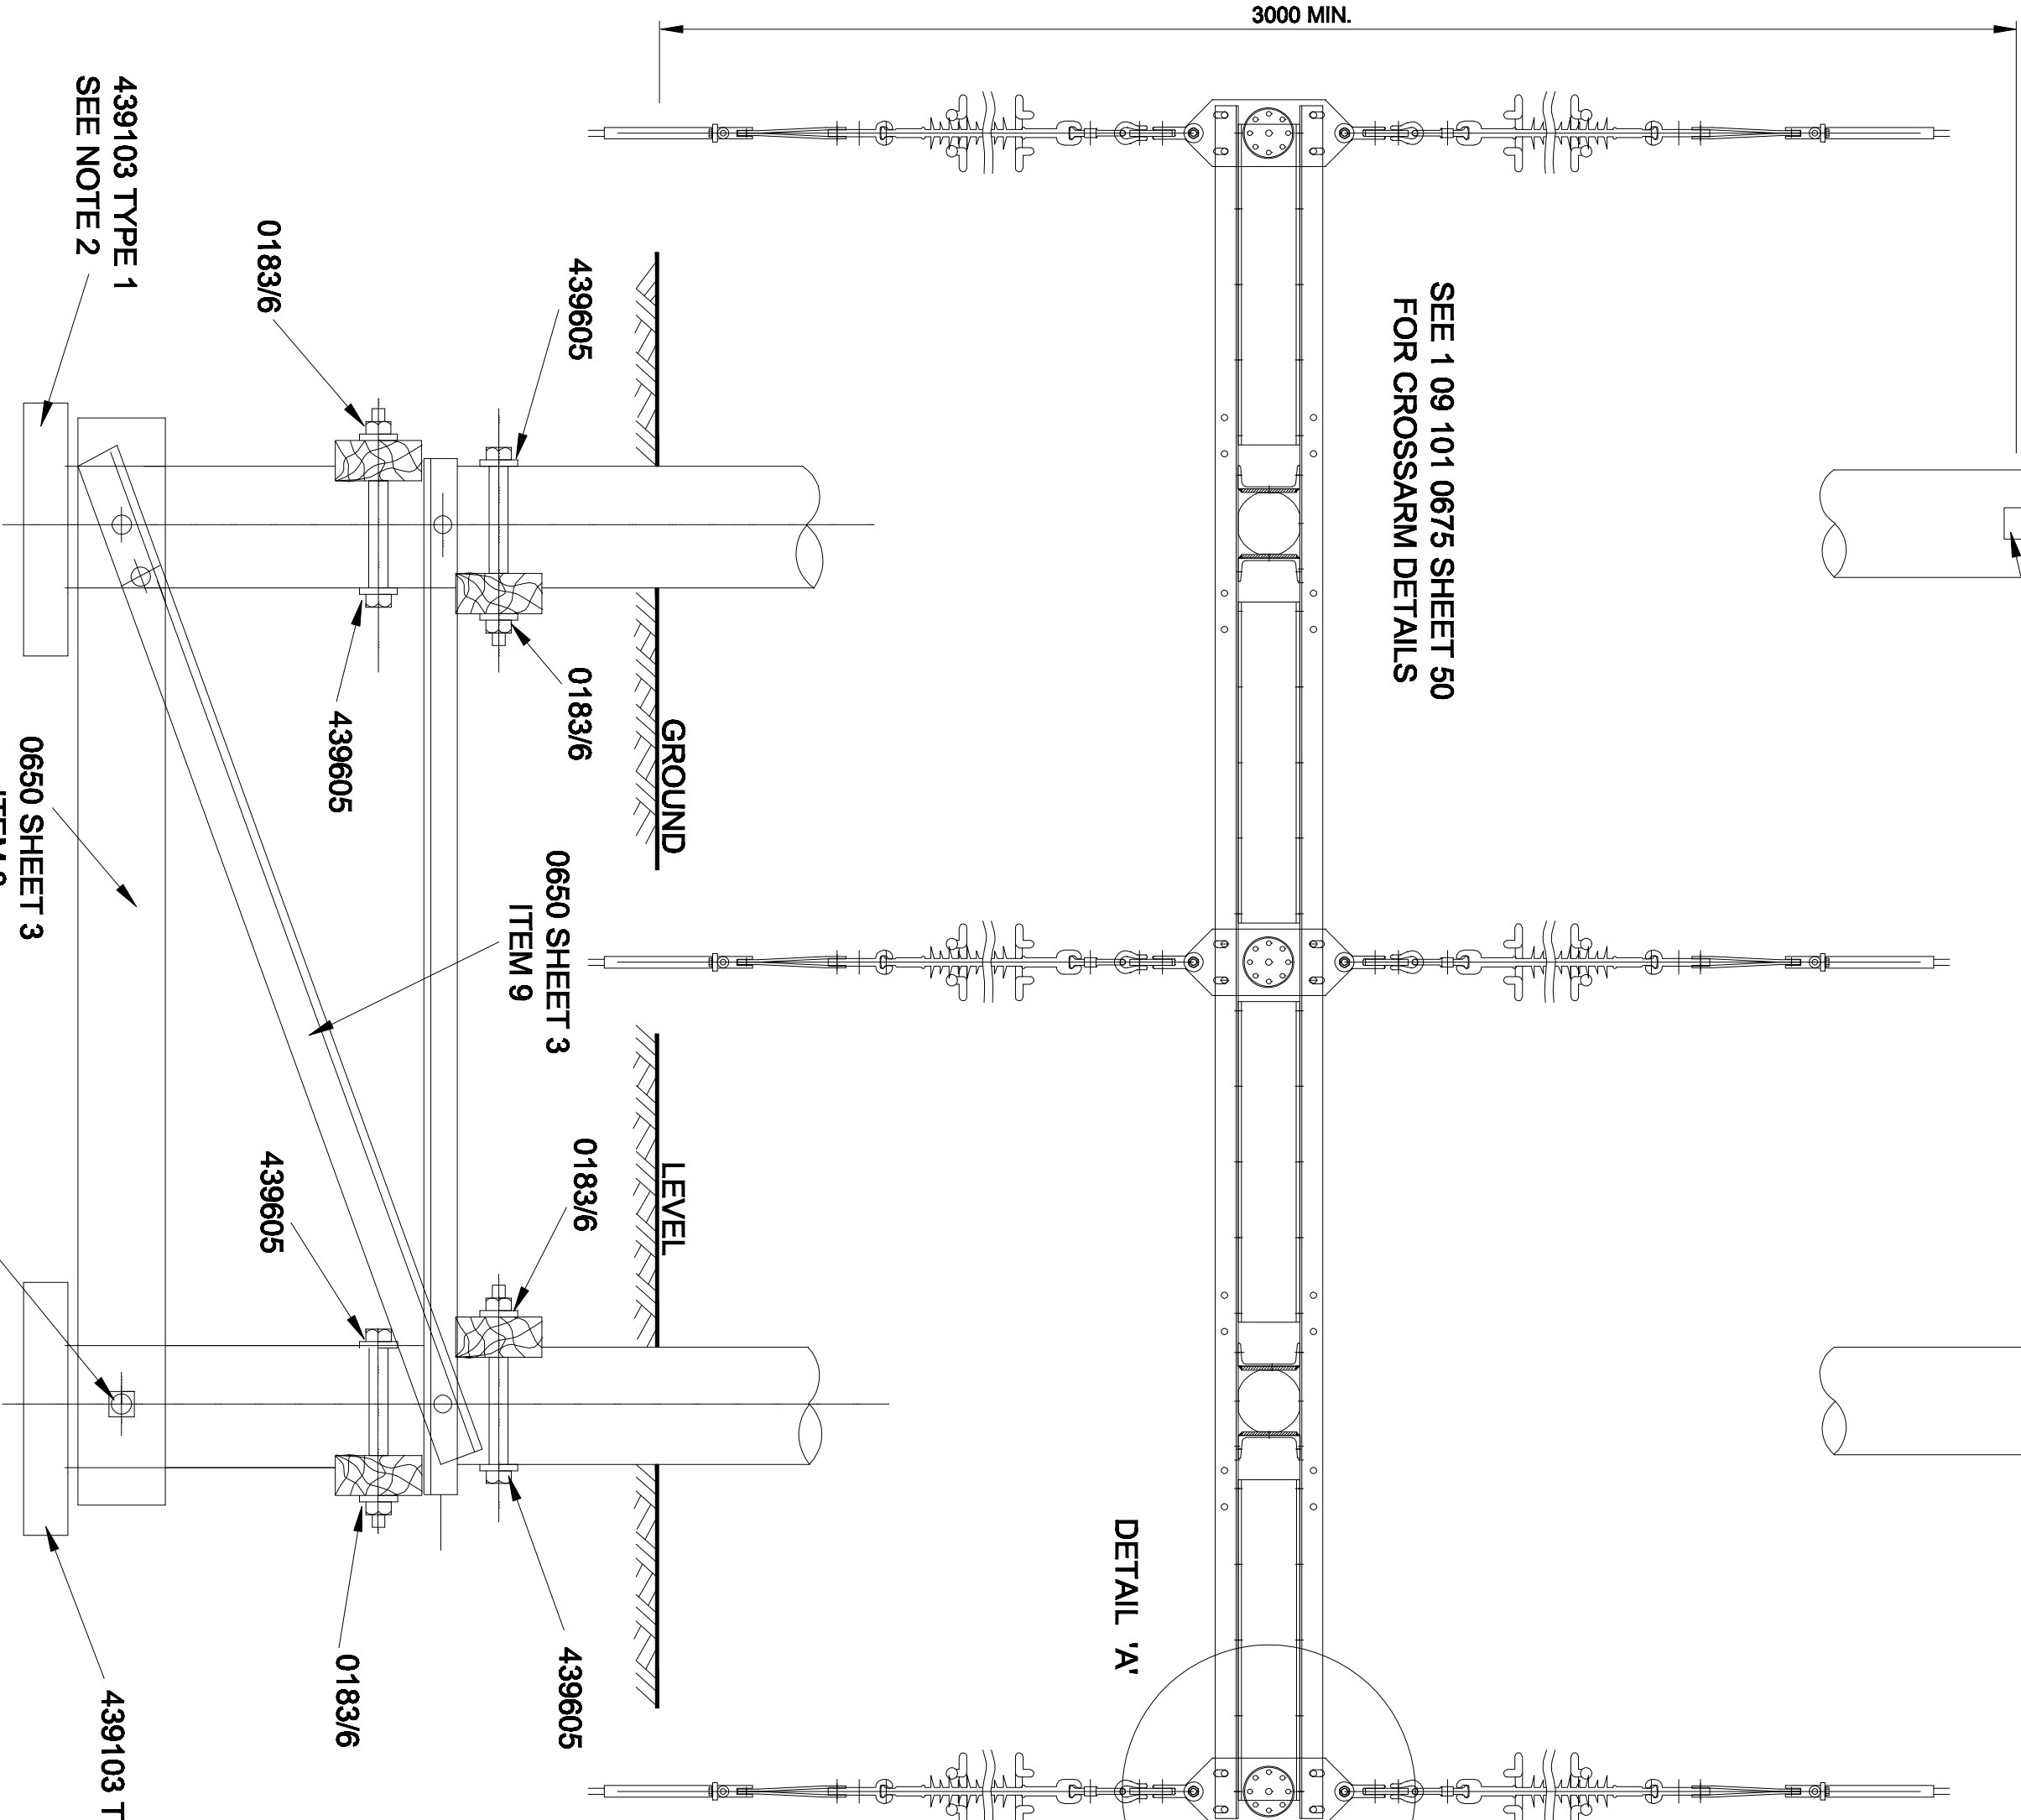

ENLARGED SCALE DETAIL
OF CROSSARM FIXING

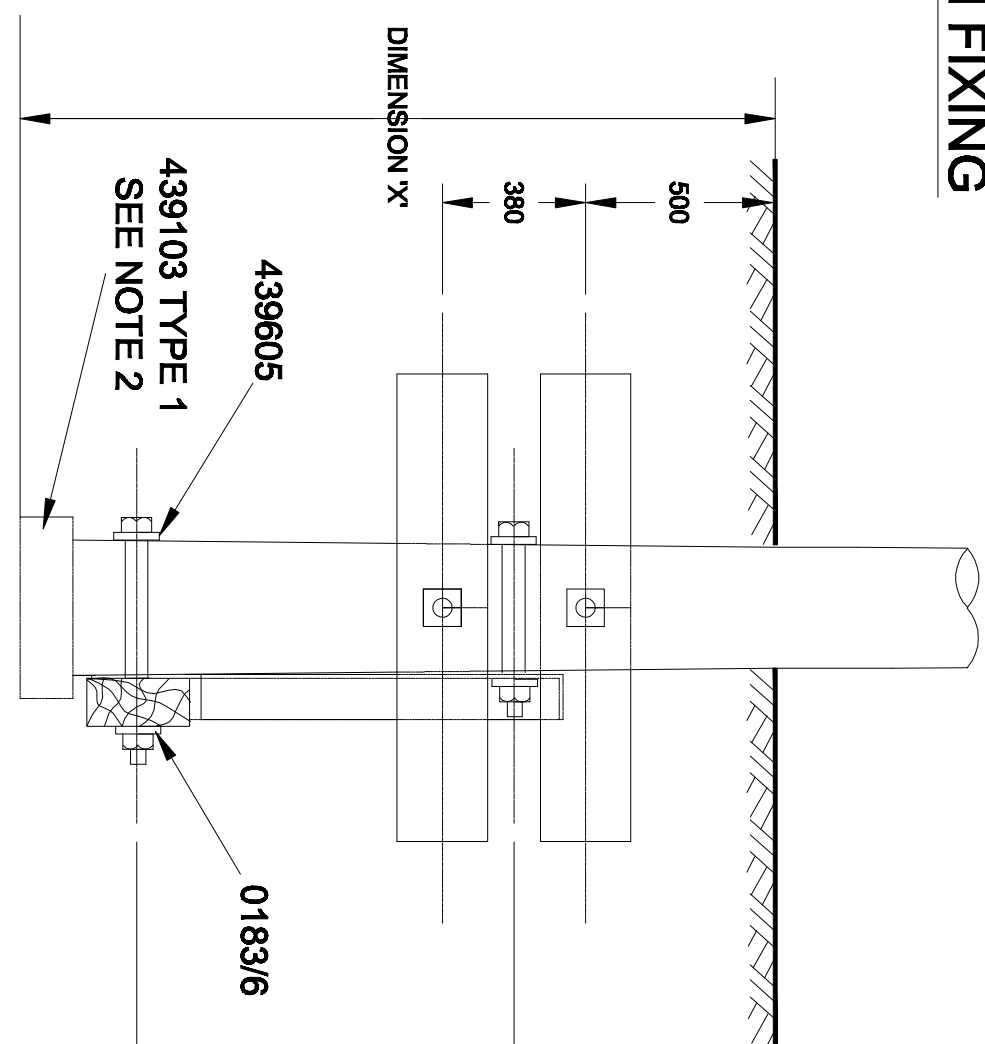

ALL DIMENSION SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 NO WOOD BALKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
 3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
 4. CLEARANCE BETWEEN PHASES AND STEELWORK OR TIMBER TO BE 1200mm
 5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
 6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

 CE Electric UK				Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturing Details				66kV/132kV SINGLE CIRCUIT OVERHEAD LINES STRAIGHT LINE SECTION STRUCTURE 2.9 CTRS 'H' POLE			
Sheet No.	Scale			Type		POLES	
	N.T.S.			OVERHEAD			
Designed By John Oakley				Grid Reference		Ref No. C980130	
Reviewed 17/09/10				Checked By G HAMMILL		Historic Drg No. 1091390020	
Data Issued 17/09/10				Revision		Notes	